Cost sensitivity of optimal sector-coupled district heating production systems

Magnus Dahl^{a,b}, Adam Brun^b, Gorm B. Andresen^a

^aDepartment of Engineering, Aarhus University, Inge Lehmanns Gade 10, 8000 Aarhus C, Denmark ^bAffaldVarme Aarhus, Municipality of Aarhus, Bautavej 1, 8210 Aarhus V, Denmark

Abstract

Goals to reduce carbon emissions and changing electricity prices due to increasing penetrations of wind power generation affect the planning and operation of district heating production systems. Through extensive multivariate sensitivity analysis, this study estimates the robustness of future cost-optimal heat production systems under changing electricity prices, fuel cost and investment cost. Optimal production capacities are installed choosing from a range of well-established production and storage technologies including boilers, combined heat and power (CHP) units, power-to-heat technologies and heat storages. The optimal heat production system is characterized in three different electricity pricing scenarios: Historical, wind power dominated and demand dominated. Coal CHP, large heat pumps and heat storages dominate the optimal system if fossil fuels are allowed. Heat pumps and storages take over if fossil fuels are excluded. The capacity allocation between CHP and heat pumps is highly dependent on cost assumptions in the fossil fuel scenario, but the optimal capacities become much more robust if fossil fuels are not included. System cost becomes less robust in a fossil free scenario. If the electricity pricing is dominated by wind power generation or by the electricity demand, heat pumps become more favorable compared to cogeneration units. The need for heat storage more than doubles, if fossil fuels are not included, as the heating system becomes more closely coupled to the electricity system.

Keywords: District heating, Energy production, Optimization, Cost sensitivity, Fossil free

Goals to reduce carbon emissions and changing electricity paffect the planning and operation of district heating procupations, this study estimates the robustness of future cost prices, fuel cost and investment cost. Optimal production caproduction and storage technologies including boilers, comb and heat storages. The optimal heat production system is Historical, wind power dominated and demand dominated. optimal system if fossil fuels are allowed. Heat pumps and allocation between CHP and heat pumps is highly depend optimal capacities become much more robust if fossil fuels free scenario. If the electricity pricing is dominated by wind become more favorable compared to cogeneration units. To not included, as the heating system becomes more closely of the compared to cogeneration units. To not included, as the heating system becomes more closely of the decrease carbon emissions call for the transformation of heat production systems away from fossil fuels and towards fossil free alternatives. In modern district heating systems combined heat and power (CHP) plants form the backbone of the production system and usually provide a majority of the heat. Coal and gas fuelled CHP is cheaper than biomass based CHP but problematic from a carbon emissions perspective. At the same time, electricity systems are quickly adopting large amounts of wind power generation, which reduces the economic feasibility of CHP generation by periodically lowering electricity prices [1, 2]. Power-to-heat technologies benefit from this development, especially in combination with heat storage technologies.

In this study, we explore how the cost-optimal compositions of a city-wide heat production system changes when moving into a fossil-free future. The effect of electricity pricing dominated by wind generation or by electricity demand is investigated, and the results are corroborated by

pricing dominated by wind generation or by electricity demand is investigated, and the results are corroborated by extensive sensitivity analysis. We use the district heating system of Aarhus, Denmark as a study case, providing the heat load and the validation scenario.

District energy systems are often planned and operated on a city level. Therefore, it makes sense to model the district heating production system coupled to a larger electricity system. Taking the city's point of view in the

modeling allows us to give recommendations for energy planners under different external conditions, such as the state of the regional or national electricity system.

In [3], Lund et al. compared two different approaches to energy system modeling: simulation and optimization. Simulation studies simulate and envisage the behavior of the system under a set of operating conditions defined by the user. Scenario based modeling, e.g. in EnergyPLAN, is an example of simulation studies. In optimization studies, the values of a number of decision variables are computed to minimize a certain objective function subject to constraints. A common example is allocation of production capacities in order to minimize system cost. Both modeling paradigms have their merits, and in this study we combine the two in orders to find cost-optimal system configurations in different scenarios. These scenarios include: allowing fossil fuels, excluding fossil fuels, historical electricity pricing, wind dominated electricity pricing and demand dominated electricity pricing. Combining the two approaches, we provide recommendations that are relevant to decision makers under different planning conditions. We indicate the robustness of the recommendations under changing cost assumptions by means of thorough sensitivity analysis.

Capacity optimization studies in district energy systems are plentiful in the literature. Our system optimization includes well-established technologies such as different boilers, CHP units, electric boilers, heat pumps and heat storages. Operations and capacities of CHP units have been optimized in [4, 5] using fossil fuels and in [6, 7] using biomass. The economic feasibility of large heat pumps for district heating systems have been investigated carefully in [8], taking day-to-day operational uncertainty into account through stochastic programming. The benefit of long-term heat storage in district heating systems has been studied in [9] and heat storage tanks have been compared to using the building mass for heat storage in [10].

Energy systems, in which it is important to model system nonlinearities, possibly making the objective function non-convex can be optimized using global optimization approaches such as genetic algorithms [7, 11, 12]. However, these approaches can be slow and run the risk of not finding the global minimum. In [9] the capacity and operation of CHP plants are optimized as mixed integer nonlinear programming (MINLP) problems, and the authors highlight some of the potential pitfalls of non-convex optimization. In cases where the energy system behavior can be reasonably linearized, the optimization speed can be decreased. Not surprisingly, mixed integer linear programming (MILP) [13, 14] and linear programming (LP) [15, 16] models are widespread in production capacity optimization and operational optimization. A thorough review of optimization studies in trigeneration systems (electricity, heating, cooling) can be found in [17].

In this study, we pose capacity and operational optimization as an LP problem and validate the resulting system operation against actual operational data for the city of Aarhus using a methodology similar to [18]. Even large LP problems with hundreds of thousands of variables and millions of constraints can be solved deterministically in relatively short time, assuming they are feasible and bounded. This property allows us to perform extensive sensitivity analysis of the cost assumptions of the model. In many optimization studies, model runs are very computationally expensive, which can severely limit the feasibility of large sensitivity analyses. In [16] the sensitivity analysis is limited to varying the fuel prices and CO₂ prices up and down by 50%. Most studies that do include sensitivity analysis of the model assumptions, only vary the input parameters one at the time [7, 11, 13]. One-at-atime sensitivity analysis has the disadvantage, that it only explores a very small part of the possible input space and fails to account for interactions between input parameters [19]. In this study, we perform an extensive multivariate sensitivity analysis including 200 points. These points are sampled using an experimental design called Latin hypercube sampling (LHS) [20] in order to better capture to full variability of the cost-parameters of the model and thoroughly test the robustness of the results with respect to changes in electricity prices, fuel cost and investment cost.

A number of studies explore the effects of changing electricity prices on the economy of CHP units [12] or entire district energy systems [8, 18]. As in [13], we model the district heating system as a price-taker, that does not affect the electricity prices. We employ a novel way of con-

structing electricity price scenarios based on historical dayahead prices, that preserves the distribution of the prices, but changes the autocorrelations. This methodology allows us to construct wind dominated electricity prices or demand dominated electricity prices, and facilitates fair comparison between these scenarios.

Some capacity optimization studies include local regulatory constraints [7, 21]. Regulations, tariffs and taxations are left out of our modeling, except for a possible ban on fossil fuels. In this way, our results represent taxation-neutral economically optimal energy systems, which can serve as a guiding point for energy planners and lawmakers.

Summing up, we demonstrate the robustness of economically optimal heat production systems under changing cost assumptions in the transition away from fossil fuels. In addition, the effects of changing influences in the electricity market are explored using a new methodology which allows for fair comparison between pricing scenarios, because it preserves the electricity price distribution.

The rest of the paper is structured as follows. In Section 2 the system model is described and validated, and the electricity pricing scenarios and sensitivity analysis are outlined. The results are presented in Section 3, and the paper is concluded in Section 4. Finally, in the Appendix the full mathematical formulation of the model can be found.

2. Methodology

This section describes how we have modeled the energy production system of a city with district heating coupled to a larger electricity transmission area. In Figure 1, the conceptual overview of the modeled energy system is sketched. The focus in this work is the optimal capacity configuration of a such a city, with regards to CHP production, heat only boilers, power-to-heat technologies and heat storages. The system operation and production capacity installation is co-optimized as described in Section 2.1. In Section 2.1.1 the optimization model is validated against the actual energy system operation of the city of Aarhus in 2015 and in Section 2.2 the various production and storage technologies in the capacity optimization are described. The implementation of the electricity market and three different electricity pricing schemes is covered in Section 2.3. Finally, Section 2.4 describes an extensive cost sensitivity analysis that qualifies the robustness of the final results.

2.1. Production system optimization

The modeling in this study is based on the city of Aarhus in Denmark. Aarhus is a city of about 340,000 people and almost all buildings in the city are heated through an extensive district heating system. The basis of this model is the hourly heat load of Aarhus from 2015.

The core of the work is a linear programming (LP) optimization problem, in which the heat and electricity

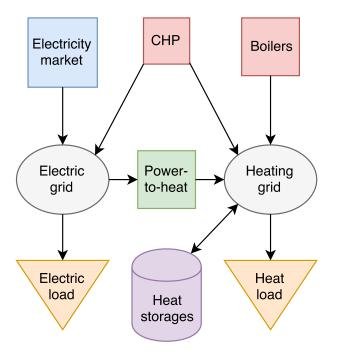


Figure 1: Conceptual overview of the energy system model. Arrows indicate directed energy flows.

production are co-optimized with heat storage operation and the installation of different types of heat and electricity production capacity. The total production system cost is minimized, including investment cost, operational and maintenance cost and fuel cost on all production units.

The full optimization problem, is formulated in the appendix, where the objective function (1) is minimized under the constraints (2-14). The system cost is minimized under a number of constraints. Energy balance constraints ensure that the total heat demand of the city is met in each hour and that the total electrical load is met as well. A number of capacity constraints ensure that all production units operate within their capacity. Finally, cogeneration production units are imposed with further constraints, depending on whether they are extraction-condensing plants or back-pressure plants with bypass.

The formulation of the capacity optimization as an LP problem means that well-established very fast techniques can be used to solve the problem in relatively short time. A scenario can be optimized in less than 10 minutes on a regular laptop as of 2018, which allows for extensive sensitivity analysis of the problem. The whole model has been implemented in Python for Power System Analysis (PyPSA) [22] and solved with the commercial Gurobi Optimizer [23].

We optimize the operation of the production and storage units on an hourly timescale throughout a full year. By using a full year, the system is operated through a representative range of the heat and electricity load. This is especially important for the heat load, as it varies by more than a factor of 8 over the course of a year [24].

2.1.1. Model validation

In order to validate the operational part of the optimization model, we reconstruct the operation of the Aarhus heat production system in 2015. In this operational optimization, we lock the capacities of each unit to the actual production capacity of the system. We cannot disclose the full technical specification of the Aarhus production plants, but we can summarize the most important aspects. In 2015, the base heat load was provided by 94.5 MW of waste incineration CHP, with the capability to boost the heat production to 112 MW by bypassing the turbines. A wood chips boiler of 24 MW supplemented the waste incineration as base load. A large coal CHP plant was in charge of maintaining the load balance in the system, and had a heat production capacity of 968 MW and an electrical production capacity of 707 MW. A number of peak-load oil boilers, with a total capacity of 435 MW were available in case of extremely cold weather or fallouts of other production units. Finally, a heat storage tank capable of storing 2,000 MWh was available.

When comparing the optimization results to the actual operation of the system, it is important to bear in mind that the optimization is based on the 2015 day-ahead electricity prices and operates with perfect foresight. This potentially makes the storage operation more optimal than what can be achieved by actual system operators.

On Figure 2, we see a comparison of the duration curves of the production and storage units in the Aarhus system of 2015. There is a good correspondence between the simulated and realized duration curves both in shape and magnitude. There are some smaller discrepancies, most notably in the operation of the oil boilers and the storage operation. The oil boilers are not used at all in the simulation, but in reality some oil was used. This is because the CHP plant fell out for a small period during 2015, and the excess load had to be covered with oil boilers. The difference in the shape of the storage operation, is due to tighter constraints on the storage heat uptake and dispatch in the simulation, compared to reality. It was necessary to use tighter constraints in the optimization to compensate for the perfect foresight.

A summary of the total annual heat output for each of the units can be found in Table 1. The waste incineration delivered 6% more heat in the simulation than in reality. The waste incineration is the cheapest unit and the simulation does not account for revision periods in which a unit is taken out for repairs and maintenance. This explains the excess production from waste in the simulation compared to reality. Likewise, the wood chips boiler also delivered more heat in the optimization compared to reality. This is because the wood chips boiler in reality was shut down during the summer in order to avoid competing with the waste incineration. The summed storage uptake and dispatch in the simulation are very similar to reality. The storage operation in reality was not cyclical, which explains the apparently positive net heat output from the

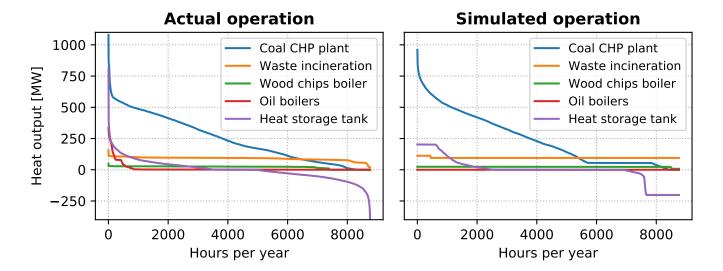


Figure 2: Duration curves for the heat output of the main production and storage units in the Aarhus heat production system of 2015. On the left, the actual operation of the units is shown; on the right are the results of the operational optimization.

storages.

Table 1: Comparison between the actual and simulated operation the Aarhus heat production system as of 2015. For each major production unit, the total annual heat production is shown. The heat storage dispatch is shown with a positive sign and storage uptake is shown with a negative sign.

	Total heat output in 2015		
	Actual [GWh]	Simulated [GWh]	
Coal CHP plant	2.11×10^{3}	2.12×10^{3}	
Waste incineration	785	836	
Wood chips boiler	183	206	
Oil boilers	72.5	0.00	
Heat storage dispatch	241	241	
Heat storage uptake	-240	-246	

We cannot disclose the total electricity production in Aarhus, because it would be easy to reconstruct which plants delivered how much electricity. But, we have made the comparison between the actual and simulated electricity production and there is a difference of less than 1% [25].

All in all, we cannot expect perfect correspondence between the actual operation and the optimized operation, since the actual operation is decided by production planners without perfect knowledge of the system, and because revision periods and accidental fallouts are not included in the simulation. However, the correspondence is good enough that the operation of production units and storages can be considered realistic, also when we move on to capacity optimizations.

2.2. Heat production and storage technologies

The technologies we have chosen to include in the capacity optimization are all well-established technologies, that have been implemented in district heating systems before. The production units can be divided into three types: Heat only boilers, CHP plants and power-to-heat technologies. Geothermal production technologies have not been included since their feasibility and cost are highly location dependent. Solar thermal technologies have not been included due to their high cost and negative synergies with waste incineration [26]. The financial and technical data about the heat production technologies included in the capacity optimization are summarized in Table 2.

Heat only boilers (Table 2a) are generally cheap and produce heat for the heating system by burning fuel. From an exergetic perspective, boilers are not ideal as they convert high exergy fuel into low exergy heat. We implement three common boiler types in the capacity optimization: Wood chips boilers, gas boilers and oil boilers. While wood chips boilers are preferable due to lower carbon emmisions, the investment cost is significantly higher compared to gas and oil boilers. We have omitted wood pellet and straw boilers, as they are generally not economically competitive on a large scale due to the higher fuel cost [26].

As heat production units, CHP plants (Table 2b) are much more expensive than boilers, but they have the advantage that they deliver both heating and electricity. This is beneficial from and exergy perspective. Even in a future with large amounts of cheap wind power, the electricity system is likely to need dispatchable backup power, e.g. from CHP plants [30]. Our capacity optimization implements six different CHP technologies. Coal and wood pellets plants are both extraction-condensing CHP plants fired by pulverized fuel. The modeling includes three different gas fired plants: gas engines, simple cycle turbines and combined cycle turbines. Finally, a straw fired backpressure CHP plant has been implemented, inspired by the newly opened (2017) straw fired plant in the Aarhus

Table 2: Financial and technical data for the energy production and storage technologies in the simulation based on [26, 27]. Fuel costs are sourced from [28] and missing parameters have been estimated based on the Aarhus heat production system. Efficiencies are given in terms of the lower calorific value of the fuel. All financial data for CHP technologies are in terms of electricity production and capacity. CapEx denotes the investment cost per unit capacity, OpEx denotes operation and maintenance cost and are split into a fixed annual part and a variable part depending on the operation. η^{boiler} is the efficiency of the boilers, and η^{el} is the electrical efficiency of the CHP plants. α denotes the power-to-heat ratio of CHP plants in back-pressure operation and ζ is the specific electrical power loss [29]. For power-to-heat technologies, η^{boiler} or COP is the ratio of produced heat to consumed electricity. For the heat storage units, η^{stand} is the fraction of the energy content that is lost through standing heat losses in each time step.

(a) Boiler technologies (fuel based).

Boiler type	Fuel cost	CapEx	$OpEx_{fixed}$	OpEx _{variable}	Lifetime	$\eta^{ m boiler}$
	$[\in/\mathrm{MWh_{fuel}}]$	$[\mathrm{M} \mathbf{\in} / \mathrm{MW}_{\mathrm{heat}}]$	$[k \in /MW_{heat}/yr]$	$[\in/\mathrm{MWh_{heat}}]$	[yr]	[-]
Wood chips	24	0.8	0	5.4	20	1.08
Gas	20	0.06	2	1.1	25	1.03
Oil	46	0.06	2	0.26	25	0.94

(b) CHP technologies.

CHP type	Fuel cost [€/MWh _{fuel}]	CapEx [M€/MW _{el}]	$\begin{array}{c} \mathrm{OpEx_{fixed}} \\ [\mathrm{k} \mathbf{\in} / \mathrm{MW_{el}/yr}] \end{array}$	$\begin{array}{c} \mathrm{OpEx_{variable}} \\ [\leqslant /\mathrm{MWh_{el}}] \end{array}$	Lifetime [yr]	$\eta^{ m el}$ [-]	ζ [-]	α [-]
Straw	21	4.0	40	6.4	25	0.29	0.15	0.48
Wood pellets	25	2.0	57	2.0	40	0.46	0.15	0.75
Gas (simple cycle)	19	0.60	20	4.5	25	0.39	0.15	0.95
Gas (combined cycle)	19	0.90	30	4.5	25	0.55	0.15	1.7
Gas engines	19	1.0	10	5.4	25	0.44	0.15	0.9
Coal	9.2	1.9	32	3.0	40	0.46	0.15	0.75

(c) Power-to-heat technologies.

Power-to-heat type	$\begin{array}{c} \operatorname{CapEx} \\ [\mathrm{M} \mathbf{\in} / \mathrm{MW}_{\mathrm{heat}}] \end{array}$	$\begin{array}{c} \mathrm{OpEx_{fixed}} \\ [\mathrm{k} \in /\mathrm{MW_{heat}/yr}] \end{array}$	$\begin{array}{c} \mathrm{OpEx_{variable}} \\ [\in /\mathrm{MWh_{heat}}] \end{array}$	Lifetime [yr]	$\eta^{ m boiler}/{ m COP}$ [-]
Electric boilers Compression heat pumps	$0.07 \\ 0.7$	1.1 2.0	$\begin{array}{c} 0.5 \\ 2 \end{array}$	20 25	0.98 3.5

(d) Heat storage technologies.

Heat storage type	CapEx	Storage capacity	Lifetime	$\eta^{ m stand}$
	[€/m³]	$[{ m MWh_{heat}/m^3}]$	[yr]	[-]
Storage tanks	210	0.07	20	1.4×10^{-3}
Storage pits	35	0.07	20	1.4×10^{-3}

district heating system.

Power-to-heat technologies (Table 2c) have increasing potential in district heating applications as electricity markets are periodically flooded with large amounts of cheap wind power [8]. The capacity optimization includes simple electric boilers and compression heat pumps. Large-scale heat pumps for district heating have already been implemented in district heating systems (e.g. in Stockholm) [31], and we assume a low-temperature heat source such as seawater and a conservative coefficient of performance (COP) of 3.5. Depending on the temperature of the heat source and the district heating supply temperature, the COP can be significantly higher [27].

Finally, two different heat storage technologies (Table 2d) have been implemented: heat storage tanks and seasonal pit storages. Heat storage tanks are already common in many district heating systems around the world, including the one in Aarhus. Pit storages are gaining ground and two examples of large heat storage pits are located in Marstal (75 \times 10³ m³) and Dronninglund (60 \times 10³ m³) [32] in Denmark, and they are significantly cheaper than storage tanks for large storage volumes.

Besides delivering heat for room heating and hot water consumptions, the district heating system of Aarhus and many other large district heating systems serve another crucial societal function. Municipal waste is incinerated and the excess heat is used for district heating and electricity generation. The waste incineration needs of a city like Aarhus are unlikely to change significantly in the coming years, so the actual 2015 waste incineration capacity was therefore included in all the simulations with fixed capacity and optimized operation.

2.3. Electricity pricing schemes

In the modeling, the West Danish electricity market (DK1) has been implemented with historical day-ahead prices for 2015. The market is implemented in the model as a simple generator with practically unlimited production capacity, capable of delivering electricity at the spot price in the relevant time step. Effectively, this lets local CHP units deliver electricity when their production price is below the spot price and it allows power-to-heat technologies to use electricity at market price. See Figure 1.

Besides the 2015 electricity pricing (Historical electricity pricing), we have constructed two artificial pricing scenarios. In a market with abundant amounts of electricity, the supply side will dominate. In the current and future North European energy system, the market will periodically be dominated by large amounts of wind power [33]. Prices will go down when wind power is abundant, and when the wind settles down, prices go up. We call this scenario the Wind dominated electricity pricing. In the other extreme, if the energy system is not dominated by variable renewable energy sources, and the electricity demand is primarily covered by dispatchable generation with a less volatile price, the electricity price will be dominated by the demand. In hours with high demand, prices go up

and vice versa. We call this scenario the *Demand domi*nated electricity pricing.

In the capacity optimization, we implement the wind and demand dominated pricing scenarios based on the historical 2015 electricity price, wind power production and electricity demand. All the data has been sourced from the local transmission system operator (TSO) Energinet [34]. We employ a methodology that preserves all moments of the distribution of the electricity price time series. In this way, there is the same mean, variance, skewness etc., but the autocorrelation is lost. A wind dominated price time series is obtained by sorting the original price such that the highest price is relocated to the hour with the lowest wind power production, the second highest price is relocated to the second lowest wind hour and so on. This process preserves the total value in the electricity market and facilitates fair comparison between the different pricing scenarios. In the historical pricing scenario, the Pearson correlation coefficient between the day-ahead electricity price and the wind power production was -0.40. In the wind dominated scenario it is -0.91.

The same methodology is used to create a demand dominated pricing scheme. This time, the electricity prices are relocated such that the highest price falls in the hour with highest demand. The correlation between demand and price goes from 0.57 in the historical scenario to 0.95 in the demand dominated scenario.

2.4. Sensitivity analysis

Large scale modeling studies are haunted by the fact that they require many different input parameters to define the model. These parametes may be difficult to accurately estimate or may be subject to change. It is therefore crucial to perform sensitivity analysis to investigate how robust the final results are to changes in input parameters. It is a well known problem in numerical modeling that hypervolumes grow exponentially with the dimensionality of input spaces. This is known as the curse of dimensionality, and it means that exhaustive searches through input spaces very quickly become infeasible as the number of input parameters grow, especially if model evaluations are time-costly. One technique to deal with this problem is Latin hypercube sampling (LHS), which is a random multivariate sampling method that ensures that the samples are representative of the real variability of the variables [20].

In this study, the sensitivity analysis is focused on the cost assumptions. We have run the system capacity optimization with 200 different perturbations of the CapEx and fuel cost assumptions shown in Table 2 as well as the mean electricity price¹. The 200 points were generated using Latin hyper cube sampling to ensure a representative

¹In the sensitivity analysis, the entire electricity price time series was scaled up or down with the same factor, drawn from the Latin hypercube sample.

sample of the input space. The LHS points were transformed via the inverse cumulative distribution to be normally distributed around the initial value (Table 2), with a standard deviation of 10 % of the initial value. This leaves about 5 % chance of the value being perturbed by more than 20 %.

This methodology ensures that we investigate a representative sample of the many combinations of changes in cost assumptions. It is very important to be thorough in this kind of analysis as a rise in coal prices combined with a drop in electricity prices may yield very different results from a rise in both or from a drop in the cost of e.g. biomass.

We do not perform sensitivity analysis on the technical parameters, as most technical changes can be reduced to equivalent changes in cost assumptions.

3. Results

In this section we present the cost-optimal heat production capacities for the case of Aarhus embedded in the West Danish electricity market DK1. In the base scenario, all the production and storage technologies from Table 2 have been included. This case is compared to a fossil free scenario, in which all fossil fuel technologies are excluded from the capacity optimization.

Figure 3a shows optimal heat production and storage capacities for the base scenario, and the fossil free scenario is shown below in Figure 3b. The orange bars depict the optimal capacities obtained using the historical dayahead electricity prices from 2015. This is the historical electricity pricing scheme. A first look at Figure 3 reveals that only a few technologies are assigned nonzero capacities in the cost optimization. The waste incineration is not a part of the capacity optimization, but its operation is optimized. Waste incineration aside, the heat demand is covered by a combination of coal fired CHP and compression heat pumps in the fossil fuel scenario. In the fossil free scenario, the entire heat demand is covered by heat pumps supplemented by waste incineration. Pit heat storage is the only storage technology that is utilized, which is not surprising given its low costs. Heat storage tanks may still have a place in district heating production systems, especially in places where pit storages are infeasible due to space, temperature or pumping requirements. There are two main differences between the production system configuration in the fossil fuel scenario and the fossil free scenario. The first is that the coal CHP capacity is replaced, almost one to one with heat production capacity from heat pumps. The second is that the optimal amount of heat storage doubles.

The total annual cost of the production system of the city includes investment cost, operation and maintenance cost, fuel cost and the cost of electricity for heat pumps, minus the value of generated electricity. We compare the total annual system cost to a reference system, consisting of the actual installed production capacities in Aarhus in

2015 (see Section 2.1.1), using optimized operation, the historical electricity pricing and the financial and technical data from Table 2. The difference in annual system cost between the reference and the capacity optimized system is shown in Table 3. Negative values indicate that the capacity optimized system is cheaper.

In the first row of Table 3 we see that the capacity optimized fossil fuel system reduces the cost of the production system by 8.4 million \in every year, a cost reduction of about 12 %. It is possible to construct a fossil free production system that is cheaper than the reference, in this case only 5.3 million \in per year cheaper. The cost difference of about 3 million \in between the fossil fuel and fossil free scenario can be attributed to the very low fuel price of coal

It is important to note that the capacity optimized scenarios do not include redundancy or extra capacity for exceptionally cold years. The cost comparison in Table 3 should therefore not be interpreted a *savings potential* by transforming the energy system, but rather serve as a consistent cost comparison between the capacity optimized scenarios.


Table 3: Difference in the total annual Aarhus production system cost compared to the 2015 reference scenario. The cost differences are shown plus-minus an error of 1σ . Negative values indicate lower than reference system cost.

Electricity pricing scheme	System cost difference Fossil fuels includes	
Historical Wind dominated	-8.4 ± 3.8 -11.1 ± 3.1	-5.3 ± 5.1 -9.7 ± 4.6
Demand dominated	-6.7 ± 3.9	-5.0 ± 5.0


3.1. The effect of the electricity pricing

As the wind power generation capacity in Northern Europe is expanding, it is likely that electricity prices in the future will become more strongly anticorrelated with the wind power production. In this study, we analyze how the heat production system is affected by a wind dominated electricity pricing scheme. An alternative scenario is also explored in which the electricity prices are dominated by the electricity demand instead of the wind power generation. The optimal heat production and storage capacities for these two electricity pricing schemes are shown as green and blue bars in Figure 3.

Wind power generation in Northern Europe has a positive seasonal correlation with the heat demand in district heating systems, because average winds tend to be higher in winter when it is also cold. This effect shifts the optimal heat production capacities toward larger shares of power-to-heat technologies and lower shares of CHP. Electricity becoming cheaper in the winter when the heat demand is high negatively impacts the economy of CHP units, while it benefits power-to-heat technologies. In the fossil fuel scenario, the optimal coal CHP capacity is almost halved

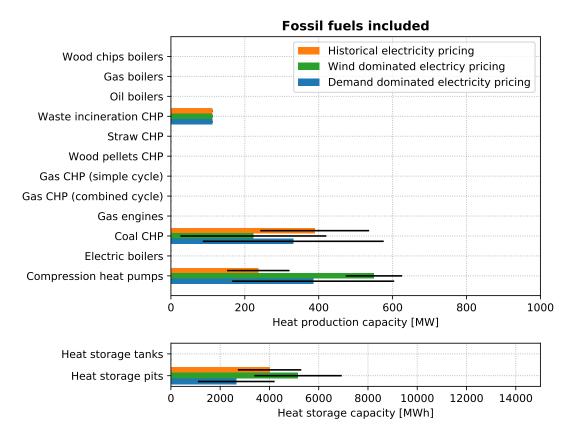

(a) Fossil fuels scenario.

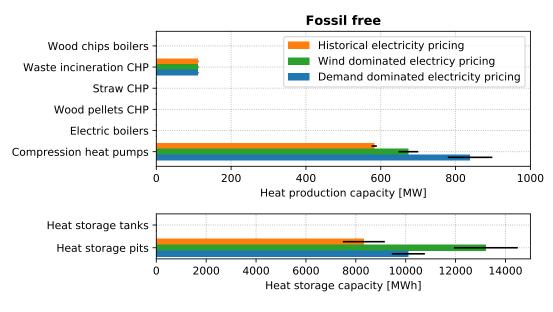

(b) Fossil free scenario.

Figure 3: Optimal heat production capacity under three different electricity pricing schemes: Historical, wind dominated and demand dominated. In the top figure, all technologies are allowed in the optimization. In the bottom figure, only fossil free technologies are included. Error bars based on the sensitivity analysis are shown in black. The waste incineration capacity was fixed in the optimization.

while the heat pump capacity is more than doubled. In the fossil free scenario, the optimal heat pump capacity is also increased, but not as dramatically. The optimal heat storage capacity is increased regardless of whether or not fossil fuels are included.

The effect of implementing a demand dominated electricity pricing scheme depends on whether or not fossil fuels are allowed. If fossil fuel technologies are included, the demand dominated electricity price reduces the optimal coal CHP capacity and increases the heat pump capacity. The effect is similar to the effect of a wind dominated pricing scheme, although not as strong. The main difference is that in the demand dominated pricing scheme the storage need falls significantly instead of rising. In the fossil free scenario, the picture is different. The need for heat pumps increases significantly and so does the need for heat storage, although not as much as in the wind dominated scheme.

All in all, a future in which electricity prices are dominated by wind power production or by electricity demand is likely to increase value of heat pumps in the energy system at the expense of CHP units. Wind dominated electricity prices are also likely to increase the benefit of heat storages.

3.2. Cost sensitivity analysis

In order to assess the robustness of the optimal capacity configurations and system cost, a thorough sensitivity analysis has been performed. Using Latin hypercube sampling, we have run the system optimization in 200 perturbations of the initial values of fuel cost, investment cost and electricity price. The optimal capacities resulting from these cost-perturbed scenarios, can be seen on the radar charts in Figure 4. All CHP and boiler technologies have been aggregated to Fuel based production capacity and shown on the top axis. Each cost-perturbed scenario is shown as a triangle, plotted with an alpha transparency value, so 10 lines on top of each other appear as the full color. The initial unperturbed scenario is plotted as a red triangle corresponding to the orange bars in Figure 3. Notice that the scale is logarithmic and that production capacity is shown in units of MW, whereas storage capacity is shown in units of MWh.

The spread of the 200 triangles is an indication of the cost-based uncertainty in the optimal production and storage capacities. The wider the spread is, the larger the uncertainty is. Conversely, smaller spread indicates that the optimal configuration is robust to changes in investment, fuel and electricity costs. It is clear that the capacities in the fossil free scenario on the bottom are significantly more robust to changing costs than the fossil fuel scenario on the top.

It should be noted that 200 cost-perturbed scenarios have been solved for each of the other electricity pricing schemes, yielding very similar results. None of the costperturbations found it feasible to install capacities of different technologies than the ones that were assigned in Figure 3.

3.2.1. Clustering in the optimal production system

Focusing on the top part of Figure 4, it appears that the capacities resulting from the different cost perturbations fall in different categories. Three clusters have been identified, when inspecting the data. Using the k-means clustering algorithm [35], we have assigned each resulting capacity configuration to one of the three clusters and colored them accordingly: green, blue and orange. An implementation of the algorithm from the Python framework scikit-learn (version 0.19.0) [36] was used.

Most of the perturbed cost-scenarios fall into the green cluster like the unperturbed scenario. The green main cluster consists of scenarios in which both heat pumps and coal CHP are installed in the production system in some mix. There is quite a bit of spread in this cluster and the heat pumps are installed with between 91 MW and 400 MW capacity, whereas the coal CHP is installed with between 345 MW and 1,080 MW. The anticorrelation between the power-to-heat capacity and the fuel based capacity can be observed from the crossover of the lines between the two vertices. The error bars assigned to the capacities in Figure 3a represent $\pm 1\sigma$ where σ is the standard deviation of the capacity within the green main cluster.

The blue and the orange clusters in the top of Figure 4 represent two opposite outcomes. The orange cluster contains all the scenarios in which the entire heat supply is covered by fuel based production: coal CHP and a little waste incineration. This group of scenarios is characterized by higher storage requirements and is mostly a result of the cost perturbations with significantly rising electricity prices.

The blue cluster is the opposite situation. In this group of cost scenarios, the city's heat demand is fully covered by power-to-heat technologies supplemented by a small base load of waste incineration. The storage needs in this cluster correspond to the high end of the storage capacity in the main green cluster.

Moving to the fossil free scenario on the bottom of Figure 4, all the cost perturbations fall into the same cluster: the blue cluster where power-to-heat technologies dominate the picture. The spread of the capacities in this cluster is quite narrow, as is also reflected by the error bars in Figure 3b.

Table 3 shows the reduction in system cost compared to the 2015 reference system. The cost are shown with an uncertainty of $\pm 1\sigma$, estimated within the main cluster. It is clear that going fossil free, the cost reductions are generally smaller and slightly more uncertain. The magnitude of the uncertainty makes it possible, that there may not be a cost reduction compared to the reference, especially in the demand dominated and in the historical electricity pricing scheme. The largest and most certain cost reduction would appear in the wind dominated electricity pricing scenario with fossil fuels allowed. The wider

Fossil fuels included Fuel based production capacity [MW] Unperturbed scenario 100 Power-to-heat 500 Heat storage production capacity 1000 capacity [MWh] [MW] 10000 20000 **Fossil free** Fuel based production capacity [MW] Unperturbed scenario 100 Power-to-heat 500 Heat storage production capacity 1000 capacity [MWh] [MW] 10000 20000

Figure 4: Radar charts of the optimal heat production capacities in 200 cost-perturbed sensitivity scenarios using the historical electricity pricing scheme. Fuel based capacity includes all boiler and CHP technologies, also waste incineration, which is not subject to the capacity optimization. In the top figure, all technologies are allowed; in the bottom figure, fossil fuel technologies, i.e. coal, oil and gas, are excluded. The unperturbed scenarios from Figure 3 (orange bars) are shown in red. The green, blue and orange triangles represent different clusters of the sensitivity scenarios. The scale is logarithmic, except the center, which represents 0. Production capacities are shown in units of MWh.

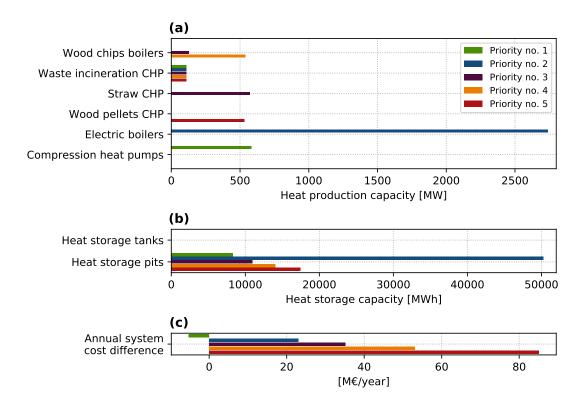


Figure 5: Ranking of fossil free production system alternatives, in case the first priority becomes infeasible. Each consecutive priority scenario is constructed by excluding the preferred production technology from the previous priority scenario. (a) shows the optimal heat production capacities and (b) shows the heat storage capacities. In (c) we display the additional annual system cost compared to the reference production system of 2015.

spread in the system cost in the fossil free scenarios, may be due to these scenarios being more vulnerable to rising electricity prices.

Summing up, when moving from away from fossil fuels, three different possible capacity configurations reduce to one and the spread of the optimal capacities narrows significantly. Heat pumps combined with storage and waste incineration remain as a highly robust choice for the future heat supply of the city.

3.3. Alternative paths to fossil free production

Since only very few technologies were installed in the optimal heat production systems, even under significant perturbations to the cost assumptions, we were interested in delving into different alternatives, in case the first choice of compression heat pumps became infeasible. There may be political roadblocks such as taxation of heat pumps or technical obstacles such as limited heat sources or weak electric grids, that make it infeasible to supply a whole city with heat from heat pumps. In order to find the second priority, in case heat pumps become infeasible we have optimized the production capacities and operation of a fossil free system excluding the heat pumps. Figure 5 shows the result of this analysis. The green bars show priority no. 1 and correspond to the orange bars in Figure 3b. This is the preferred fossil free scenarios, dominated by

compression heat pumps and with 8,322 MWh storage capacity. Excluding heat pumps from this scenario, brings us to priority no. 2.

In the second priority fossil free scenario, the heat pumps are replaced by a very large amount of electric boilers, and a very large amount of heat storage. The production system cost jumps significantly to be more than 20 million \in more expensive per year compared to the reference system cost. This power-to-heat scenario, may be infeasible, due the large areas needed for heat storage and the extreme number of electric boilers, putting a very high load on the local electric grid.

Excluding all power-to-heat technologies from the production capacity optimization brings us to priority no. 3. This is the first time we see biomass technologies enter the picture. In the third priority scenario, the heat for the city is provided primarily from straw CHP plants supplemented by a small amount of wood chips boilers and the waste incineration base load. This is a fossil free scenario that does not put a large strain on the electric grid and includes some dispatchable electricity generation. The necessary heat storage in this scenario drops to a more reasonable level, although still higher than in the first priority scenario. However, the cost of this system is even higher and about 150 % of the cost of the reference system.

If straw CHP is not feasible on the scale needed for

priority no. 3, wood chips boilers completely take over the heat supply. In the fourth priority scenario, the heat is generated mostly from heat only technologies and the heat storage needs are higher than in the third priority. The total system cost in this case is more than 50 million \in higher each year compared to the reference system.

Finally, if wood chips boilers are excluded from the optimization, the entire heat demand can be covered by wood pellets CHP plants in priority no. 5. While being able to serve as dispatchable backup for the electricity system, this would be an extremely expensive district heating production system. The system cost in this final scenario is now more than double the cost of the reference system. Note again that the system cost discussed here is not directly comparable to the cost of the present day Aarhus district heating system; rather, it is the cost of building a new system from scratch and operating it. The current system was built over many years, and transforming existing coal CHP plants into biomass CHP plants is cheaper than building entirely new plants.

It is clear that there are other ways to construct a fossil free district heating production system than by installing very large heat pumps and energy storage. However, all of these pathways require larger amounts of heat storage and increase the production system cost significantly.

4. Conclusion and outlook

In this work, we have studied the cost-optimal production capacities in a city wide district heating system coupled to a larger electricity system. Using well-established technologies, i.e. heat only boilers, CHP units, power-to-heat technologies and heat storages, the optimal heat production has been characterized in a transition away from fossil fuels. The effects of electricity prices dominated by wind power production or by electricity demand have been investigated, and the uncertainty of the results have been estimated through extensive sensitivity analyses.

If we allow fossil fuels, the cost-optimal system will consist of a combination of coal CHP, heat pumps and heat storages. Going fossil free, heat pumps take over the heat supply, and the necessary storage capacity more than doubles, while the total system cost only increases slightly.

The optimal *choice* of technologies is highly stable under changing cost assumptions. But if fossil fuels are allowed, the optimal *capacities* of coal CHP and heat pumps are very uncertain. The need for heat pumps becomes significantly more certain if fossil fuels are banned. The total system cost, however, becomes more uncertain in the fossil free scenario, as it is more sensitive to changing electricity prices. A cost-optimal fossil free district heating system is thus more robust in its capacity allocation, but less robust in its cost.

There are other paths to fossil free district heating production, i.e. electric boilers or biomass, but these solutions all require larger heat storages and are significantly more costly.

Our study case, the Aarhus district heating system is going to change over the next 15 years, because key plants in the production system are at the end of their lifetime. This is an opportunity to rethink the production system, and our analysis indicates that regardless of a ban on fossil fuels, investing in large-scale heat pumps and heat storages is desirable, if taxes and regulations allow it.

Finally, the choice of technologies in this study was somewhat conservative, and only well-established dispatchable technologies were included. Future studies should include solar heating technologies, which may alter the system dynamics due to the seasonal and weather-dependent production patterns. New types of combined heat and electricity storages, e.g. the rock cavern storage described in [37], are emerging. Including combined heat and electricity storage technologies in the future may enhance the synergies between the electricity and heating sector in the transition away from fossil fuels.

Acknowledgements

This study is part of the READY project (Resource Efficient cities implementing ADvanced smart CitY solutions) which is partly financed by the EU's Research and Innovation funding program FP7 (https://ec.europa.eu/research/fp7/index_en.cfm). We would like to thank AffaldVarme Aarhus for providing data about the heat load and production system in Aarhus. We also thank Energinet for providing data about electricity prices, consumption and power generation.

Appendix

The optimal operation and production capacities are found by solving a joint optimization problem. We pose the problem as a linear programming problem (LP) and minimize the total annual investment and operational cost. The objective function of the optimization problem reads:

The objective function of the optimization problem reads:
$$\frac{\min\limits_{\substack{\bar{P}_{u}^{\text{el}},\bar{P}_{u}^{\text{heat}},\\ P_{u}^{\text{el}},P_{u}^{\text{heat}},\\ P_{u,t}^{\text{el}},P_{u,t}^{\text{heat}},}}{\sum_{u\in\text{prod. units}}c_{u}^{\text{el}}\bar{P}_{u}^{\text{el}}+c_{u}^{\text{heat}}\bar{P}_{u}^{\text{heat}}} \\ +\sum_{s\in\text{storages}}c_{s}^{\text{stor}}\bar{H}_{s} \\ +\sum_{t=1}^{N}\Delta t\left[\sum_{u\in\text{prod. units}}o_{u,t}^{\text{el}}P_{u,t}^{\text{el}}+o_{u,t}^{\text{heat}}P_{u,t}^{\text{heat}} \\ +\sum_{s\in\text{storages}}o_{s,t}^{\text{disp}}h_{s,t}+o_{s,t}^{\text{upt}}f_{s,t}\right]\right).$$

Here c denote annualized² capital cost per MW production capacity \bar{P} or per MWh heat storage capacity \bar{H} . The

 $^{^2{\}rm The}$ capital cost was annualized using a discount rate of $4\,\%$ and the lifetime listed in Table 2.

capital cost includes the nominal investment (CapEx) and fixed operation and maintenance cost (OpEx_{fixed}). $o_{u,t}^{\text{el}}$ and $o_{u,t}^{\text{heat}}$ denote the marginal cost of electricity and heat production from unit u in hour t. The marginal cost includes fuel cost and variable operation and maintenance cost (OpEx_{variable}). The optimization runs over an entire year, so the total number of time steps N is 8760 and the length of the time step Δt is 1 h. The rate of production of heat and electricity from unit u in hour t are denoted $P_{u,t}^{\text{heat}}$ and $P_{u,t}^{\text{el}}$, and the rate of dispatch and uptake of heat from heat storage s we denote $h_{s,t}$ and $f_{s,t}$, respectively. Finally, $o_{s,t}^{\mathrm{disp}}$ and $o_{s,t}^{\mathrm{upt}}$ are the marginal costs of dispatching from and storing heat in storage s.

Constraints

The cost-optimization is imposed with a number of constraint, so the correct physical behavior of the system is captured.

Energy balance. The total electricity and heat load of the system must be met in all time steps t:

$$\sum_{u \in \text{prod}, \text{ units}} P_{u,t}^{\text{el}} = P_{\text{tot},t}^{\text{el}} , \qquad (2)$$

$$\sum_{u \in \text{prod. units}} P_{u,t}^{\text{el}} = P_{\text{tot},t}^{\text{el}} , \qquad (2)$$

$$\sum_{u \in \text{prod. units}} P_{u,t}^{\text{heat}} = P_{\text{tot},t}^{\text{heat}} . \qquad (3)$$

 $P_{\text{tot},t}^{\text{el}}$ includes the total consumption in the local electricity market and any electricity consumed by power-toheat technologies (see Figure 1). $P_{\text{tot},t}^{\text{heat}}$ includes the total heat consumption in the city, as well as losses in heat storages and in the distribution system.

Production capacity constraints. Heat and electricity production are constrained by the production capacity for all units u:

$$0 < P_{u,t}^{\text{el}} < \bar{P}_{u}^{\text{el}} , \qquad (4)$$

$$0 \le P_{u,t}^{\text{el}} \le \bar{P}_u^{\text{el}} , \qquad (4)$$

$$0 \le P_{u,t}^{\text{heat}} \le \bar{P}_u^{\text{heat}} . \qquad (5)$$

Storage constraints. The energy content in the storage $H_{s,t}$ is limited by the storage capacity:

$$0 \le H_{s,t} \le \bar{H}_s. \tag{6}$$

In any time step t the storage level $H_{s,t}$ is governed by the dispatch and uptake of heat as well as the standing loss in the storage:

$$H_{s,t} = \eta_s^{\text{stand}} H_{s,t-1} + (f_{s,t} - h_{s,t}) \Delta t$$
 (7)

 η_s^{stand} is the standing heat loss factor. We also require cyclical storage operation, in order to avoid just depleting the storage in the end of the optimization period:

$$H_{s,t=1} = H_{s,t=N}$$
 (8)

We assume uptake and dispatch cost for the storages $o_{s,t}^{\text{disp}}$ and $o_{s,t}^{\text{upt}}$ to be 0.77 \in /MWh, in order to counter excessive use of storages due to perfect foresight in the model. Except for the reproduction of the 2015 heat production, we have left the storage uptake and dispatch $f_{s,t}$ and $h_{s,t}$ unconstrained, as it depends on the installed pumping capacities. We have afterwards checked that the storage operation was sensible.

Cogeneration constraints. Our modeling includes two different types of CHP plants: An extraction-condensing plant (Type I) and a back-pressure plant with bypass (Type II). We adopt the notation from [29] and denote the power-toheat ratio in back-pressure operation by α_u . The specific electrical power loss, denoted by ζ_u , is the extra heat that can be produced by reducing the electricity production by 1 unit while injecting the same amount of fuel [29].

Type I. For extraction-condensing plants, the electricity and heat production capacity are constrained by:

$$\bar{P}_u^{\text{heat}} = \frac{1}{\alpha_u + \zeta_u} \bar{P}_u^{\text{el}} \,. \tag{9}$$

Extraction-condensing plants are capable of running in condensing mode, where only electricity is produced. In a power versus heat diagram, the feasible operational area is below the top iso-fuel line

$$P_{u,t}^{\text{el}} \le -\zeta_u P_{u,t}^{\text{heat}} + \bar{P}_u^{\text{el}} \,, \tag{10}$$

and above the back-pressure line

$$P_{u,t}^{\text{el}} \ge \alpha_u P_{u,t}^{\text{heat}} \ . \tag{11}$$

This is illustrated in Figure 6.

Type II. The other CHP type in the model is a backpressure plant with bypass. This type of plant can bypass the steam turbine and boost the heat production by reducing the electricity production. It is assumed that 1 extra unit of heat can be produced for each unit of electricity not produced in bypass operation [27]. The total heat and electricity production capacities are thus constrained by:

$$\bar{P}_u^{\text{heat}} = \left(1 + \frac{1}{\alpha_u}\right) \bar{P}_u^{\text{el}} .$$
 (12)

The feasible operational area for back-pressure plants with bypass in the power versus heat diagram is below the backpressure line:

$$P_{u,t}^{\text{el}} \le \alpha_u P_{u,t}^{\text{heat}} , \qquad (13)$$

and below the bypass line

$$P_{u,t}^{\text{el}} \le \bar{P}_u^{\text{heat}} - P_{u,t}^{\text{heat}} . \tag{14}$$

In this work we have modeled coal, wood pellets, gas engines and combined cycle gas CHPs as extraction-condensing Type I plants. Simple cycle gas, straw and waste incineration CHPs have been modeled as back-pressure Type II plants.

Fuel consumption


The fuel consumption of boilers and CHP plants is governed by the efficiencies. For boilers, the fuel consumption for heat production is

$$P_{u,t}^{\text{fuel}} = \frac{1}{\eta_u^{\text{boiler}}} P_{u,t}^{\text{heat}} . \tag{15}$$

For CHP plants, the total fuel consumption for both heat and electricity consumption is

$$P_{u,t}^{\text{fuel}} = \frac{1}{\eta_u^{\text{el}}} \left(P_{u,t}^{\text{el}} + \zeta_u P_{u,t}^{\text{heat}} \right) , \qquad (16)$$

where η_u^{el} is the electrical efficiency of the plant.

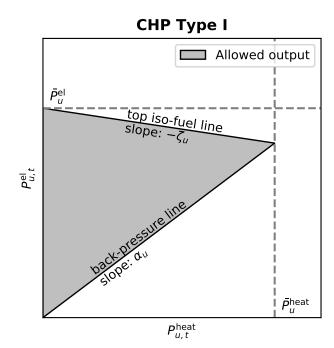

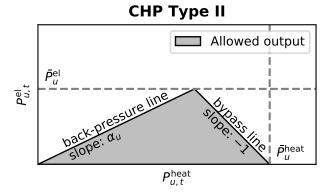


Figure 6: Feasible output of heat and electricity for the two CHP types included in the optimization. Type I is an extraction-condensing plant. Type II is a back-pressure plant with bypass.

Nomenclature

 Δt length of time steps in the optimization [h]

 σ standard deviation

s index for storage units

t index for hourly time steps

u index for production units

 c_u^{el} annualized capital cost per MW electricity production capacity $[\in/\mathrm{MW}]$

 c_u^{heat} annualized capital cost per MW heat production capacity $[\in/\mathrm{MW}]$

 c_s^{stor} annualized capital cost per MWh heat storage capacity $[\in/\mathrm{MWh}]$

 $o_{s,t}^{\text{disp}} \quad \text{marginal cost of dispatching heat from storage } s \text{ in hour } t \ [\in /\text{MWh}]$

 $\begin{array}{ll} o_{u,t}^{\mathrm{el}} & \text{marginal cost of electricity from unit } u \text{ in hour } t \\ [\mathbf{\in}/\mathrm{MWh}] \end{array}$

 $o_{u,t}^{\text{heat}} \quad \text{marginal cost of heat from unit } u \text{ in hour } t \ [\in /\text{MWh}]$

 $\begin{array}{ll} o_{s,t}^{\text{upt}} & \text{marginal cost of storing heat in storage } s \text{ in hour} \\ & t \ | \in /\text{MWh} | \end{array}$

 $P_{u,t}^{\text{el}}$ electricity production rate from unit u in hour t [MW]

 $P_{u,t}^{\text{heat}}$ heat production rate from unit u in hour t [MW]

 $h_{s,t}$ heat dispatch rate from storage s in hour t [MW]

 $f_{s,t}$ heat uptake rate in storage s in hour t [MW]

 \bar{P}_{u}^{el} electricity production capacity of unit u [MW]

 \bar{P}_u^{heat} heat production capacity of unit u [MW]

 \bar{H}_s heat storage capacity of unit s [MWh]

 $P_{u,t}^{\text{fuel}}$ fuel consumption rate of unit u in hour t [MW]

 $P_{\text{tot},t}^{\text{el}}$ total electricity load on the system in hour t [MW]

 $P_{\mathrm{tot},t}^{\mathrm{heat}}$ total heat load on the system in hour t [MW]

 $H_{s,t}$ heat content in storage s in hour t [MWh]

 α_u power-to-heat ratio of CHP unit u in back-pressure

operation

 ζ_u specific electrical power loss for CHP unit u

 η_u^{boiler} efficiency of boiler unit u

 $\eta_u^{\rm el}$ electrical efficiency of CHP unit u

 $\eta_s^{\rm stand}$ standing heat loss factor for storage s

References

- D. Jones, A. Sakhel, M. Buck, P. Graichen, The European Power Sector in 2017. State of Affairs and Review of Current Developments, Tech. rep., Agora Energiewende and Sandbag (2018).
- [2] C.-K. Woo, I. Horowitz, J. Moore, A. Pacheco, The impact of wind generation on the electricity spot-market price level and variance: The Texas experience, Energy Policy 39 (7) (2011) 3939-3944. doi:10.1016/j.enpol.2011.03.084.

- [3] H. Lund, F. Arler, P. A. Østergaard, F. Hvelplund, D. Connolly, B. V. Mathiesen, P. Karnøe, Simulation versus optimisation: Theoretical positions in energy system modelling, Energies 10 (7) (2017) 840. doi:10.3390/en10070840.
- [4] Z. Beihong, L. Weiding, An optimal sizing method for cogeneration plants, Energy and Buildings 38 (3) (2006) 189–195. doi:10.1016/j.enbuild.2005.05.009.
- [5] S. Gamou, R. Yokoyama, K. Ito, Optimal unit sizing of cogeneration systems in consideration of uncertain energy demands as continuous random variables, Energy Conversion and Management 43 (9) (2002) 1349–1361.
- [6] K. Sartor, S. Quoilin, P. Dewallef, Simulation and optimization of a CHP biomass plant and district heating network, Applied Energy 130 (2014) 474-483. doi:10.1016/j.apenergy.2014. 01.097.
- [7] A. Rentizelas, I. Tatsiopoulos, A. Tolis, An optimization model for multi-biomass tri-generation energy supply, Biomass and bioenergy 33 (2) (2009) 223–233. doi:10.1016/j.biombioe. 2008.05.008.
- [8] M. G. Nielsen, J. M. Morales, M. Zugno, T. E. Pedersen, H. Madsen, Economic valuation of heat pumps and electric boilers in the Danish energy system, Applied Energy 167 (2016) 189–200. doi:10.1016/j.apenergy.2015.08.115.
- [9] T.-M. Tveit, T. Savola, A. Gebremedhin, C.-J. Fogelholm, Multi-period MINLP model for optimising operation and structural changes to CHP plants in district heating networks with long-term thermal storage, Energy Conversion and Management 50 (3) (2009) 639-647. doi:10.1016/j.enconman.2008.10.010.
- [10] D. Romanchenko, J. Kensby, M. Odenberger, F. Johnsson, Thermal energy storage in district heating: Centralised storage vs. storage in thermal inertia of buildings, Energy Conversion and Management 162 (2018) 26-38. doi:10.1016/j.enconman. 2018.01.068.
- [11] J.-J. Wang, Y.-Y. Jing, C.-F. Zhang, Optimization of capacity and operation for CCHP system by genetic algorithm, Applied Energy 87 (4) (2010) 1325–1335.
- [12] M. Burer, K. Tanaka, D. Favrat, K. Yamada, Multi-criteria optimization of a district cogeneration plant integrating a solid oxide fuel cell-gas turbine combined cycle, heat pumps and chillers, Energy 28 (6) (2003) 497-518. doi:10.1016/ s0360-5442(02)00161-5.
- [13] D. Buoro, P. Pinamonti, M. Reini, Optimization of a distributed cogeneration system with solar district heating, Applied Energy 124 (2014) 298-308. doi:10.1016/j.apenergy.2014.02.062.
- [14] D. Steen, M. Stadler, G. Cardoso, M. Groissböck, N. DeForest, C. Marnay, Modeling of thermal storage systems in MILP distributed energy resource models, Applied Energy 137 (2015) 782-792. doi:10.1016/j.apenergy.2014.07.036.
- [15] M. Åberg, D. Henning, Optimisation of a Swedish district heating system with reduced heat demand due to energy efficiency measures in residential buildings, Energy Policy 39 (12) (2011) 7839–7852. doi:10.1016/j.enpol.2011.09.031.
- [16] M. Münster, P. E. Morthorst, H. V. Larsen, L. Bregnbæk, J. Werling, H. H. Lindboe, H. Ravn, The role of district heating in the future Danish energy system, Energy 48 (1) (2012) 47–55. doi:10.1016/j.energy.2012.06.011.
- [17] A. N. Ünal, S. Ercan, G. Kayakutlu, Optimisation studies on trigeneration: a review, International Journal of Energy Research 39 (10) (2015) 1311–1334. doi:10.1002/er.3342.
- [18] M. Åberg, J. Widén, D. Henning, Sensitivity of district heating system operation to heat demand reductions and electricity price variations: A Swedish example, Energy 41 (1) (2012) 525– 540. doi:10.1016/j.energy.2012.02.034.
- [19] V. Czitrom, One-factor-at-a-time versus designed experiments, The American Statistician 53 (2) (1999) 126–131. doi:10.2307/ 2685731.
- [20] M. D. McKay, R. J. Beckman, W. J. Conover, Comparison of three methods for selecting values of input variables in the analysis of output from a computer code, Technometrics 21 (2) (1979) 239–245. doi:10.2307/1271432.
- [21] M. A. Lozano, J. C. Ramos, L. M. Serra, Cost optimization of

- the design of CHCP (combined heat, cooling and power) systems under legal constraints, Energy 35 (2) (2010) 794-805. doi:10.1016/j.energy.2009.08.022.
- [22] T. Brown, J. Hörsch, D. Schlachtberger, PyPSA: Python for power system analysis, Journal of Open Research Software 6 (1). doi:10.5334/jors.188.
- [23] I. Gurobi Optimization, Gurobi optimizer reference manual (2016).
 - URL http://www.gurobi.com
- [24] M. Dahl, A. Brun, G. B. Andresen, Decision rules for economic summer-shutdown of production units in large district heating systems, Applied Energy 208C (2017) 1128–1138. doi:10.1016/ j.apenergy.2017.09.040.
- [25] Energiproducenttællingen for 2014-2016, Tech. rep., Danish Energy Agency (2017).
- [26] Technology data for energy plants: Generation of electricity and district heating, energy storage and energy carrier generation and conversion (May 2012), Tech. rep., Danish Energy Agency (2017).
 - URL https://ens.dk/sites/ens.dk/files/Analyser/
 technologydata_for_energy_plants_-_may_2012._updated_
 2015_ver_nov2017.pdf
- [27] Technology data for energy plants (August 2016), Tech. rep., Danish Energy Agency (2017). URL https://ens.dk/sites/ens.dk/files/Analyser/technology_data_catalogue_for_energy_plants_-_aug_2016_update_oct_nov_2017.pdf
- [28] Samfundsøkonomiske beregningsforudsætninger for energipriser og emissioner, Tech. rep., Danish Energy Agency (2017). URL https://ens.dk/sites/ens.dk/files/Analyser/ samfundsoekonomiske_beregningsforudsaetninger_2017.pdf
- [29] S. Frederiksen, S. Werner, District heating and cooling, Studentlitteratur, 2013.
- [30] M. G. Rasmussen, G. B. Andresen, M. Greiner, Storage and balancing synergies in a fully or highly renewable pan-European power system, Energy Policy 51 (2012) 642-651. doi:10.1016/ j.enpol.2012.09.009. URL http://dx.doi.org/10.1016/j.enpol.2012.09.009
- [31] H. Averfalk, P. Ingvarsson, U. Persson, M. Gong, S. Werner, Large heat pumps in Swedish district heating systems, Renewable and Sustainable Energy Reviews 79 (2017) 1275–1284. doi:10.1016/j.rser.2017.05.135.
- [32] Long term storage and solar district heating, Tech. rep., PlanEnergi (2016). URL https://ens.dk/sites/ens.dk/files/Forskning_og_ udvikling/sol_til_fjernvarme_brochure_endelig.pdf
- [33] S. Becker, R. A. Rodríguez, G. B. Andresen, S. Schramm, M. Greiner, Transmission grid extensions during the build-up of a fully renewable pan-European electricity supply, Energy 64 (2014) 404-418. doi:10.1016/j.energy.2013.10.010.
- [34] Energinet, Energi data service, Online. Accessed 2018.01.10. (Jan. 2018). URL https://www.energidataservice.dk/
- [35] J. MacQueen, et al., Some methods for classification and analysis of multivariate observations, in: Proceedings of the fifth Berkeley symposium on mathematical statistics and probability, Vol. 1, Oakland, CA, USA, 1967, pp. 281–297.
- [36] F. Pedregosa, G. Varoquaux, A. Gramfort, V. Michel, B. Thirion, O. Grisel, M. Blondel, P. Prettenhofer, R. Weiss, V. Dubourg, J. Vanderplas, A. Passos, D. Cournapeau, M. Brucher, M. Perrot, E. Duchesnay, Scikit-learn: Machine learning in Python, Journal of Machine Learning Research 12 (2011) 2825–2830.
- [37] A. Arabkoohsar, G. B. Andresen, Design and analysis of the novel concept of high temperature heat and power storage, Energy 126 (2017) 21-33. doi:10.1016/j.energy.2017.03.001.