

A Detailed Model of the Irish High Voltage Power Network for Simulating GICs

Seán P. Blake,^{1,2*} Peter T. Gallagher,^{1†}, Joan Campanyà,^{1†} Colin Hogg², Ciarán D. Beggan³, Alan W.P. Thomson³, Gemma S. Richardson³, David Bell⁴

Key Points.

- A detailed model of the Irish 400, 275, 220 and 110 kV power network was developed for GIC simulations.
- The impact of assumptions used to construct a power network model were evaluated for GIC simulations.
- Heavy rainfall before a 2015 geomagnetic storm may have decreased the grounding resistance at a substation, leading to larger GICs.

Abstract.

Constructing a power network model for geomagnetically induced current (GIC) calculations requires information on the DC resistances of elements within a network. This information is often not known, and power network models are simplified as a result, with assumptions used for network element resistances. Ireland's relatively small, isolated network presents an opportunity to model a complete power network in detail, using as much real-world information as possible. A complete model of the Irish 400, 275, 220 and 110 kV network was made for GIC calculations, with detailed information on the number, type and DC resistances of transformers. The measured grounding resistances at a number of substations were also included in the model, which represents a considerable improvement on previous models of the Irish power network for GIC calculations. Sensitivity tests were performed to show how calculated GIC amplitudes are affected by different aspects of the model. These tests investigated: (1) How the orientation of a uniform electric field affects GICs. (2) The effect of including/omitting lower-voltage elements of the power network. (3) How the substation grounding resistances assumptions affected GIC values. It was found that changing the grounding resistance value had a considerable effect on calculated GICs at some substations, and no discernible effect at others. Finally, five recent geomagnetic storm events were simulated in the network. It was found that heavy rainfall prior to the 26-28 August 2015 geomagnetic storm event may have had a measurable impact on measured GIC amplitudes at a 400/220 kV transformer ground. **Accepted for publication in AGU Space Weather. Copyright 2018 American Geophysical Union. DOI:10.1029/2018SW001926**

1. Introduction

Geomagnetically induced currents (GICs) are one of the most disruptive and damaging space weather hazards. Variations in the Earth's magnetic field induce these electrical currents in grounded conductors such as railways [Eroshenko

et al., 2010], pipelines [Pulkkinen *et al.*, 2001], and particularly in power networks [Pirjola, 2000]. GICs that arise during geomagnetic storm events can lead to transformer damage and widespread disruption to the network. The most famous example of the threat posed by GICs to power networks is the March 1989 geomagnetic storm, when GICs and their effects precipitated a blackout in the Hydro-Québec transmission [Bolduc, 2002].

The potential for damage to power networks has prompted studies of GICs around the world. It has long been recognised that the larger magnetic variations at higher latitudes drive larger GIC events, and studies have been conducted in countries such as Finland [Viljanen & Pirjola, 1994], Sweden [Wik *et al.*, 2008], Norway [Myllys *et al.*, 2014] and Canada [Boteler *et al.*, 1989]. It is now known that GICs can contribute to the failure of transformers in low-latitude and mid-latitude countries through repeated heating of transformer insulation [Koen & Gaunt, 2003; Gaunt & Coetzee, 2007]. GICs can cause wear on transformers, leading to reduced efficiency and possible failure months after geomagnetic events, even if typical geomagnetic variations are small. GICs have been studied in power networks in lower latitude countries such as Austria [Bailey *et al.*, 2017], Spain [Torta *et al.*, 2014, 2017], China [Zhang *et al.*,

¹School of Physics, Trinity College Dublin, Dublin 2, Ireland

²Dublin Institute for Advanced Studies, 5 Merrion Square, Dublin 2, Ireland

³British Geological Survey, Lyell Centre, Riccarton, Edinburgh, EH14 4AP, UK

⁴EirGrid Plc., The Oval, 160 Shelbourne Rd, Ballsbridge, Dublin 4, Ireland

* Current address: NASA Goddard Space Flight Center, Space Weather Laboratory, Greenbelt, Maryland, USA

† Current address: Astronomy and Astrophysics Section, School of Cosmic Physics, Dublin Institute for Advanced Studies, Dublin 2, Ireland

2015; Guo et al., 2015], New Zealand, Australia [Marshall et al., 2013], South Africa [Ngwira et al., 2011], Ireland [Blake et al., 2016], the UK [Beggan et al., 2013; Kelly et al., 2017], and Brazil [Barbosa et al., 2017], among others.

The simplest way to study GICs in a network is to measure GICs as they flow to and from transformer grounds. This can be achieved using a Hall effect probe attached to a transformer ground. Ideally, every grounded point in a network would have a Hall effect probe for full GIC resolution. In practice, Hall effect probes can be expensive and disruptive to install on a transformer, and many countries have a limited number of Hall effect probes to measure GICs. A notable exception to this is New Zealand, which has tens of measurements which have been recording for several years [MacManus et al., 2017]. GICs can also be measured by utilizing the differential magnetometer method [Matandirotya et al., 2016], where magnetometers measure the magnetic signal of GICs beneath transmission lines. Another indirect measure of GICs is to examine the chemical composition of gas in transformer housing [Gaunt, 2014]. As the transformer is repeatedly heated from GICs, this chemical composition will change with time.

Where GIC measurements are limited to a few transformers (or none at all), GICs can be simulated in a network. These estimations are commonly separated into two distinct parts: the geophysical step, and the engineering step [Pirjola, 2000]. The geophysical step involves calculating surface horizontal electric fields induced by the varying geomagnetic field. The magnitude of the induced surface electric fields depends on the resistivity of the subsurface geology [Wei et al., 2013; Pulkkinen et al., 2012]. Different methods of calculating surface electric fields are used for GIC calculation, including the simple plane-wave method [Pirjola, 2001], the multi-dimensional magnetotelluric (MT) method [Bedrosian & Love, 2015; Love et al., 2015; Torta et al., 2017] and the thin-sheet method [Bailey et al., 2017; Thomson et al., 2005].

Once the surface electric field is calculated, GICs in a grounded power network can be calculated (the engineering step). Accurately modelling a power network for GIC calculations requires knowledge of different components of the network. These include the transformer types in substations, the DC resistances of the windings in these transformers, the DC resistance of connections between substations, and substation grounding resistances [Boteler & Pirjola, 2016]. Using this information, a model of a power network can be constructed. This can then be imposed upon surface electric field values, and GICs can be calculated for each grounded point.

Frequently, researchers do not have access to information on the elements of a power network for GIC modelling. As such, estimations of substation grounding and transformer winding resistances are often made for some or all of a power network [Myllys et al., 2014; Torta et al., 2014; Blake et al., 2016]. In addition, studies often focus on the power network of a particular country in isolation, whereas in reality, most countries have interconnected power networks. The points of interconnection provide a route for GIC to flow between power networks, and so must be modelled for GIC calculations. Equivalent circuits can be constructed to approximate the connection between two different power networks [Boteler & Pirjola, 2016]. Finally, when a power network is modelled, lower voltage regimes within the network are often omitted. High voltage transmission lines tend to be longer and have lower resistances than lower voltage lines, meaning they are more likely to experience the largest GIC values. Studies have shown that neglecting the lower voltage portion of a network can significantly change the calculated GIC in a network [Torta et al., 2014; Guo et al., 2015].

Ireland's relatively small network presents an opportunity to model a stand-alone power network while making minimal assumptions about the DC characteristics of its components. Apart from two high voltage DC (HVDC) lines which connect it to Wales and Scotland, the integrated power network in Ireland and Northern Ireland is isolated from other

power networks, and can be modelled without approximating adjacent power networks. In this paper, we present a detailed model of the Irish power grid for GIC calculations. This improved model includes 400, 275, 220 and 110 kV lines and substations, and models the number and type of transformers in substations that operate at 220 kV or higher. Information on the grounding resistances was provided by EirGrid (Ireland's power network operator) for a limited number of substations, and Tee-junction connections were used to more accurately model GICs. A number of different sensitivity tests were performed on the power network model to investigate how the assumptions used in its construction affect calculated GIC values. Finally, GICs were calculated in the network for five minor geomagnetic events, and the values were compared to GIC values measured at a single transformer in Ireland.

2. Modelling GICs in a Power Network

While power network operators often use commercially available power system analysis tools to analyse GICs, the most commonly used approach to modelling GICs in academia is the Lehtinen-Pirjola (LP) method [Lehtinen & Pirjola, 1985]. This approach treats a subject power grid as a discretely earthed network, and applies Ohm and Kirchoff's Laws in order to calculate induced currents. As

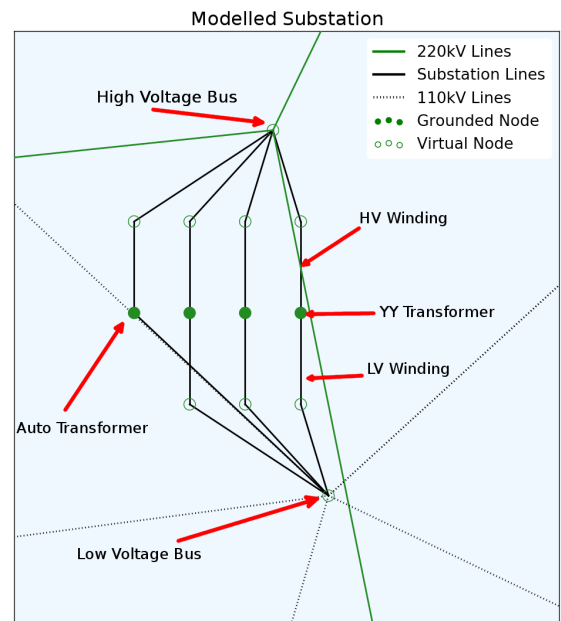


Figure 1. A 220/110 kV substation created by the power network model generator. This substation has one auto-transformer, and three YY-transformers connected in parallel. The autotransformer has one internal connection which has the resistance of the HV winding. Each of the YY-transformers has two connections with resistances set to the HV and LV winding resistances. The resistances of the substation lines between buses and nodes are set to be infinitesimally small.

GICs are driven by magnetic field variations with frequencies <1 Hz, it is appropriate to treat GICs as DC [Boteler & Pirjola, 2016]. The LP method allows for the modelling of any power network, so long as the following information about the network is known (or estimated): positions of substations, types and numbers of transformers in substations, transformer winding resistances, substation grounding resistances, connections between substations and the resistances of these connections.

This information can be used to solve the following for GICs in a network:

$$\mathbf{I} = (\mathbf{1} + \mathbf{YZ})^{-1}\mathbf{J} \quad (1)$$

where \mathbf{I} is the matrix of GIC values flowing through earthed nodes (transformers), $\mathbf{1}$ is the unit matrix, \mathbf{Y} is the network admittance matrix (defined by the resistances of the conductors of the network), \mathbf{Z} is the earthing impedance matrix and \mathbf{J} is the ‘perfect earthing’ current, defined as:

$$J_i = \sum_{j \neq i} \frac{V_{ij}}{R_{ij}} \quad (2)$$

where V_{ij} and R_{ij} refer to the geo-voltages and line resistances between two nodes i and j [Beggan, 2015]. AC power networks utilize three phase power lines. In order to simplify the calculation of GICs in these lines, the parallel paths of each phase can be used to calculate an equivalent circuit for GIC calculation [Boteler & Pirjola, 2016]. In practical terms, this involves dividing line and transformer winding resistances by three. In most transmission networks, there are different voltage levels which can be modelled. The flow of GICs in a network of multiple voltages will be through the windings of the transformers at each substation. The type of transformer determines that nature of the path for flow of GICs. Boteler & Pirjola [2014] outlines how two-winding (or ‘YY’) and auto-transformers can be treated in a power network model in order to more accurately simulate GICs with the LP method.

By including virtual nodes (nodes with infinitely large grounding resistances) at the neutral points of transformers, YY and auto-transformers can be modelled without introducing non-zero off-diagonal elements in the earthing impedance matrix \mathbf{Z} [Pirjola, 2005]. For auto-transformers, a single virtual node is placed at the high-voltage connection point of the transformer. For a YY-transformer, a node is placed at both the high and low-voltage connection points of the transformer.

There are two challenging aspects to modelling a power network for GIC calculations when utilizing the LP method. The first is collating the information regarding the power network. As power networks typically have hundreds of substations, this can be a time-consuming task to gather DC characteristics of a power network (particularly if this information is not digitised). Assuming one can collect this information, the second challenging task is constructing the network model so that it can be used to calculate GICs with the LP method in the manner outlined above. This process was automated using an open-source Python program (<https://doi.org/10.5281/zenodo.1252432>). This program takes as inputs the collated information on a power network, and outputs a model that can be used with the LP method of GIC calculation. The program can take into account the different transformer types listed above, multiple transformers per substation and dual-circuit connections between substations. An example of how the program handles a substation with multiple transformers is shown in Figure 1. This shows a 220/110 kV substation with four transformers connected in parallel (one auto and three YY-transformers). They are each connected to high and low

voltage buses, which connect to other 220 and 110 kV substations respectively. The filled circles are connected to a common ground, and it is here that the GIC are calculated. Each of the unfilled circles are the virtual nodes with infinite grounding resistances. The connections between nodes were given resistances equal to the winding resistances of the transformers.

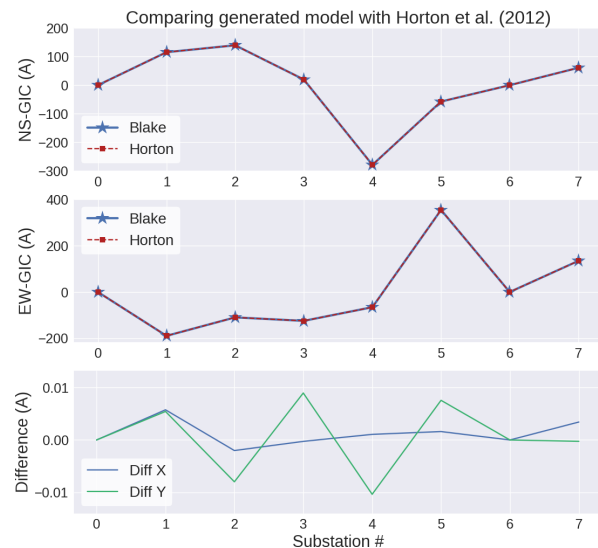


Figure 2. GIC values given in *Horton et al.* [2012] compared to GIC values calculated using the power network model generator.

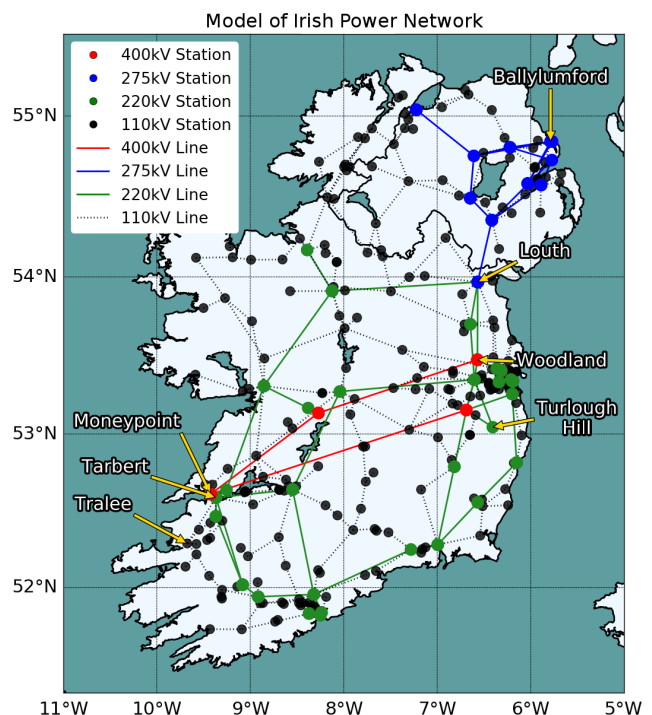


Figure 3. Model of the Irish HV power network. This model includes 400, 275, 220 and 110 kV substations and lines. Ireland’s only Hall Effect GIC monitor is located at the 400/220 kV Woodland substation.

In order to verify that the program was accurately creating power network models for given transformer and connection information, the test-case 500 and 345 kV power network featured in *Horton et al.* [2012] was used as an input to the network model generator program. This network consists of eight substations with a total of 15 auto and YY-transformers. Also included in this model is a GIC blocking device at one substation, and some instances of multiple parallel connections between substations. This information was fed into the model generator, and the output model was subjected to a 1 V km^{-1} electric field. The resulting GICs calculated at each of the substations were compared to those values calculated in *Horton et al.* [2012]. Figure 2 shows the comparison between the GIC values given in the paper and those calculated using the power network model generator. The differences between the calculated GIC and the *Horton et al.* [2012] model are on the order of 0.01 A. As the differences in calculated GIC values were small given the amplitude of modelled GICs, the power network model generator was used to create a model of the Irish power network using all available information provided by EirGrid.

3. Constructing a Detailed Model of The Irish Power Network

The Irish power network consists of approximately 270 substations and 6,400 km of 400, 275, 220 and 110 kV transmission lines in both countries of Ireland and Northern Ireland. The all-island power network is isolated from other power networks (except via two HVDC connections), so it can therefore be considered as a whole without approximating peripheral power networks. Ireland's small size (approximately $500 \times 300 \text{ km}$) and population means that it requires fewer high-voltage lines and substations than other larger countries. As such, Ireland has only four 400 kV substations, and three 400 kV transmission lines, running roughly West-East. The next highest voltage lines (275 kV) operate only in Northern Ireland, and 220 kV substations operate only in the Republic of Ireland. 110 kV substations and lines operate on all parts of the island of Ireland, and in low population density areas (such as the North West and West), 110 kV lines are the only high voltage (HV) transmission lines in operation. The power network can be seen in Figure 3.

The Irish power network model used in *Blake et al.* [2016] did not include 110 kV substations and transmission lines. In addition, it assumed a single transformer per substation, as well as resistance values for both transformer windings and substation grounds (0.5Ω and 0.1Ω respectively). This model has been improved upon to include the following: (1) The correct number and type of transformers in substations which operated at 220 kV or higher. (2) The DC resistances of the high and low voltage windings in these transformers. These values ranged from 0.04 to 0.68Ω . (3) The substation grounding resistance measured at 33 substations across Ireland. These values ranged from 0.25 to 6.35Ω . The remaining 237 substations were given grounding resistances fixed at 1Ω . This value was chosen as it is the value that EirGrid aim to maintain at their substations for operational safety. It is worth noting that these values are considerably larger than the 0.1Ω typically used in studies when true grounding resistances are unknown. (4) DC resistances for all transmission lines (including instances where multiple connections exist between substations). (5) A number of T-junctions in the network (modelled as nodes with infinitely large grounding resistances).

Each substation that operates at 110 kV was assumed to have a single transformer with a winding resistance of 0.087Ω . This value was chosen as it was a representative

resistance value of the LV windings in the 220/110 kV transformers. All of this information was used as inputs for the power network model generator, and the output model was used for GIC calculations. Of all of the substations in the network, Louth is the only substation with transformers operating at three different voltages (275, 220 and 110 kV). This was therefore modelled as two separate substations (275/220 and 220/110 kV) with a shared grounding resistance value. For the purpose of analysis, GICs calculated at the two substations were summed.

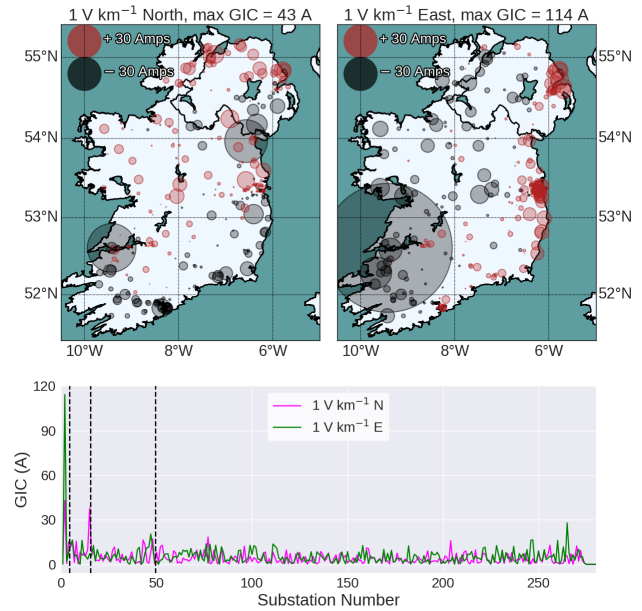


Figure 4. Response of the Irish power network model to uniform 1 V km^{-1} electric fields pointing North and East. The model saw peak GICs of 113 A in the 400/220 kV Moneypoint substation in the West of Ireland. The bottom plot shows the calculated GIC for each substation. The dashed lines separate (from left to right) the 400, 275, 220 and 110 kV substations. These are ordered alphabetically within each voltage division.

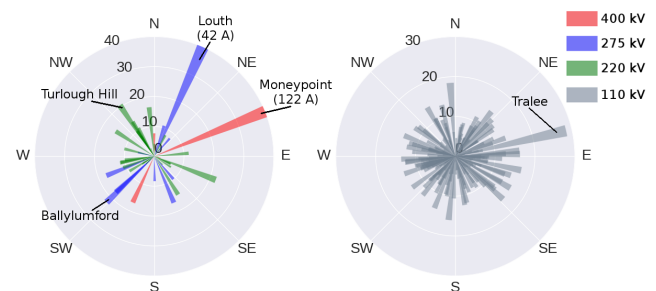


Figure 5. Maximum positive GIC calculated for each substation when a uniform 1 V km^{-1} electric field is rotated 360° from North. In each subfigure, angle corresponds to direction of electric field, and length of each segment is the maximum current. The red, blue, green and grey segments correspond to the 400, 275, 220 and 110 kV substations respectively. GICs of 122 A were calculated at the Moneypoint substation.

4. Sensitivity Tests

Once a network model has been created, it is informative to subject it to idealised geoelectric fields and subsequently calculate GIC values at the model nodes. This will give an indication as to which substations will see larger GIC amplitudes due solely to the orientation of a network. This exercise has been used on a number of different network models in different studies [Horton *et al.*, 2012; Myllys *et al.*, 2014; Torta *et al.*, 2014; Blake *et al.*, 2016].

4.1. Electric Field Orientation

Uniform 1 V km^{-1} electric fields oriented North and East were applied to the model network, and resulting GICs were calculated at each of the nodes. The calculated GICs for each substation can be found in Figure 4. The Moneypoint substation (substation number 2 in figures below) had the largest calculated GICs, with a maximum of 114 A for an eastward directed electric field. The large GIC values in this substation are to be expected, given that it is connected to two of the largest transmission lines in the country. The substation that experienced the next largest GIC was the 275/220 kV Louth substation, which connects the HV networks in the Republic and Northern Ireland. GICs were calculated at 38 A when the uniform electric field was oriented northward. Only a single 110 kV substation had calculated GIC values greater than 25 A. This was Tralee in the South-West, with calculated GICs of 28 A for an eastward directed field.

Figure 5 shows the maximum positive calculated GIC value at each substation when the 1 V km^{-1} is rotated 360° . Moneypoint again had the largest calculated GIC values, with 122 A when the electric field points 69° clockwise from North. With the exception of Tralee, it can be seen that the 275 and 220 kV substations experience marginally larger GICs than the 110 kV substations. With the exception of Moneypoint, Ireland has relatively low calculated GIC values for a 1 V km^{-1} electric field when compared to other countries [Myllys *et al.*, 2014; Torta *et al.*, 2014]. This is likely due to a combination of factors. The network's small

size limits the length of the largest transmission lines in Ireland to less than 200 km. With the addition of the 110 kV substations, Ireland has approximately one grounded transformer for every 220 km^2 , providing many grounded points in the network for GICs to flow to and from the ground. Additionally, as noted above, the grounding resistance values used in the model are larger than those used in other studies. This will also limit calculated GIC amplitudes.

4.2. Including Lower Voltage Elements

As shown in Guo *et al.* [2015] and Torta *et al.* [2014], neglecting lower-voltage elements in a power network can

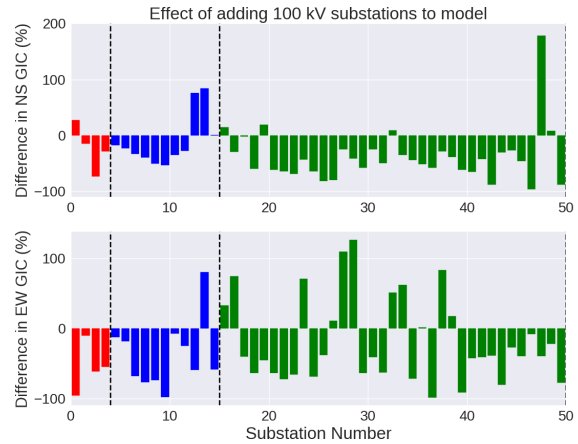


Figure 7. Proportional difference in calculated GICs when the 110 kV elements are added to the Irish power network model. The top and bottom plots are for northward and eastward directed electric fields respectively. The dashed lines separate (from left to right) the 400, 275 and 220 kV substations.

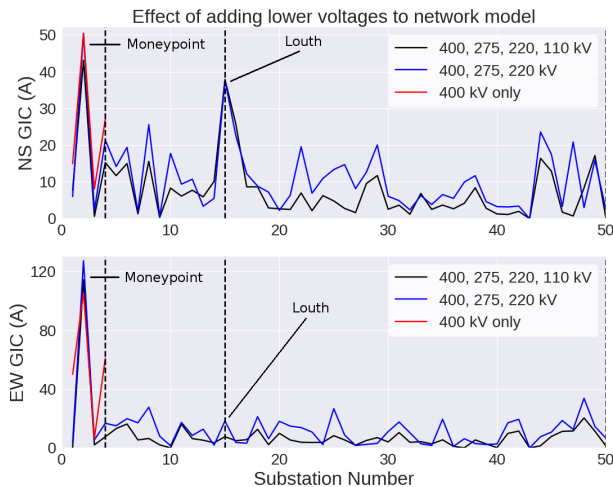


Figure 6. Calculated GICs for different voltage levels in the Irish network. The top and bottom plots are for northward and eastward electric fields respectively. The dashed lines separate (from left to right) the 400, 275 and 220 kV substations.

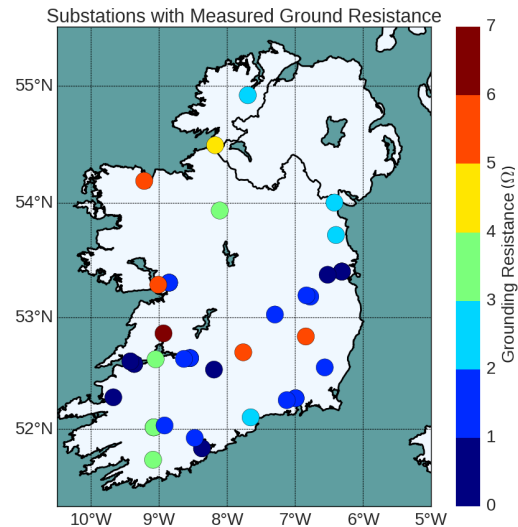


Figure 8. Locations of substations with measured grounding resistances. These values range from 0.25–6.35 Ω . The remaining substations were set at 1 Ω .

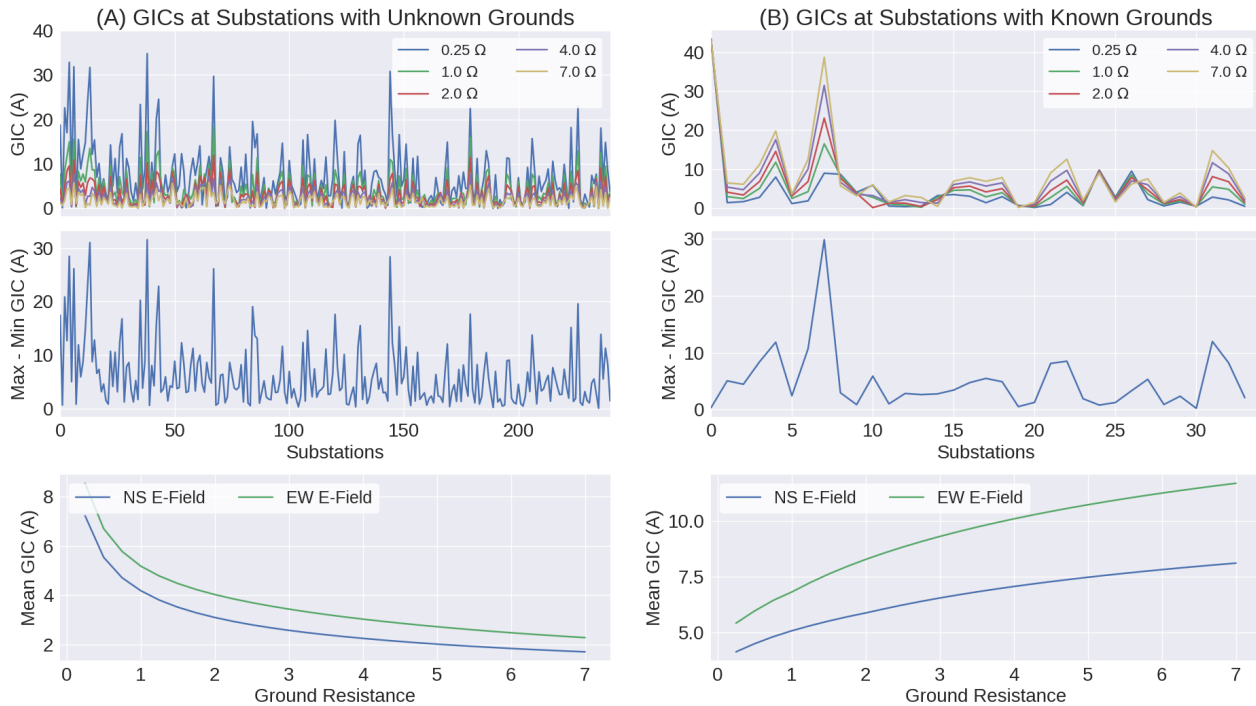


Figure 9. The GIC response of substations due to a uniform 1 V km^{-1} electric field when the grounding resistance assumption of 1Ω is altered. Subfigure (A) shows the response of those substations whose grounding resistances are unknown, subfigure (B) shows the response of the 33 substations with known and fixed grounding resistances. The bottom plots show the average GIC per substation as the grounding resistance assumption is altered.

Variation of GICs due to Grounding Res. Assumption

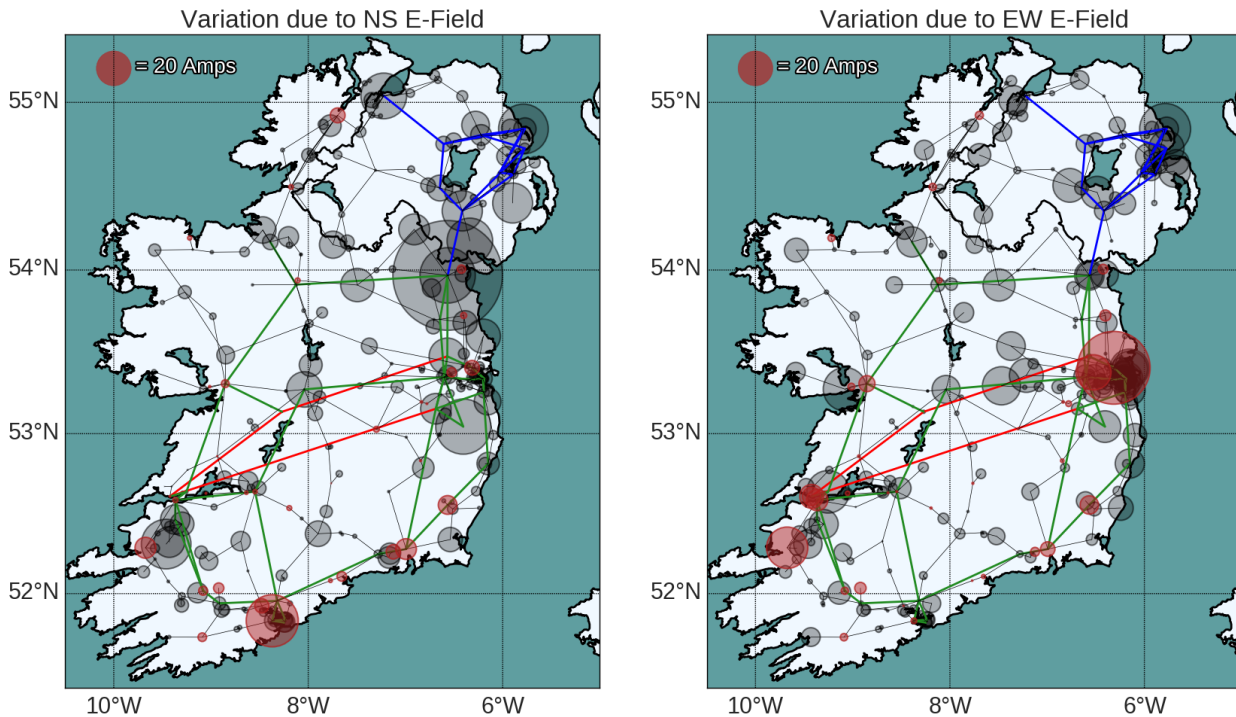


Figure 10. Maximum variations in calculated GICs for different grounding resistance assumption. The grounding resistances were varied from $0.25\text{--}7 \Omega$. Red circles are for substations with known grounds, and black are for those with assumed grounding resistances.

have a significant impact on calculated GICs, although this is highly dependent on the makeup of an individual network.

In order to investigate the effect including lower voltage ele-

ments have on GIC calculations in the Irish power network, three calculations were made for northward and eastward-directed uniform electric fields. In the first calculation, only the 400 kV substations and lines were included in the power network. After this, the model was altered to include the 275 and 220 kV elements. Finally, the 110 kV substations and lines were included to complete the HV network model.

Figure 6 shows the calculated GICs for each of these three network models when a uniform 1 V km^{-1} electric field is imposed on the network. When the 400 kV only model is compared to the 400, 275 and 220 kV model, each of the 400 kV substations have smaller calculated GICs. The exception to this is the Moneypoint substation when the uniform electric field is eastward-oriented. In this case, GICs at Moneypoint increased from 105 A to 127 A with the addition of the 275 and 220 kV elements of the network. Generally, for each of the 400, 275 and 220 kV networks, the addition of the 110 kV network decreases the calculated GICs, as the currents are directed to and from the lower voltage substations. The ten substations which had the largest change in GICs amplitudes each saw reduced GICs. Each of these ten substations were connected to at least three 110 kV substations (an exception to this is Moneypoint, which is connected only to a single 220 kV substation). It is to be expected that substations most affected by the addition of the lower voltages are connected to lower voltage substations.

The proportional changes in calculated GICs when the 110 kV substations are added are shown in Figure 7. This shows that there was a general decrease in GIC although there were increased GIC amplitudes in 17 substations. The largest proportional increase occurs in the 220 kV Tarbert substation, increasing by 178% with a northward-directed field. Whilst this is quite a large proportional increase, in absolute terms, the GICs at this substation increased from 3.01 to 8.36 A. In the case of the Irish power network, with some exceptions, omitting the lower voltage elements in the network model would lead to overestimating the ‘true’ GIC values in higher voltage substations, particularly at those substations with direct connections to the lower voltage elements.

4.3. Grounding Resistances

The locations of the 33 substations which have known grounding resistances are shown in Figure 8. All other substations in the power network model were assumed to have a grounding resistance of 1Ω . When compared to the mean three-phase resistances for the transmission lines and individual transformer windings in the network (0.73Ω and 0.062Ω respectively), this large grounding resistance assumption will be an important factor in determining the distribution of GICs in the power network. In order to investigate how the assumed grounding resistance value affects GIC calculations, the 1Ω assumption was varied from 0.25Ω to 7Ω in 0.25Ω increments. For each grounding resistance value chosen, a uniform 1 V km^{-1} electric field was applied to the network, and resulting GICs were calculated. Figure 9 shows the calculated GICs at the substations with assumed and varying (subfigure A) and known and fixed (subfigure B) grounding resistances.

Figure 9 shows from top to bottom: the GIC calculated at each substation for a varying grounding resistance value, the variation in GIC for each substation (maximum calculated GIC minus minimum calculated GIC) for the simulations and assumed grounding resistance value against average GIC per substation. As can be expected, varying the grounding resistance assumption from 0.25Ω up to 7Ω gives greatly different GIC values at many of the substations. This is not true for all substations however, with GIC amplitudes varying by only a small amount at some substations. The Moneypoint substation is an example of one of the substations with a known grounding resistance value of 0.25Ω . Varying the grounding resistance of the other substations in the network changed the calculated GIC in Moneypoint by only 0.7 A.

The variations in GIC amplitudes ranged from approximately 0 to 30 A for both groups of substations. This shows that the grounding resistance at a substation can be an important factor in GIC calculation, but the impact it has depends on the substation in question, and its connections to other substations. Generally, the larger the grounding resistance assumption, the smaller the GICs in the substations with unknown grounds. The inverse of this is true at the 33 substations with fixed grounds. By assuming large grounding resistances for the majority of the network, those substations with fixed values become more viable routes for GICs to flow to and from the ground.

Figure 10 shows the the maximum calculated variation for each substation for northward and eastward directed electric fields. The red circles indicate substations with known, fixed grounding resistances, and the black circles indicate those substations whose grounding resistance was varied. Figure 10 shows that the orientation of the electric field will also determine how much of an effect varying the grounding resistance will have on calculated GICs: some substations show large variations with northerly electric fields, but not with easterly electric fields, and vice versa.

5. Modelling GICs During Recent Geomagnetic Storms

In mid-2015, a Hall Effect probe was installed on a transformer ground in the 400/220 kV Woodland substation in the East of Ireland. Since then, the device has been recording continuously, and has been operational for a number of minor geomagnetic storm events. Five of these events were used to simulate GICs in the complete HV power network described above. These events are the 26-28 August 2015, 07-08 September 2015, 07-08 October 2015, 20-21 December 2015, and the 06-07 March 2016 storms. The planetary K (Kp) and disturbed storm time (Dst) indices for each event are given in Table 1.

For each event, magnetic data were collected from the INTERMAGNET and MagIE [Blake *et al.*, 2016] observatory networks around Ireland, Britain and Europe. These data were interpolated across Ireland using the spherical elementary current system method [Amm & Viljanen, 1999]. A uniform $400 \Omega\text{m}$ ground resistivity model was used with the magnetotelluric method to calculate surface electric fields across Ireland. Finally, the model of the complete power network was overlaid on the calculated surface electric fields, and GICs were calculated. The calculated values at the Woodland transformer were then compared to the measured GIC values. The measured and calculated GIC values at the Woodland transformer for each of the five events are shown in Figure 11.

Three goodness-of-fit measures were selected to quantify the fit of the calculated GIC to the measured GICs. These are the root mean squared error (RMSD), the Torta *et al.* [2014] defined performance parameter (P), and Pearson’s correlation coefficient (R). The goodness-of-fit measures for each of the events are shown in Table 1. Generally, the measured GICs during each of the storm events were modelled reasonably well using the $400 \Omega\text{m}$ resistivity model and the detailed power network model, although different events are modelled to a different degree of accuracy. Of the five events, the worst-fit was the 07-08 September 2015 event, with the highest RMSD and lowest R value. The other four events had correlation coefficients which ranged from 0.59 to 0.68.

While the detailed power network model was able to replicate GICs with a reasonable level of accuracy for five small

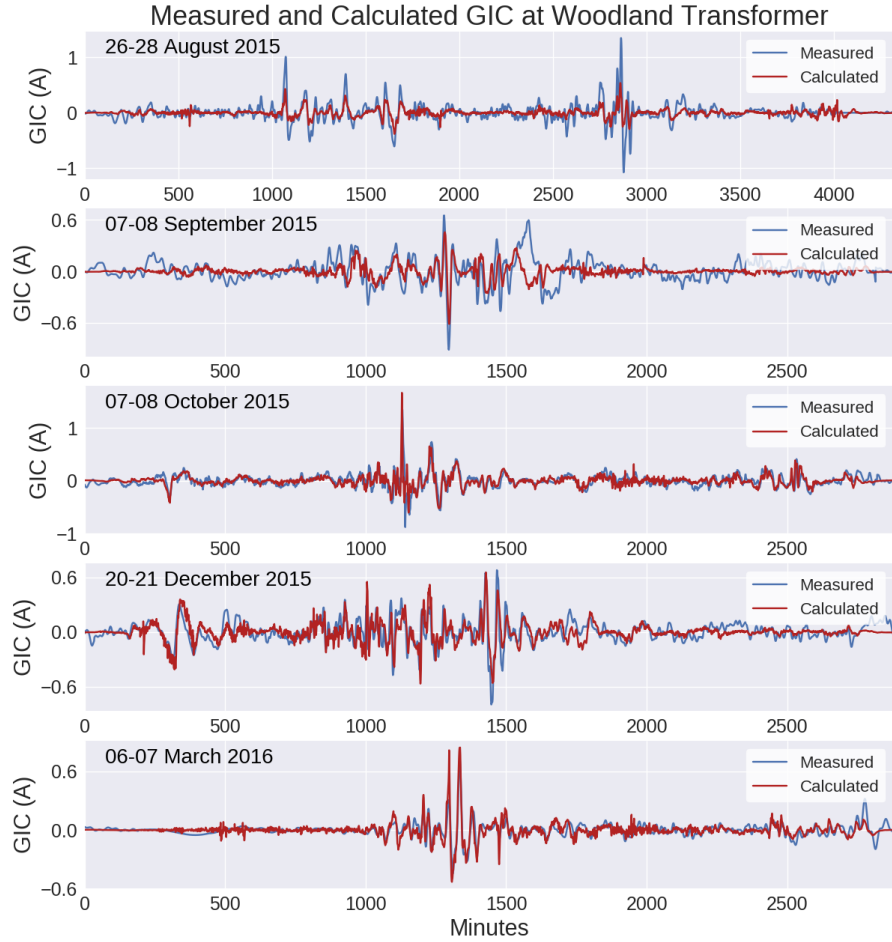


Figure 11. Measured and calculated GIC at a transformer in the 400/220 kV Woodland substation for five recent storm events. The GICs were driven by electric fields calculated using a uniform $400 \Omega\text{m}$ resistivity model.

Table 1. Goodness of fit measures for the calculated and measured GICs at Woodland for five recent geomagnetic storm events. These are the root-mean-square-difference (RMSD), the *Torta et al.* [2014] defined performance parameter (P), and Pearson’s correlation coefficient (R), where subscripts o and c refer to the observed and calculated GIC values. Kp and Dst values for each storm were taken from <http://wdc.kugi.kyoto-u.ac.jp/>.

Storm Event	Kp	Dst (nT)	RMSD _{oc} (A)	P_{oc}	R_{oc}
26-28 Aug. 2015	6+	-90	0.127	0.224	0.685
07-08 Sep. 2015	6+	-70	0.128	0.090	0.425
07-08 Oct. 2015	7+	-124	0.100	0.239	0.676
20-21 Dec. 2015	7-	-155	0.101	0.201	0.639
06-07 Mar. 2016	6+	-98	0.071	0.044	0.599

events, there are a number of caveats which must be taken into account. Firstly, Ireland has only a single GIC probe at a single transformer. Uncertainty exists around the calculated GIC values in the rest of the power network. Secondly, the GICs seen in Woodland since 2015 are all quite small. No GIC values larger than 2 A have yet been measured in Ireland. It is worth noting that the low measured GIC amplitudes in the five events are approximately an order of magnitude larger than the noise levels in the Hall Effect probe (± 0.1 A). The accuracy of the model for larger or historical events (pre-2015) can only be estimated. Finally, the five geomagnetic events in this paper occur over a period of eight months. During this time, it is possible that the network may have had elements added or removed as part of its normal operation (either for repairs/maintenance or load balancing), altering the flow of GICs in the network. This

information was not available for modelling however, and the same network model was used for all five events. This may explain why some events are better modelled than others.

5.1. Soil Moisture Variation and GIC Amplitudes

The August 2015 event is of particular interest, as unlike the other four simulated events, it has a high correlation coefficient (0.68), but it underestimates the amplitude of GICs by a factor of approximately 2.5. The difference between this event and the other four may be due to the variability of Woodland’s ground resistance due to terrestrial weather. If the sediment beneath a substation becomes sodden due to rainfall, it will become more conductive. This will reduce the grounding resistance between the transformer neutrals and the ground, allowing larger GICs to enter the network.

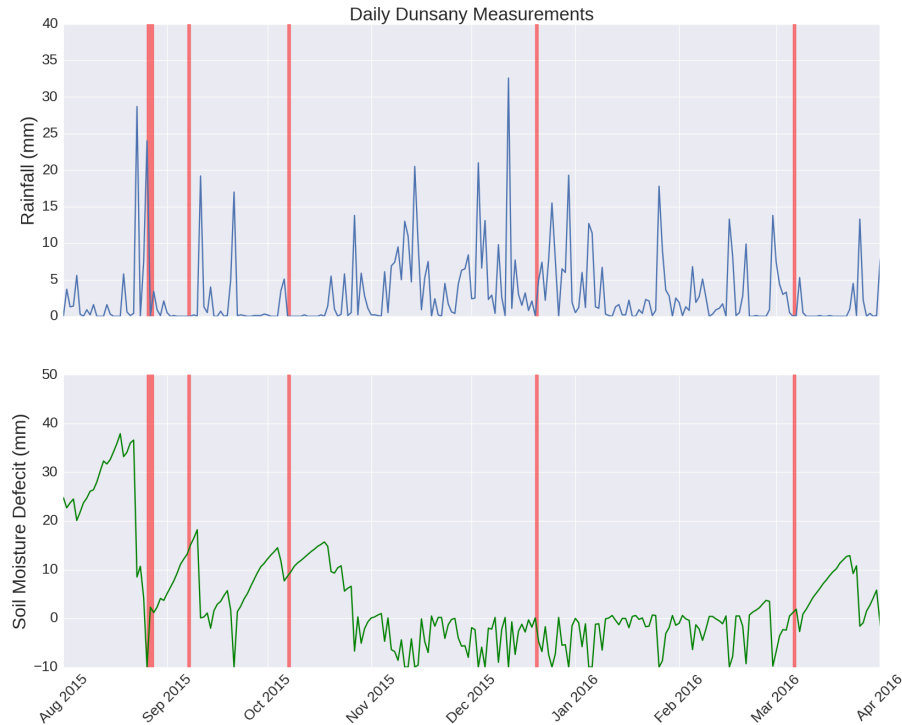


Figure 12. Rainfall (top) and soil moisture deficit for a moderately drained soil sample (bottom) at the Met Éireann operated meteorological station 7 km from the Woodland substation. The times highlighted in red are the five geomagnetic storm events modelled in this paper. 60 mm of rain fell in the three days before the August 2015 geomagnetic storm event, and the soil sample at Dunsany was saturated for the first day of the geomagnetic storm event.

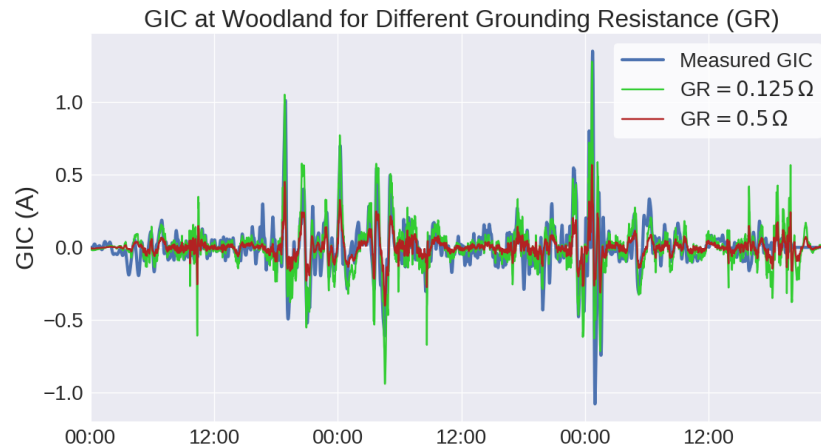


Figure 13. Measured and calculated GIC at the Woodland transformer for different grounding resistances (GR) for the August 2015 geomagnetic storm. Changing this value from 0.5 to 0.125 Ω increases the amplitude of the calculated GICs to better match the measured GICs.

In the five simulations, the Woodland substation was given a grounding resistance of 0.5 Ω . In reality, this may have differed for each event, depending on the conductivity of the subsurface at the time of the storm.

Met Éireann, Ireland's meteorological service, operates the Dunsany weather station 7 km from the Woodland substation. At this weather station, rainfall measurements are taken. In addition, daily soil moisture deficit (SMD) measurements are taken for soil samples with different drainage characteristics (classed as well, moderately or poorly drained

soils). This measures the amount of rain needed to bring the soil moisture content back to capacity. When the SMD is at a minimum measured value of -10 mm, the soil is considered saturated. The measured daily rainfall and SMD in a moderately drained soil sample for the 5 events are shown in Figure 12. Of all of the periods of interest, August 2015 had the most rainfall immediately before a geomagnetic storm, with 60.2 mm of rain falling in the three days prior to the event. On average, Ireland experiences between 2 and 2.7 mm of rainfall per day, and the heavy rainfall sat-

urated the soil samples at Dunsany on 20 August 2015. The event with the next largest amount of rainfall was the October 2015 event, with 8.6 mm of rainfall in the three days before this event.

It is possible that heavy rainfall prior to the August 2015 event had a measurable effect on the galvanic connection between the transformer grounds and the Earth. By reducing the grounding resistance at Woodland from 0.5 Ω to 0.125 Ω in the power network model, the calculated GICs better match the larger peaks in the measured GIC timeseries for the August 2015 event. This can be seen in Figure 13. Despite better fitting the larger peaks, the RMSD actually decreased from 0.127 to 0.122 with the lower grounding resistance. This is due to the overestimation of GIC amplitudes towards the end of the event. This may correspond to the ground draining by 21 August 2015 (Figure 12), increasing the substation ground resistance value.

While the above exercise suggests that rainfall may have had some influence on the magnitude of GICs in Woodland for this event, a number of uncertainties exist. The moderately drained soil sample at the Dunsany weather station was saturated at the start of the August event. The SMD of the soil at and around the Woodland substation is unknown however, as is how the grounding resistance value may change over time. For this simulation, only the grounding resistance at the Woodland substation was changed. If rainfall had an effect on the grounding resistance at Woodland, it is likely that it had an effect on other substations. This was not factored in to the simulations, as GIC measurements are limited only to Woodland. There may also have been changes in the makeup of the network which could account for the differences in the five different storm simulations, and the rainfall may simply be coincidental. Whether or not the rainfall is the cause of the mismatch between the simulated and measured GICs in this paper, it is reasonable to assume that grounding resistances at substations do not remain constant with varying soil moisture.

6. Discussion and Conclusion

The entire HV power network operating in Ireland and Northern Ireland was modelled for studying GICs. This model includes 400, 275, 220 and 110 kV substations and transmission lines. Substations operating at 220 kV or higher had the correct number, type and DC winding resistances of transformers modelled. Measured grounding resistances were also used for 33 of the substations across Ireland, with the remainder having assigned grounding resistances of 1 Ω . An open-source Python program (<https://doi.org/10.5281/zenodo.1252432>) was written to use all of the available power network information and construct a network model consistent with the *Lehtinen & Pirjola* [1985] method for calculating GICs. The resulting power network model for Ireland is an improvement on the simpler model seen in *Blake et al.* [2016].

The improved power network model was subjected to uniform 1 V km⁻¹ electric fields in a number of sensitivity tests. It was found that apart from a single 400 kV substation in the West of Ireland (Moneypoint), no substation had calculated GICs greater than 40 A. These are lower GIC amplitudes than seen for the same test in other European grids. This is likely due to the network's small size and the ground resistance assumption of 1 Ω .

This 1 Ω assumption for substation grounding resistance was then investigated using uniform electric fields. It was found that different substations were affected to differing degrees by the grounding resistance assumption. For some substations, calculated GIC amplitudes were barely affected when the grounding resistance assumption was changed. In

other substations, the grounding resistance was an important factor for calculated GIC amplitudes. Interestingly, this was found to be true even for some substations that had known, fixed grounding resistance values. One such substation, Moneypoint, had calculated GIC that changed by only 0.7 A when the grounding resistances were changed in the rest of the network. In contrast, the calculated GIC at Rafeen, (another substation with a known grounding resistance) changed by 30 A with the grounding resistance assumption. The calculated GIC at Rafeen could be said to depend on the grounding resistance of the rest of the network, whereas this is not the case for Moneypoint.

It is not immediately clear why this dependence on grounding resistance exists for some substations in the network but not for others. No simple relation was found between the variability in GIC amplitudes (middle row, Figure 9) and the characteristics of the substation elements or connections to the rest of the network. By finding this relation, or alternatively by performing the ground resistance simulation described in Section 4.3 for a network, one can identify substations for which the ground resistivity is a particularly important factor for GIC generation. This could help prioritise which substations should have empirical ground resistances measured in the future.

It was also found that omitting lower-voltage elements of the power network model (in this case 110 kV substations and lines) led to general overestimation of GIC amplitudes in the network model. Those substations which were most affected by including the lower voltage elements were themselves connected to lower voltage substations and lines.

A comparison between the power network model in this paper and the model that appears in *Blake et al.* [2016] can be made, allowing us to reassess the vulnerability of individual substations. In *Blake et al.* [2016], Moneypoint was assigned a grounding resistance of 0.1 Ω , the same assumed value for every substation in that model. In the new network model, Moneypoint now has a grounding resistance value of 0.25 Ω , the lowest in the network. This gives a computed GIC of 114 A for an eastward 1 V km⁻¹ test electric field, a large increase compared to 41 A reported for Moneypoint in *Blake et al.* [2016]. As Moneypoint is Ireland's largest electricity generating substation, these larger GIC estimates are noteworthy.

The 275/220 kV Louth substation is an example of another substation which has to be reassessed with regards to GIC estimates. Previously, modest GICs were calculated for the Louth substation, with a peak of 9 A for a northward-oriented 1 V km⁻¹ test electric field. With the latest network model, the GIC calculated at the Louth substation is now 38 A, second only to Moneypoint. Louth is treated differently in a number of ways in the new network model. As the Louth substation is now known to operate with three different voltages, it is modelled as two separate but spatially close substations (275/220 and 220/110 kV), with a total of seven transformers. These transformers have a lower average resistance than the single transformer used in the previous network model (0.17 Ω versus 0.5 Ω), which may have contributed to the larger GICs, despite the larger ground resistance value of 1 Ω used in the new model. Another difference is the number of connections to the Louth substation. With the addition of the 110 kV substations and lines, Louth now has 10 transmission line connections to other substations, whereas before it had only four. For an eastward directed field, the addition of the 110 kV elements in the network reduces the calculated GIC at Louth significantly (see Figure 6), as is the general trend in the network. For the case of a northward directed field however, the lower voltage elements slightly increase the calculated GIC at Louth. In terms of GICs, Louth is an important substation as it is the only connection between 275 and 220 kV elements, and sees the second largest GICs in the network.

Along with Moneypoint, Louth should be prioritised in future studies on the Irish power network.

The updated model of the Irish power network was used to simulate GICs in the 400/220 kV Woodland substation for five geomagnetic storm events that occurred between 2015 and 2016. The measured GIC at Woodland was replicated with correlation coefficients ranging from 0.43 to 0.68 for the different events. GICs simulated for the August 2015 event underestimated measured GICs at the Woodland substation by a factor of 2.5, despite having the highest correlation coefficient of the events. In the three days prior to the August 2015 event, 60 mm of rain fell near to this substation, saturating the ground. This heavy rainfall may have reduced the substation grounding resistance. A grounding resistance change from 0.5Ω to approximately 0.125Ω at Woodland would account for much of the discrepancy between simulated and measured GIC peaks for this event. This event indicates that terrestrial weather may be an additional factor which can be taken into account for more complete GIC simulations.

While the power network model has been greatly improved by incorporating as much information as was available, assumptions were still made in order to make the model complete. Further information is required to make comprehensive GIC calculations in the future. This includes details on the transformer resistances in the 110 kV substations, and realtime information on the makeup of the power network (to account for elements being powered on and off due to maintenance). Substation grounding information is only known for the 33 of the 274 substations, and as demonstrated, the assumed grounding resistance value can greatly affect GIC calculations at individual substations. If (or when) this information becomes available in the future, it may be the case that our understanding of the vulnerability of different substations will change, as our understanding of the Louth and Moneypoint substations has changed with the latest iteration of the network model.

In addition, the uniform $400 \Omega\text{m}$ Earth model used for the geomagnetic storm event simulations is a significant simplification. As shown in this study, this model was sufficient for replicating measured GIC values in the Woodland substation. However, a uniform Earth model neglects both spatial variations in the surface electric field due to conductive variation, as well as the sea or coastal effect in areas close to shorelines. These can each affect GIC values at substations, and future GIC studies will take advantage of a full 3D Earth model for Ireland from long-period MT measurements. This future model is currently being developed as part of the Space Weather Electromagnetic Database for Ireland (SWEMDI) project, funded by the Geological Survey of Ireland.

Acknowledgments. The results presented in this paper rely on data collected at magnetic observatories. We thank the national institutes that support them and INTERMAGNET for promoting high standards of magnetic observatory practice (www.intermagnet.org). We also acknowledge Armagh Observatory for hosting a magnetometer which contributed to this work. Historical rainfall and soil moisture deficit data for the Dunsany weather station was taken from Met Éireann's website (www.met.ie). Calculated and measured GICs for the events in this paper are given as supporting information. This research was funded by the Irish Research Council's Enterprise Partnership Scheme between Trinity College Dublin and Eir-Grid Plc. We thank the Irish Research Council for support for Seán Blake and Joan Campanyà. This research benefited from a Royal Society/Royal Irish Academy International Exchange grant (IE150685). Ciarán Beggan, Gemma Richardson and Alan Thomson were supported by Natural Environment Research Council grant NE/P017231/1 'Space Weather Impacts on Ground-based Systems (SWIGS)'.

References

- Amm, O., Viljanen, A., (1999), Ionospheric disturbance magnetic field continuation from the ground to the ionosphere using spherical elementary current systems, *Earth Planets Space*, 51, 431–440, <https://doi.org/10.1186/BF03352247>
- Bailey, R.L., Halbedl, T.S., Schattauer, I., Romer, A., Achleitner, G., Beggan, C.D., Wetztergom, V., Egli, R. and Leonhardt, R., (2017), Modelling geomagnetically induced currents in midlatitude Central Europe using a thin-sheet approach, *Ann. Geophys.*, 35, 751–761, <https://doi.org/10.5194/angeo-35-751-2017>
- Barbosa, C.S., Caraballo, R., Alves, L.R., Hartmann, G.A., Beggan, C.D., Viljanen, A., Ngwira, C.M., Papa, A.R.R. and Pirjola, R.J., (2017), The Tsallis statistical distribution applied to geomagnetically induced currents, *Space Weather*, 15, 1542–7390, <https://doi.org/10.1002/2017SW001631>
- Bedrosian, P. and Love, J., (2015), Mapping geoelectric fields during magnetic storms: Synthetic analysis of empirical United States impedances, *Space Weather*, 42, 10, 160–170, <https://doi.org/10.1002/2015GL066636>
- Beggan, C. D., Beamish, D., Richards, A., Kelly, G. S. and Thomson, A. W. P., (2013), Prediction of extreme geomagnetically induced currents in the UK high-voltage network, *Space Weather*, 11, 407–419, <https://doi.org/10.1002/swe.20065>
- Beggan, C. D. (2015), Sensitivity of geomagnetically induced currents to varying auroral electrojet and conductivity models, *Earth, Planets and Space*, 67, <https://doi.org/10.1186/s40623-014-0168-9>
- Blake, S. P., Gallagher, P. T., McCauley, J., Jones, A. G., Hogg, C., Campanyà, J., Beggan, C. D., Thomson, A. W. P., Kelly, G. S. and Bell, D., (2016), Geomagnetically Induced Currents in the Irish Power Network During Geomagnetic Storms, *Space Weather*, 14, 1136–1154 <https://doi.org/10.1002/2016SW001534>
- Bolduc, L., (2002), GIC observations and studies in the Hydro-Quebec power system, *J. Atmos. Sol.-Terr. Phys.*, 64, 1793–1802, [https://doi.org/10.1016/S1364-6826\(02\)00128-1](https://doi.org/10.1016/S1364-6826(02)00128-1)
- Boteler, D. H., Shier, R.M., Watanabe, T. and Horita, R.E., (1989), Effects of Geomagnetically Induced Currents in the B.C. Hydro 500 kV System, *IEEE Trans. Power Delivery*, 4, 818–823, <https://doi.org/10.1109/61.19275>
- Boteler, D. H., Pirjola, R. J., (2014), Comparison of methods for modelling geomagnetically induced currents, *Ann. Geophys.*, 32, 1177–1187, <https://doi.org/10.5194/angeo-32-1177-2014>
- Boteler, D.H. and Pirjola, R. (2016), Modeling Geomagnetically Induced Currents, *Space Weather*, 15, <https://doi.org/10.1002/2016SW001499>
- Eroshenko, E.A., Belov, A.V., Boteler, D., Gaidash, S.P., Lobkov, S.L., Pirjola, R. and Trichtchenko, L., (2010), Effects of strong geomagnetic storms on Northern railways in Russia, *Adv. in Space Res.*, 46, 1102–1110, <https://doi.org/10.1016/j.asr.2010.05.017>
- Gaunt, C. T. and Coetzee, G., (2007), Transformer failures in regions incorrectly considered to have low GIC-risk, *IEEE, Power Tech*, 4, 27, <https://doi.org/10.1109/PCT.2007.4538419>
- Gaunt, C. T., (2014), Reducing uncertainty - responses for electricity utilities to severe solar storms, *J. Space Weather Space Clim.*, 4, 27, <https://doi.org/10.1109/PCT.2007.4538419>
- Guo, S.-X., Liu, L.-G., Pirjola, R.J., Wang, K.-R. and Dong, B., (2015), Impact of the EHV Power System on Geomagnetically Induced Currents in the UHV Power System, *IEEE Trans. Power Delivery*, 30, 2163–2170, <https://doi.org/10.1109/TPWRD.2014.2381248>
- Horton, R., Boteler, D., Overbye, T.J., Pirjola, R., Dugan, R.C., (2012), A test case for the calculation of geomagnetically induced currents, *IEEE Trans. Power Del.*, 27, 2368–2373, <https://doi.org/10.1109/TPWRD.2012.2206407>
- Kelly, G., Viljanen, A., Beggan, C.D. and Thomson, A.W.P., (2017), Understanding GIC in the UK and French high-voltage transmission systems during severe magnetic storms, *Space Weather*, 15, 99–114, <https://doi.org/10.1002/2016SW001469>
- Koen, J. and Gaunt, T., (2003), Geomagnetically Induced Currents in the Southern African Electricity Transmission Network, *IEEE Bologna PowerTech Conference*, <https://doi.org/10.1109/PTC.2003.1304165>
- Lehtinen, M. and Pirjola, R. (1985), Currents produced in earthed conductor networks by geomagnetically-induced electric fields, *Ann. Geophys.*, 3, 479–484
- Love, J., Joshua Rigler, E., Pulkkinen, A., and Riley, P., (2015), On the lognormality of historical magnetic storm intensity statistics: Implications for extreme-event probabilities, *Geophysical Research Letters*, 42, 6544–6553, <https://doi.org/10.1002/2015GL064842>
- MacManus D. H., Rodger, C.J., Dalzell, M., Thomson, A.W.P., Clilverd, M.A., Petersen, T., Wolf, M.M., Thomson, N.R. and T. Divett (2017), Long-term geomagnetically induced current observations in New Zealand: Earth return corrections and geomagnetic field driver, *Space Weather*, 15, 1542–7390, <https://doi.org/10.1002/2017SW001635>
- Marshall, R.A., Gorniak, H., Van Der Walt, T., Waters, C.L., Sciffer, M.D., Miller, M., Dalzell, M., Daly, T., Pouferis, G., Hesse, G. and Wilkinson, P., (2013), Observations of geomagnetically induced currents in the Australian power network, *Space Weather*, 11, 6–16, <https://doi.org/10.1029/2012SW000849>
- Matandirotya, E., Cilliers, P. J., Van Zyl, R. R., Oyedokun, D.T. and de Villiers, J., (2016), Differential magnetometer method applied to measurement of geomagnetically induced currents in Southern African power networks, *Space Weather*, 14, 221–232, <https://doi.org/10.1029/2012SW000849>
- Myllys, M., Viljanen, A., Rui, O. A. and Magne Ohnstad, T., (2014), Geomagnetically induced currents in Norway: the northernmost high-voltage power grid in the world, *J. Space Weather Space Clim.*, 4, 27, <https://doi.org/10.1051/swsc/2014007>
- Ngwira, C. M., McKinnell, L. and Cilliers, P. J., (2011), Geomagnetic activity indicators for geomagnetically induced current studies in South Africa, *Adv. Space Res.*, 48, 529–534, <https://doi.org/10.1016/j.asr.2011.03.042>
- Pirjola, R. (2000), Geomagnetically induced currents during magnetic storms, *IEEE Trans. Plasma Sci*, 28, 1867–1873, <https://doi.org/10.1109/27.902215>
- Pirjola, R. (2001), Review on the calculation of surface electric and magnetic fields and of geomagnetically induced currents in ground-based technological systems, *Surveys in Geophysics*, 23, 71–90, <https://doi.org/10.1023/A:1014816009303>
- Pirjola, R., (2005), Effects of space weather on high-latitude ground systems, *Adv. Space Res.*, 36, 2231–2240, <https://doi.org/10.1109/27.902215>
- Pulkkinen, A., Viljanen, A., Pajunpää, K. and Pirjola, R., (2001), Recordings and occurrence of geomagnetically induced currents in the Finnish natural gas pipeline network, *J. Appl. Geophys.*, 48, 219–231, [https://doi.org/10.1016/S0926-9851\(01\)00108-2](https://doi.org/10.1016/S0926-9851(01)00108-2)
- Pulkkinen, A., Bernabeu, E., Eichner, J., Beggan, C., Thomson, A.W.P., (2012), Generation of 100-year geomagnetically induced current scenarios, *Space Weather*, 10, <https://doi.org/10.1029/2011SW000750>
- Thomson, A. W. P., McKay, A. J., Clarke, E., Reay and S. J., (2005), Surface electric fields and geomagnetically induced currents in the Scottish Power grid during the 30 October 2003 geomagnetic storm, *Space Weather*, 3, <https://doi.org/10.1029/2005SW000156>

- Torta, J.M., Marsal, S. and Quintana, M., (2014), Assessing the hazard from geomagnetically induced currents to the entire high-voltage power network in Spain, *Earth, Planets and Space*, *66*, 87 <https://doi.org/10.1186/1880-5981-66-87>
- Torta, J.M., Marcuello, A., Campanyà, J., Marsal, S., Queralt, P. and Ledo, J., (2017), Improving the modeling of geomagnetically induced currents in Spain, *Space Weather*, *15*, 691–703, <https://doi.org/10.1002/2017SW001628>
- Viljanen, A. and Pirjola, R., (1994), Geomagnetically induced currents in the Finnish high-voltage power system, *Surv. Geophys.*, *15*, 383–408, <https://doi.org/10.1007/BF00665999>
- Wei, L. H., Homeier, N. and Gannon, L., (2013), Surface electric fields for North America during historical geomagnetic storms, *Space Weather*, *11*, 451–462, <https://doi.org/10.1002/swe.20073>
- Wik, M., Viljanen, A., Pirjola, R., Pulkkinen, A., Wintoft, P. and Lundstedt, H., (2008), Calculation of geomagnetically induced currents in the 400 kV power grid in southern Sweden, *Space Weather*, *6*, 7005, <https://doi.org/10.1029/2007SW000343>
- Zhang, J.J., Wang, C., Sun, T. R., Liu, C.M. and Wang, K. R., (2015), GIC due to storm sudden commencement in low-latitude high-voltage power network in China: Observation and Simulation, *Space Weather*, *13*, 643–655, <https://doi.org/10.1029/2007SW000343>

Corresponding author: Seán P. Blake, School of Physics, Trinity College Dublin, Dublin 2, Ireland (blakese@tcd.ie)