

Sector coupling via hydrogen to lower the cost of energy system decarbonization

Guannan He^{*†}, Dharik S. Mallapragada[†], Abhishek Bose[†],
Clara F. Heuberger[‡], Emre Gençer[†]

Abstract: There is growing interest in hydrogen (H_2) use for long-duration energy storage in a future electric grid dominated by variable renewable energy (VRE) resources. Modelling the role of H_2 as grid-scale energy storage, often referred as “power-to-gas-to-power (P2G2P)” overlooks the cost-sharing and emission benefits from using the deployed H_2 production and storage assets to also supply H_2 for decarbonizing other end-use sectors where direct electrification may be challenged. Here, we develop a generalized modelling framework for co-optimizing energy infrastructure investment and operation across power and transportation sectors and the supply chains of electricity and H_2 , while accounting for spatio-temporal variations in energy demand and supply. Applying this sector-coupling framework to the U.S. Northeast under a range of technology cost and carbon price scenarios, we find a greater value of power-to- H_2 (P2G) versus P2G2P routes. P2G provides flexible demand response, while the extra cost and efficiency penalties of P2G2P routes make the solution less attractive for grid balancing. The effects of sector-coupling are significant, boosting renewable energy generation by 12-55% with both increased capacities and reduced curtailments and reducing the total system cost (or levelized costs of energy) by 6-14% under 96% decarbonization scenarios. Both the cost savings and emission reductions from sector coupling increase with H_2 demand for other end-uses, more than doubling for a 96% decarbonization scenario as H_2 demand quadruples. Moreover, we found that the deployment of carbon capture and storage is more cost-effective in the H_2 sector because of the lower cost and higher utilization rate. These findings highlight the importance of using an integrated multi-sector energy system framework with multiple energy vectors in planning energy system decarbonization pathways.

1 Introduction

As the greenhouse gas (GHG) emission intensity of electricity generation in various regions has declined with continued adoption of wind and solar generation, there is growing interest to pursue electrification-centric decarbonization strategies for other end-use sectors where emissions reduction has been sluggish. Yet, direct electrification may be practically challenged for some of these end-uses, such as in the case of heavy-duty transport where volumetric energy density and refueling time are key drivers for fuel choice. In this context, there is renewed interest in hydrogen (H_2) and H_2 derived carriers for their role in the decarbonization of difficult-to-electrify end-uses in transport, building and industrial sectors. In addition to the plurality of its end-uses, the multiple technology choices across

*Corresponding author: gnhe@mit.edu

[†]MIT Energy Initiative, Massachusetts Institute of Technology, Cambridge, MA, USA.

[‡]Shell Global Solutions International B.V., Shell Technology Centre Amsterdam, 1031 HW Amsterdam, Netherlands.

the H₂ supply chain, from production, storage, transport and end-use, make its assessment a complex systems problem. Here, we propose a scalable decision-support framework for assessing the impact of technology and policy choices on the decarbonization of power sector in conjunction with other end-use sectors. This framework provides a systematic way to study the role and impact of H₂-based technology pathways in a future low-carbon, integrated energy system at a regional/national scale.

Recent renewed interest in H₂ has been partially intrigued by expectations of a future renewables-dominant electric grid and cost declines for water electrolyzers¹, both of which raise the prospect of electrolytic H₂ becoming cost-competitive with fossil fuel-based pathways, such as natural gas reforming^{2,3}. Besides the economics of electrolytic H₂ production^{4,5}, many studies have focused on evaluating the economics of H₂-based energy storage (power-to-gas-to-power, P2G2P), which relies on electrolysis for H₂ production, under deep decarbonization scenarios. Some of the studies in this area focus on: 1) comparing the cost-effectiveness of P2G2P with other types of long-duration energy storage options like pumped hydro and compressed air energy storage for VRE integration, from a marginal deployment perspective (i.e. electricity price taker)⁶⁻⁸, 2) assessing least-cost investment and operation of H₂ storage and short-term energy storage like lithium-ion batteries in the context of a VRE dominant power systems⁸⁻¹¹, and 3) the operational scheduling of H₂ storage in power markets^{12,13}. Although these studies provide useful insights to compare different energy storage technologies from the perspective of the power sector, they overlook the multiple potential uses of H₂ (or H₂ derived carriers) outside the power sector and the associated cost-savings resulting from sharing infrastructure costs across these uses. Consequently, in the absence of modelling sector-coupling interactions, the role of H₂ storage may be under-valued as compared to other long-duration storage technologies in future low-carbon power grids¹⁴.

With the above motivation, a number of studies have expanded the scope of traditional power sector capacity expansion models (CEM) to endogenize investment decisions in end-use technologies, which includes some parts of the H₂ supply chain, notably electrolytic H₂ production. These studies highlight the potential for flexible electricity consumption in other end-uses to partially substitute the need for energy storage in the electricity sector and alter generation mix in the power sector towards increasing VRE deployment¹⁵⁻¹⁸. While these studies are inspiring, the interactions between the H₂ supply chain and the power sector, in many of the studies, exclude critical components in the H₂ supply chain. For example, some studies ignore the possibility of natural gas-based H₂ production from steam methane reformer (SMR) with or without carbon capture and storage (CCS)¹⁹⁻²¹, which is the dominant mode of H₂ production today. Second, most literature either do not consider some modes of H₂ transmission^{19,22,23} or when it is included, the modelling of H₂ transmission is oversimplified by setting fixed lower and upper H₂ flow limits for each route^{20-22,24}. These approaches may not capture the potential benefits of both H₂ pipeline and trucks serving as transmission and storage assets simultaneously. Notably, H₂ trucks can function as mobile storage, which has been shown to provide greater operational flexibility than stationary storage²⁵. Moreover, the existing literature does not reveal a clear evolution of the role of H₂ in energy systems as the costs of H₂ infrastructure decline with increased adoption or technology innovation.

This paper develops a high-fidelity electricity-H₂ (e-H₂) capacity planning model to study the role of H₂ in low-carbon energy systems, the sector-coupling effects, and the trade-offs between various technology options across the entire bulk supply chain* of both energy carriers. For a pre-defined set of electricity and H₂ demand scenarios, the model determines the least-cost technology mix across the power and H₂ sectors while adhering to operational constraints of the power and H₂ supply chains

*The last-mile distribution networks of electricity and H₂ are not considered in the e-H₂ model.

at an hourly resolution along with the spatiotemporal variations in VRE supply and energy demands.

Applying the e-H₂ model to the U.S. Northeast energy system for a range of CO₂ price (up to \$1000/tonne CO₂), H₂ demand and technology cost scenarios, we find electrolytic H₂ supply to be cost-effective under moderate carbon policy (\$50/tonne or greater) and/or electrolyzer capital cost of \$500/kW or lower. The interactions between the power and H₂ supply chains increase investments in VRE generation and reduce investments in dispatchable resources like battery storage and natural gas generation in the power sector, which results in reducing the total system cost by up to 14% in the most carbon constrained scenarios analyzed here. Notably, as opposed to most literature that emphasizes the role for H₂ in the power sector as grid-scale energy storage, i.e. P2G2P^{6,6-9,12,13}, we find a greater role for H₂ to serve as a flexible demand response resource based on the use of electrolysis in conjunction with H₂ storage. This finding, stemming from the reduced capital cost and energy efficiency of the P2G path, is found to be valid across a range of CO₂ price scenarios as well as capital cost assumptions for electrolysis and G2P generation. Finally, we find that the role for natural gas in a future energy system is predominantly in the H₂ supply chain and this role remains robust to increasing CO₂ prices because of the relative cost-competitiveness of CCS-equipped natural gas based H₂ production vs. electrolytic H₂ production.

2 Methods

2.1 Model overview

The developed e-H₂ planning model evaluates investments and operations across the bulk supply chain for electricity and H₂, including production, storage, transmission, conditioning (compression/liquefaction in the case of H₂) and demand as shown in Figure 1. The model determines the least-cost mix of electricity and H₂ production, storage, and transmission infrastructures to meet power and H₂ demands subject to a variety of operational and policy constraints. The developed model can incorporate a wide range of power and H₂ technology options, including VRE generation, carbon capture and storage (CCS) applied to power and H₂ generation, and truck (gaseous and liquid) and pipelines for H₂ transportation. The power systems and H₂ supply chain are coupled through electrolysis and power generation technologies fueled by H₂, as well as electricity consumption in H₂ compression/liquefaction. The operational constraints of the model, implemented at an hourly resolution, include: a) supply-demand balance for H₂ and electricity at each zone, b) inventory balance constraints for stationary storage technologies, c) inventory balance constraints related to trucks at a given location (any of the zones and routes, arriving, departing or in transit) and for different states (empty and full), and d) linearized unit commitment for conventional thermal power generation technologies and natural gas based H₂ production technologies. We model these operational constraints at an hourly resolution over a set of representative weeks that are selected from applying time-series clustering to annual demand and VRE resource profile data²⁶, to approximate annual system operations. The time-domain reduction preserves chronological variability of power and H₂ demands and VRE resource availability and the correlations among them, while reducing the model size to still be computationally tractable. Process level CO₂ emissions are penalized with a price on emissions that is applied to both sectors. The details of the power system planning model and the H₂ supply chain model can be referred to Jenkins and Sepulveda²⁷ and He et al.²⁵, respectively. The codes and data are available on GitHub²⁸.

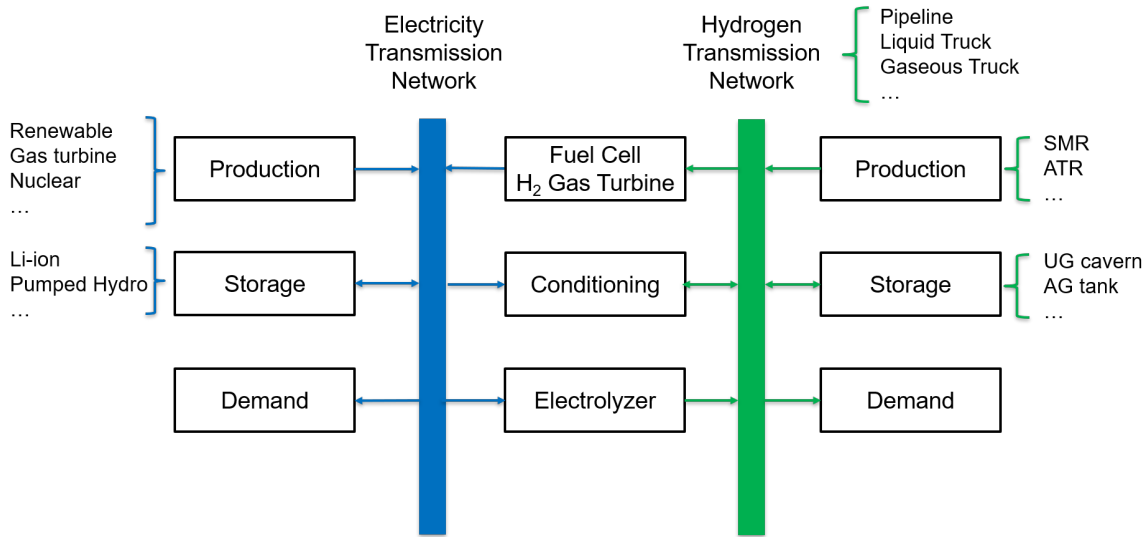


Figure 1: Superstructure of the coupled model of power systems and H₂ supply chain.

2.2 Case study setup

We illustrate the value of the proposed model using a case study where we assess electricity and H₂ infrastructure outcomes for the U.S. Northeast region under a variety of demand, technology and CO₂ price scenarios for 2050. We model a greenfield 2050 system with the exception of existing inter-zonal transmission and hydro power generation (both domestic and imports from Canada) and pumped hydro storage capacity in the region. The U.S. Northeast region is represented in the model as six zones, shown in Figure 2(a), according to the zonal boundaries adopted from the Integrated Planning Model²⁹. An additional seventh zone is included with zero energy demand to represent imports of Canadian hydro power generation that is limited by power and transmission capacity constraints. States in the Independent System Operator New England (ISO-NE) are split into zone 1-3 and the New York Independent System Operator (NYISO) is split into zone 4-6 based on their load share split in 2012. As zone 4 is heavily urbanized, we do not allow centralized H₂ generation (SMR or SMR with CCS) to be built in that zone, while distributed electrolyzers are allowed.

Electricity demand data (excluding electrolysis) are based on 2018 NREL electrification futures study load projection for 2050³⁰, with assumed business-as-usual technology advancement and reference electrification. The H₂ demands for each zone are developed based on available fuel consumption data and hourly refueling profiles³¹ for both light- and heavy-duty fuel cell electric vehicles (FCEV) and the relative penetration of FCEV. In the base case, we assume a 20% FCEV penetration for the transport sector in the U.S. Northeast. Light-duty vehicle (LDV) fuel consumption for each zone is estimated using state-level gasoline consumption data for 2017 from the the U.S. Energy Information Administration, which is then converted to a H₂ consumption equivalent based on the relative efficiency of FCEV to gasoline internal combustion vehicle. Heavy-duty vehicle (HDV) demand projections are based on the National Freight Analysis Framework³². The zonal average demands of power and H₂ are shown in Figure 2(b).

For the power system, we include thermal, renewable, nuclear generation, and storage resources,

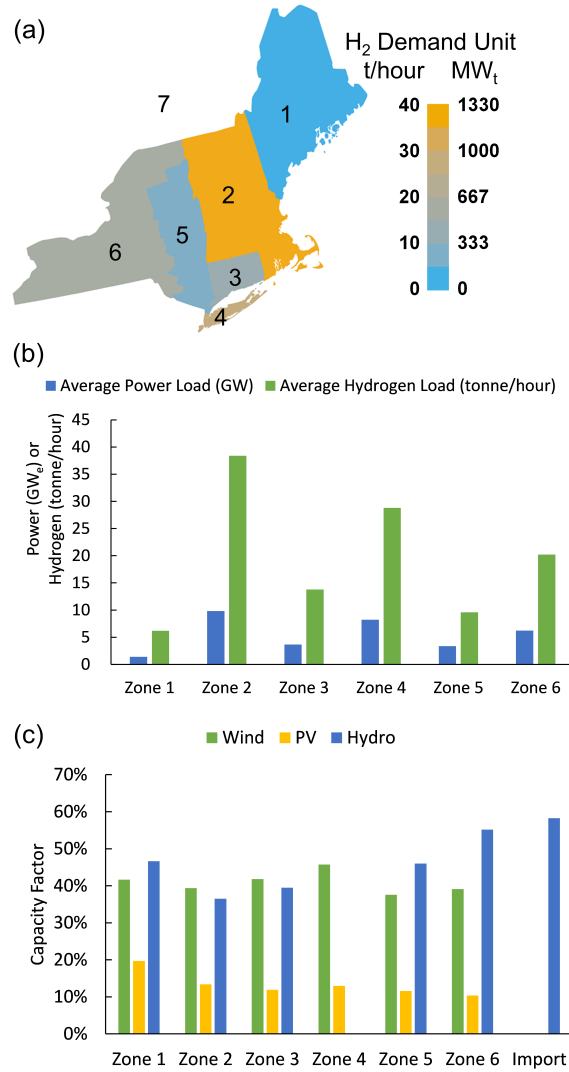


Figure 2: Demand and renewable energy resources distributions in the U.S. Northeast. H₂ demands are estimated based on transportation fuel consumption data in 2017, and electricity demands are projections for 2050. (a) Geographical zone classification for U.S. North-East and average H₂ demands for each zone; (b) Average power and H₂ demands for each zone; (c) Average capacity factors of wind, PV, and hydro for each zone.

whose main parameters are derived from the NREL annual technology baselines³³ and the EIA Annual Energy Outlook 2018³⁴ for the year 2050, as summarized in Table 1. As no new coal plants will likely be built in this region, we consider the options of natural gas combined cycle gas turbine (CCGT), open cycle gas turbine, as well as CCGT with CCS. The VRE resource cost and availability in each zone are represented by supply curves³⁵ to characterize different possible sites with specific resource profile, maximum potential capacity, and average cost of interconnection. We use three supply curves per zone for onshore wind and one supply curve per zone for PV. Offshore wind is included with no capacity limits and single resource profile for zone 2 and zone 4 based on sampling

Table 1: Major Parameters for generation and storage technologies in the power sector for the year 2050. CAPEX: capital cost; FOM: fixed operational and maintenance cost; VOM: fixed operational and maintenance cost.

Technology	Onshore Wind	Offshore Wind	Utility PV	Distributed PV	Li-ion Battery	Pumped Hydro	CCGT	OCGT	CCGT w/ CCS	Nuclear
Power CAPEX (10^3 \$/MW)	1,086	1,902	724	1,083	120	1,966	817	816	1798	6126
Energy CAPEX (10^3 \$/MWh)	-	-	-	-	126	-	-	-	-	-
FOM (10^3 \$/MW-year)	35	48	11	9	2	41	11	12	34	105
VOM (\$/MWh)	-	-	-	-	-	-	3	7	7	2
Heat Rate (MMBTU/MWh)	-	-	-	-	-	-	6	9	7	10
Round-trip Efficiency	-	-	-	-	85%	80%	-	-	-	-
Lifetime (years)	30	30	30	30	15	50	30	30	30	30

sites from the NREL Wind Toolkit that overlaps with the areas. Distributed PV is modelled with a separate resource profile per zone and minimum build requirement to meet 2029 projections by NYISO and ISONE. For hydropower, we consider hydro reservoir, hydro run-of-river, and Canadian hydro and extrapolate hourly generation from historical monthly output. The average capacity factors of VRE resources are shown in Figure 2(c). Lithium-ion battery storage and pumped hydro storage are considered for electrical energy storage. The initial power transfer capacities between each zone are developed from the integrated planning model (IPM) model documentation²⁹ and are tabulated in Table S2 in the SI, while transmission expansion costs are listed in Table S1.

Table 2: Major parameters for H₂ generation and G2P technologies. CAPEX: capital cost.

	Electrolysis ³⁶	SMR ³⁶	SMR w/ CCS ³⁶	Fuel Cell ³⁷	CCGT-H ₂ ³⁸
Unit CAPEX	450 \$/kW _e	910 \$/kW _{H₂}	1,280 \$/kW _{H₂}	1,264 \$/kW _e	1,171 \$/kW _e
Lifetime (years)	10	25	25	10	25
Efficiency (LHV)	74%	76%	69%	60%	65%
Emissions Intensity (tonne CO ₂ /tonne H ₂)	0	8.9	1.0	0	0

Table 3: Major parameters for H₂ transmission and storage technologies. CAPEX: capital cost; OPEX: operational cost; A: cost and electricity consumption proportional to pipeline length; B: cost and electricity consumption irrelevant to pipeline length; C: truck and tank storage compression related costs and electricity consumption.

	Pipeline	Gas Tank	Liquid Truck	Gas Truck
Unit Capacity	0.3 tonne/mile	0.3 tonne	4 tonne	0.3 tonne
Capital Cost	2.8 M\$/mile ^{39,40}	0.58 M\$/unit ⁴¹	0.8 M\$/unit ⁴¹	0.3 M\$/unit ⁴¹
Compression CAPEX (A) (\$/mile-unit)	700 ^{42,43}	0	0	0
Compression CAPEX (B) (\$/unit)	0.75	0	0	0
Compression Electricity (A) (MWh/tonne-mile)	1	0	0	0
Compression Electricity (B) (MWh/tonne)	1	0	0	0
Unit OPEX (\$/mile)	0	0	1.5	1.5
Compression CAPEX (C) (\$/(tonne/hr))	0	0.5 ⁴¹	32 ⁴¹	1.5 ⁴¹
Compression Electricity (C) (MWh/tonne)	0	2 ^{42,43}	11 ^{42,43}	1 ^{42,43}
Boiloff Rate	0	0	3%	0

The main cost and performance parameters of H₂ generation and G2P technologies are summarized in Table 2, which include electrolysis and natural gas fueled SMR, with and without CCS (90% capture), stationary fuel cell, and H₂ fueled CCGT. We model trucks and pipelines as the key modes

of H₂ transmission, with the distance traveled in each case measured by the distances between the polygon centroids of each zone. At the same time, we also model them as potential storage resources, in tandem with stationary H₂ storage. We model the potential deployment of two types of trucks, based on handling H₂ as a cryogenic liquid or compressed gas, while the pipelines are considered as multiples of an 8" pipeline being built across different geographies. We do not consider geological H₂ storage as its availability in U.S Northeast region is uncertain⁴⁴. The parameters of transmission and storage technologies are summarized in Table 3. The interfaces of each of these transmission and storage technologies with H₂ generation and demand require compression and/or liquefaction depending on the state of H₂. The compression/liquefaction costs comprise of the capital cost of the equipment as well as the operational costs from electricity consumption, which are also provided in Table 3.

2.3 Modelling approximations

To maintain computational tractability with the expanded scope of investment and operational decisions considered here, we implement the following approximations, whose potential impacts on model outcomes are described below. Similar to other power sector CEM studies^{6,35}, we approximate annual hourly system operations based on modelling operations of the system over 30 representative weeks, selected using K-means based clustering techniques, described elsewhere²⁶, in conjunction with heuristics regarding so-called "extreme" weeks applied to 7-years (2007-2013) of load and VRE availability data. Because representative periods identified via clustering techniques are known to emphasize typical weeks over extreme weeks, we a priori identified weeks in the data set with the highest load and lowest average capacity factors and added them to the set of 30 representative weeks to be considered by the model.

Some of the technologies considered in the power and H₂ supply chain, namely thermal power plants, H₂ pipelines and SMR based H₂ production facilities, exhibit economies of scale and limited operational flexibility, which typically requires using binary or integer variables to represent their investment and operations. However, because in nearly all scenarios, we are deploying more than one unit of each technology, the approximation of modelling investment in these technologies as continuous rather integer variables is relatively small. Prior modelling work^{45,46} has shown that such an approximation in practice results in a relatively small error in the overall dispatch and objective function while leading to large reductions in computational run times. In the case of SMRs, which represent centralized H₂ production sources, we estimated that the additional H₂ storage cost (pressurized gas tank) needed to make SMR output flexible only accounts for approximately 2% of the capital cost of SMR with CCS[†]. Therefore, we assume SMR is as flexible as electrolysis in this study.

[†] Assuming that a 0.5 hour gas storage is installed to buffer SMR starting up or shutting down, then the capital cost of storage for SMR of one tonne/hour is \$1.9 million (\$0.58 million for a 0.3 tonne unit), which is 2% of the capital cost of SMR with CCS (\$391 million for a 9.2 tonne/hour unit). The electricity operating cost is negligible when SMR is ramping down (charging and compressing), as the electricity must be very cheap at the time.

3 Results

3.1 Optimal technology mixes

Fig. 3 presents the optimal technology mixes with different CO₂ prices and electrolyzer capital costs. The scenarios with 0, \$50/tonne, \$100/tonne, and \$1000/tonne CO₂ prices correspond to approximately 100%, 40%, 30%, and 3% CO₂ emissions compared to no CO₂ price scenario and represent no carbon policy, moderate carbon policy, and deep decarbonization scenarios, respectively. Here we highlight several observations from Fig. 3: First, from Fig. 3 (a) and (b), we can find that as the CO₂ price increases, the H₂ generation switches from central SMR, to SMR with CCS, and then to electrolyzer, accompanied by the power generation shifting away from CCGT to wind and solar. Second, electrolyzer is only cost-effective for deployment at lower CO₂ prices and/or reduced capital costs compared to 2020 costs levels for multi-MW systems, which is near \$800 to \$1000/kW³⁶. Thirdly, although CO₂ price increase favors an increasing share of H₂ generation from electrolyzer and renewable power generation, it has a relatively small impact on the installed capacities of natural-gas-fueled H₂ and power generation (SMR and CCGT). CCGT and SMR with CCS remain cost-effective sources of flexible power and H₂ supply for time periods when the lack of VRE generation result in scarcity pricing in the power system for all CO₂ price scenarios analyzed here (see Fig. 3 (c) and (d)). Fourthly, we see CCS utilized at lower CO₂ prices in the H₂ sector (less than \$50/tonne) than in the power sector (greater than \$100/tonne), comparing Fig. 3 (c) and (d), which implies that if CCS resource availability is limited, equipping SMR with CCS will be of higher priority. This finding is a result of lower cost of CO₂ capture at SMR facilities than CCGT power plants[‡] as well as the higher utilization factor of SMR-CCS facilities vs. CCGT-CCS facilities in the analyzed scenarios. For example, in the scenario with \$300/kW electrolysis and \$100/tonne CO₂ price, the capacity factor is 18% for CCGT, while 64% for SMR with CCS. Lastly, we find from Fig. 3 (e) that H₂ storage, both stationary and mobile, accounts for the majority of storage resources in no and moderate carbon policy scenarios, while the requirement for electrical storage increases with higher VRE penetration in the power sector. Overall, in the future energy system in the U.S. Northeast, we find that natural gas could play a key role as a flexible resource and electrolytic H₂ supply will be cost-effective with moderate carbon policy (\$50/tonne or greater) and/or electrolyzer capital cost reduction (\$500/kW or lower).

3.2 Sector coupling effects

When the power and H₂ sectors are tightly coupled through electrolysis or H₂-based power generation, the operational flexibility resources in the H₂ sector can support VRE integration in the power sector, leading to overall system cost reductions. Fig. 4 demonstrates how the two sectors coordinate with each other in a representative week for the scenario with \$300/kW electrolyzer and \$100/tonne CO₂ price. As shown in Fig. 4, electrolyzer is the main H₂ supply source when VRE supply is abundant, such as hour 0 to 50. Once VRE is in short supply relative to baseline electricity demand (hour 60 to 80), the SMR, stationary gas storage, and gas and liquid trucks are utilized to meet H₂ demands.

How much is the benefit of coupling power and H₂ sectors? To quantify the impact of sector coupling, we compare the optimal power sector generation mixes with and without the options of conversion between power and H₂ (electrolysis and H₂-based power generation). In the latter case, H₂

[‡]The levelized CO₂ abatement cost of CO₂ capture facility is approximately \$40/tonne at SMR and \$110/tonne at CCGT, given the cost assumptions in the study.

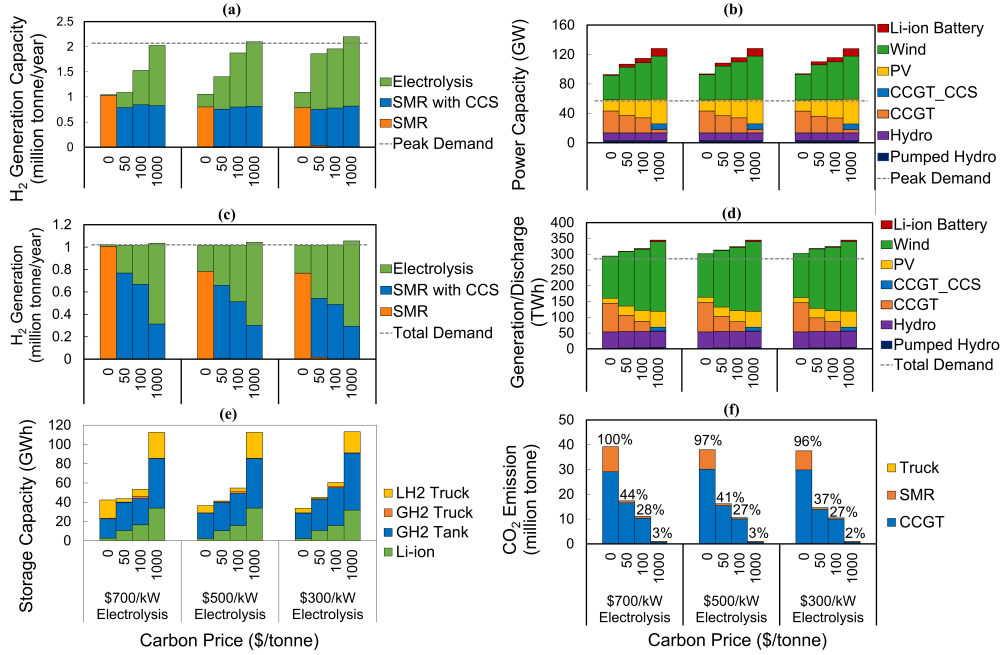


Figure 3: Optimal generation and storage capacity mixes and CO₂ emissions in the power and H₂ sectors under various CO₂ price and electrolysis cost scenarios in U.S. Northeast. Technologies that are not cost-competitive are not shown. (a) H₂ generation capacity; (b) Power generation capacity; (c) H₂ generation per year; (d) Electricity generation or electrical storage energy discharge per year; (e) Energy storage capacity in power and H₂ sectors; (f) CO₂ emissions in power and H₂ sectors. SMR: steam methane reformer; LH2: Liquid H₂; GH2: Gaseous H₂.

production would exclusively rely on natural gas based pathways[§]. From Fig. 5 (a), we can observe that the power and H₂ interactions (mainly through electrolysis) boost VRE generation (as well as VRE capacities, see Figure S3 (a)) in the power sector, reduce VRE curtailment (see Figure S3 (b)) and reduce the need for dispatchable resources like CCGT and battery storage. This boosting effect grows as the share of electrolyzer in the H₂ supply chain increases, due to either increasing CO₂ price and/or increasing H₂ demand. In the deep decarbonization scenarios with total H₂ demands equivalent to 20% and 80% FCEV penetration, the total VRE generation increases by 12% and 55%, and the VRE curtailment reduces by 3%-5% (see Figure S3 (b)), respectively.

As a result of reduced need in dispatchable power resources and cheaper electrolytic H₂ production, we see cost savings from sector coupling in Fig. 5 (b), increasing with CO₂ price and H₂ demand and approaching 14% of the total cost[¶] of the two sectors in the decoupled model in the deep decarbonization scenario. Sector-coupling also leads to greater CO₂ emissions reduction (up to 25% of the emission of the case with \$0/tonne CO₂, \$300/kW electrolyzer, and 20% FCEV penetration) than the case without coupling, owing to the increased penetration of VRE generation in the power

[§]Electricity consumption by conditioning (compression and liquefaction) is still supplied by the power sector, and its cost is accounted in the same way as the coupled case with conversion between power and H₂.

[¶]The levelized costs of electricity and H₂ reduce by the same rate, if the cost savings are proportionally allocated between the power and H₂ sectors.

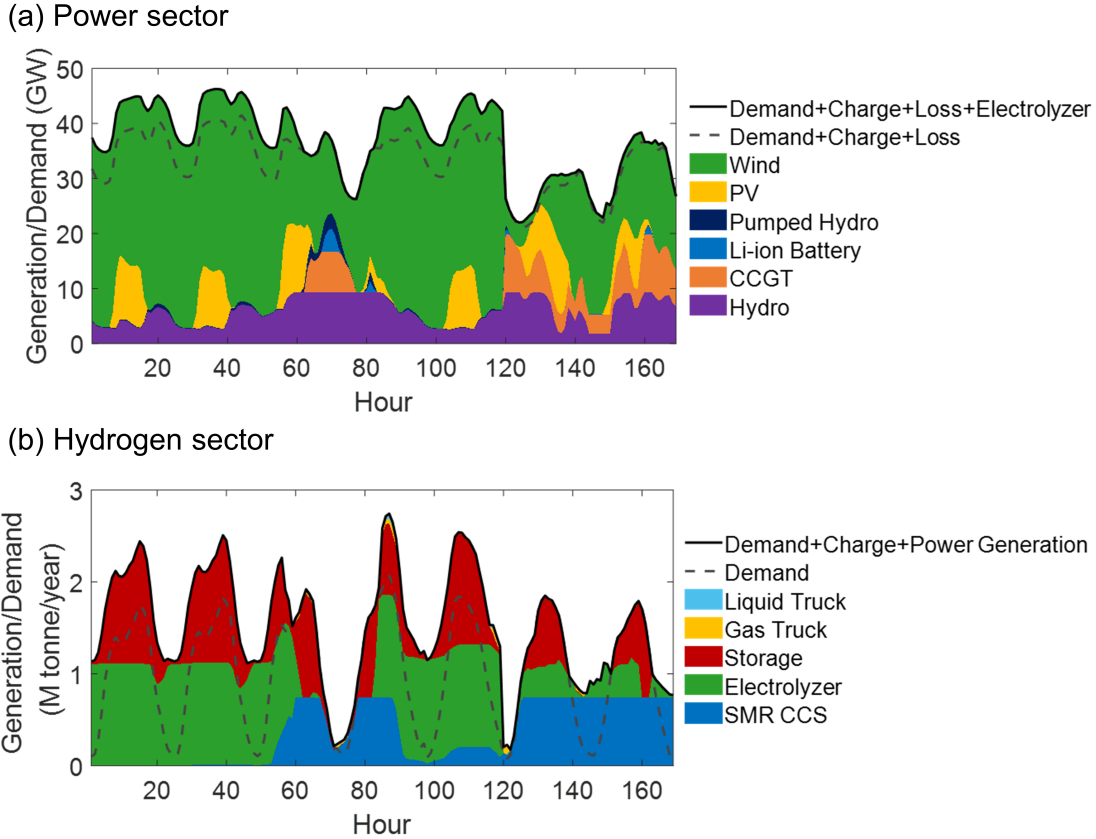



Figure 4: Generation and demand profiles in the power and H₂ sectors in a representative week in the base case demand scenario (H₂ demand corresponding to 20% FCEV penetration), \$100/tonne CO₂ price and \$300/kW_e electrolyzer capital cost. (a) Generation and demand profiles in the power sector; (b) Generation and demand profiles in the H₂ sector.

sector. Both the cost savings and emission reductions from sector coupling increase with increasing H₂ demand (either from transportation or other end-uses such as heating or industrial sectors), more than doubling for the 96% decarbonization scenario as H₂ demand quadruples. The CO₂ emission reductions are high in the cases with no carbon policy because of the large existing emissions in that case. As the CO₂ price increase from \$50/tonne to \$1000/tonne, the emission reductions benefit from sector coupling increase since individual decarbonization becomes more expensive within each sector.

3.3 Storage or flexible demand

G2P generators are not cost-competitive in the results discussed above, even in the deep decarbonization scenario, because of the relatively high capital cost and the additional efficiency losses incurred in supplying power rather than H₂. While they may become economically feasible in the future with economics of scale, technology innovations, and/or efficient deployment strategies (like sharing power conversion systems with electrolyzers or renewable plants), the results imply that the sectoral

(a) Power system generation change due to sector coupling

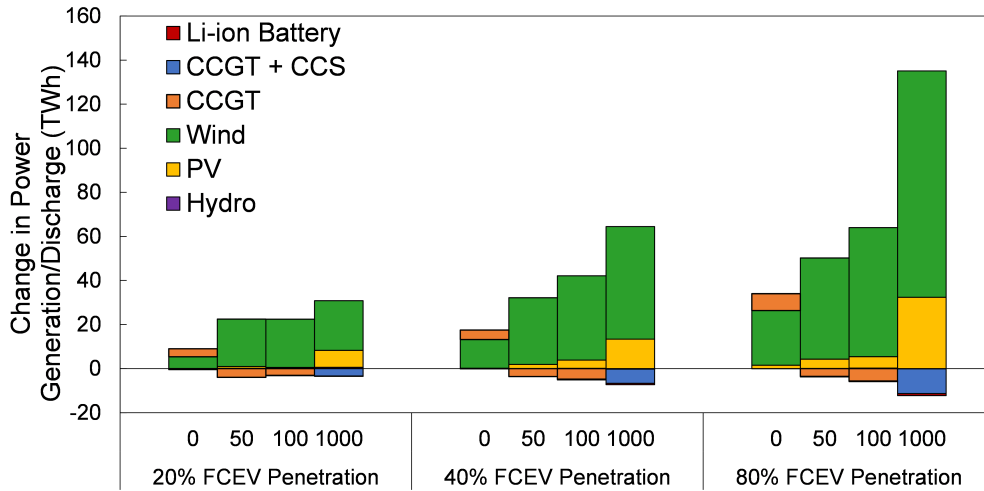

(b) Total system cost saving and emission reduction due to sector coupling

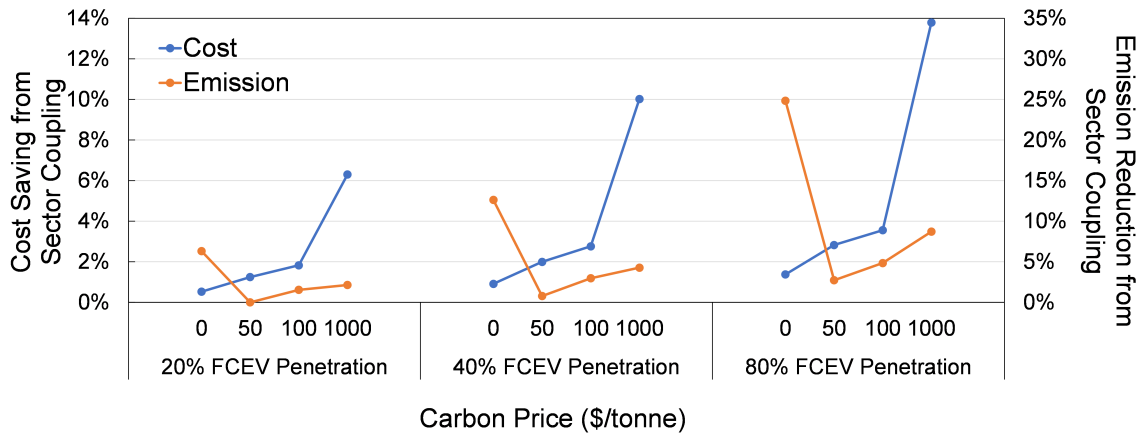


Figure 5: Differences in the optimal power system generation mix, total system cost, and CO₂ emission between energy systems with and without conversions between power to H₂ under various CO₂ price and FCEV penetration scenarios. (a) Differences in the optimal power system generation mix; (b) Differences in the total system cost and CO₂ emission. The capital cost of electrolyzer is assumed to be \$300/kW_e. In (b), the cost savings are shown as percentages of the total system costs in each CO₂ price and FCEV penetration scenario, while the emission reductions are shown as percentages of the CO₂ emission in the case with \$0/tonne CO₂, \$300/kW electrolyzer, and 20% FCEV penetration.

power exchange between the H₂ and power sectors could be highly imbalanced, as opposed to energy storage (charging and discharging typically of the same order of magnitude).

We further evaluate the role of H₂ supply chain and its interaction with the power sector for different values of electrolyzer and G2P generator capital costs in Fig. 6. The electricity and H₂ interactions are quantified using two model outputs: a) the sum of annual power for H₂ production

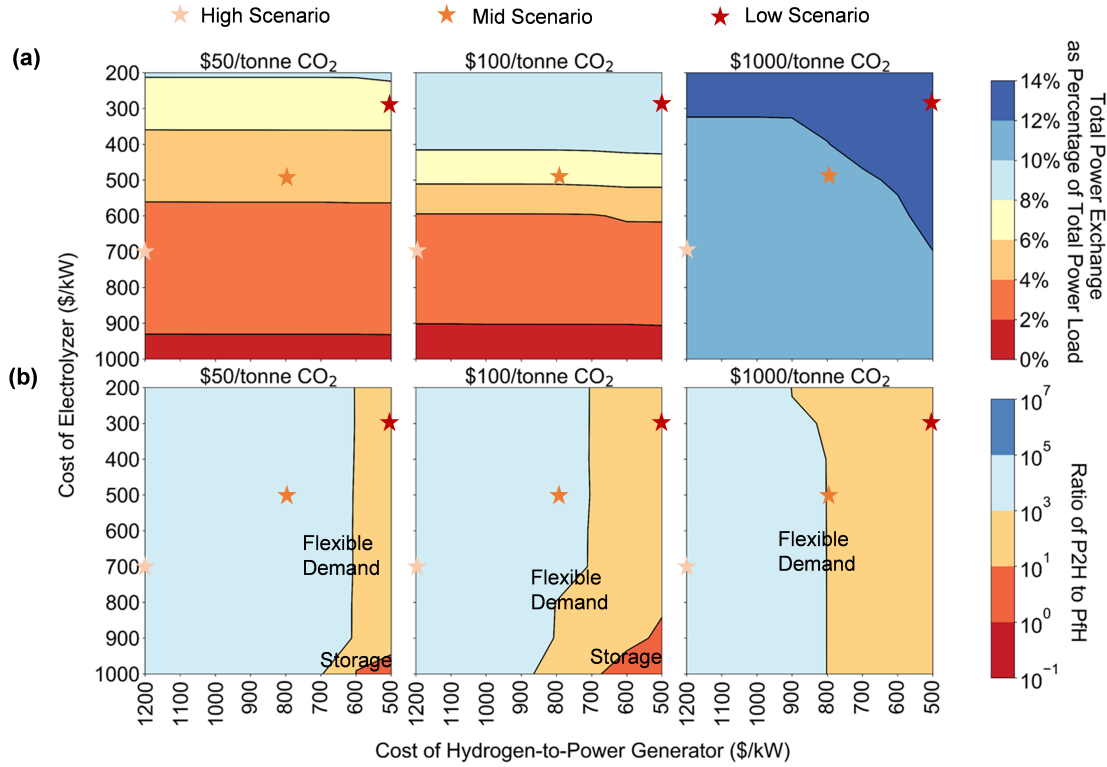


Figure 6: Power exchanges between H₂ supply chain and power system under different costs of electrolyzer and G2P generator. (a) Total power exchange throughput, power used to generate H₂ (P2H) plus power generated from H₂ (PfH), as percentages to the total power load (without H₂ generation); (b) The ratio of P2H to PfH. We define the role of H₂ supply chain as storage when the P2H and PfH are of the same order of magnitude, as flexible demand when the P2H is of higher order of magnitude than PfH, and as generator when the P2H is of lower order of magnitude than PfH. The cost scenario of electrolyzer ranges from \$1000/kW_e to \$200/kW_e, and the cost scenario of H₂-based power generator ranges from \$1200/kW_e to \$500/kW_e. The H₂ demand scenario corresponds to 20% FCEV penetration. All other parameters are the same as the base case.

(P2H) and annual power generated from H₂ (PfH) exports as a percent of total annual electricity demand (without power for H₂ generation) and b) the ratio of annual P2H to PfH. The red, orange, and light pink stars in Fig. 6 represent high, medium and low capital costs for P2G and G2P technologies, respectively. We produce these scenarios based on potential cost savings from economies of scale, technology learning, and system designs that saves critical component costs like power electronics. We can see from Fig. 6 (a) that in the \$100/tonne CO₂ price case, along the cost-reduction pathway (i.e. a straight line connecting the three star markers), the power exchange between the H₂ and the power sectors increase from 3% to 9% of the total electric load. For the deep decarbonization scenario (\$1000/tonne CO₂), the power exchange can be as high as 14% of the total electric load in the low technology cost scenario. Notably, as opposed to most literature that study H₂ as long-term/seasonal storage, our results in Fig. 6 (b) indicate that H₂ will more likely serve as a flexible

demand response resource rather than long-term storage. This can be seen in Fig. 6 (b), where annual P2H generally tend to be several orders of magnitude greater than PfH, for almost the full technology cost space studied here. This observation stems from the additional efficiency losses and capital costs of converting H₂ back to power associated with H₂-based electricity storage vs. its use as a flexible demand resource. The only exceptions when the amounts of P2H and PfH are of the same order of magnitude under moderate decarbonization scenarios (\$50-100/tonne CO₂) with G2P capital costs below \$700/kW and electrolyzer capital costs greater than \$800/kW. That the minimum cost of G2P generator for the H₂ supply chain to play a storage role is higher in the moderate decarbonization scenario compared to the deep decarbonization scenario implies that the need for electrolytic H₂ increases faster than the need in PfH.

3.4 Transmission deployment

In the results presented above, H₂ pipeline is not economically competitive compared to H₂ trucks. However, it could become attractive if the existing natural gas pipelines can be retrofitted at relatively low cost for transporting H₂, which has been a rising interest for the gas industry⁴⁷. Therefore, we conduct a sensitivity analysis on the pipeline cost, given the uncertainty in the pipeline retrofitting cost as well as the cost of deploying dedicated H₂ pipelines. Besides pipeline capital cost, we focus on two scenarios, one with SMR as the dominating generation source, the other with significant electrolyzer generation while SMR playing as back up resource. As seen in Fig. 7, H₂ pipeline becomes cost-competitive with H₂ truck if the pipeline capital cost is 50% of the cost assumed in the base case. This can also be interpreted to represent a threshold cost for retrofitting existing natural gas pipelines to be compatible with 100% H₂ flows. The other notable observation is that we need more H₂ transportation in the case with SMR as the dominant H₂ supply source compared to the case with significant electrolytic H₂ supply, and the share of electrolytic H₂ production goes down as pipelines become cheaper. This finding is, in part, driven by the assumption that distributed electrolyzers are allowed in the highly urbanized zone 4, while centralized SMRs are not. Pipelines, because of their relatively high capital costs, are more cost-efficient to cope with large and steady H₂ transmission demand from centralized SMR production pathway, while electrolyzers can be deployed in a more distributed manner and thus complement smaller-scale and more flexible H₂ transmission mechanisms like trucks. The above conclusions also extended for increased H₂ demand scenarios, corresponding to FCEV penetration of 80% (See Figure S4).

4 Conclusions

The interest in H₂ for decarbonizing energy systems is unquestionably increasing, in part driven by declining technology costs, greater policy emphasis on decarbonizing non-electric end-uses, and recognition of the limitations of direct electrification in certain applications. The unique versatility of H₂ as an energy carrier and its multiple uses, however, require a holistic view to accurately explore its role in future low-carbon energy systems and the accompanying technology pathways. Additionally, such a view could demonstrate the relative economic and environmental merits of H₂ and electricity use for various end-uses as well as their complementarity as vectors for decarbonizing the energy system.

To this end, we developed a generalized framework for cost-optimal energy infrastructure investment and operations for decarbonizing multiple end-use sectors based on coordinated use of electric-

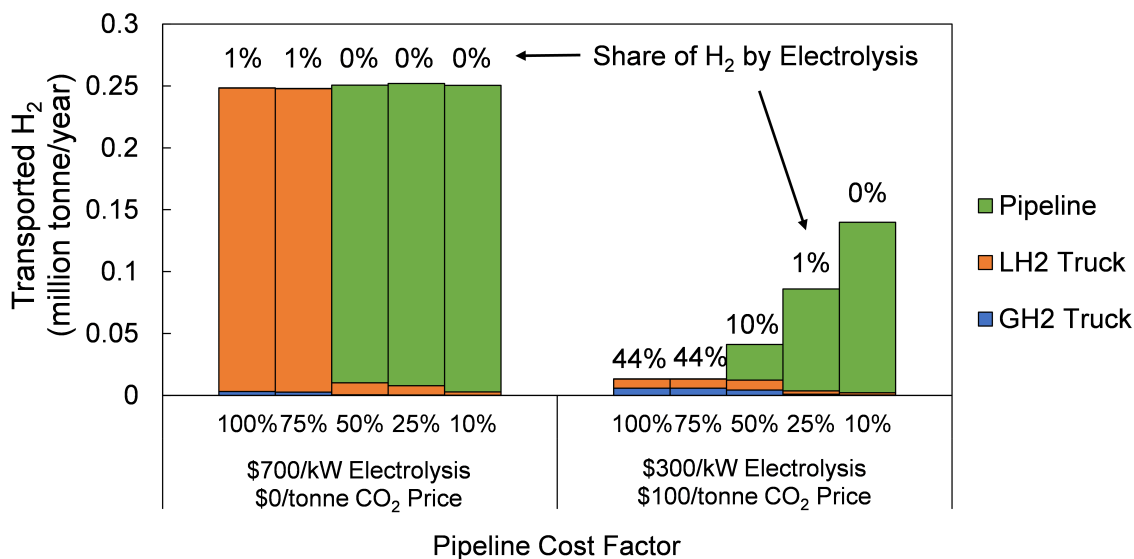


Figure 7: The amounts of transported H₂ per year via different transport modes under different pipeline cost scenarios and dominating H₂ generation modes. The FCEV penetration is 20%. LH₂: liquid H₂; GH₂: Gaseous H₂.

ity and H₂ supply chains to manage spatio-temporal variations in renewable energy inputs and energy demands. This modelling approach provides numerous insights on the technological make-ups of these energy supply chains, spanning production, transport, storage and end-use, and their impacts on the cost of decarbonization, as highlighted via the U.S Northeast case study.

First, in the coupled energy system, CCS is deployed at lower carbon prices in the H₂ sector than the power sector, which can be interpreted as CCS being more competitive in the H₂ supply chain than the power supply chain. This conclusion, however, goes counter to the observation that six times more CCS projects will be online before this decade in the power sector than for H₂ production⁴⁸. For regions like Europe, where decarbonization via H₂ is part of the government’s decarbonization roadmap, our study highlights the importance of prioritizing CCS deployment for H₂ production.

Second, power and H₂ sector coupling via flexible electrolysis and H₂ storage enables increased VRE penetration in the power sector, thereby reducing the need for alternative flexible resources for managing VRE variability (e.g. gas generation, battery storage, etc.) and in turn reducing total system cost. Moreover, as opposed to other power-sector focused studies that emphasize H₂’s value as a grid-scale storage resource⁶⁻⁸, our multi-sector view highlights the greater system value of P2G as a flexible demand resource that avoids the additional efficiency losses and capital cost incurred with P2G2P pathways. This conclusion is found to be robust to future expectations on the capital costs of electrolyzer and G2P systems. Since electrolyzers and H₂ storage are commercially available, this finding also suggests that H₂ playing a role for grid balancing could be sooner than the full P2G2P routes becoming cost-effective.

Third, as compared to the independent optimization of each supply chain, we find that sector-coupling via P2G, reduces the cost of energy system decarbonization and that this benefit grows as the demand for H₂ in other end-use sectors increases. Realizing the benefits of such cross-sector

coordination, however, calls for policy and market reforms. For example, H₂ prices need to be settled at similar spatiotemporal resolution as electricity prices, to provide incentives and signals for H₂ infrastructure owners, and electrolyzers should be allowed to provide ancillary services to power systems. Moreover, both integrated operation and planning of power and H₂ sectors, through a shared independent system operator, could help fully exploit the sector-coupling benefits.

Finally, we found that the choice of H₂ transport infrastructure is intricately dependent on the choice of H₂ production infrastructure, with pipelines more synergistic with natural gas based production pathways because of the matching scale of production and transmission capacity of the two assets.

There are a number of areas for future work that can build on this analysis. While this study has focused on H₂ used in transportation, greater H₂ demand might be realized from decarbonizing heating and industrial sectors, such as ammonia production and steel manufacturing. Those H₂ demands will have different temporal profiles and flexibility compared to FCEV charging, and thus may affect the H₂ supply-demand balance in different ways. Accounting for these heterogeneous H₂ demands should be further explored. Investigating the last-mile delivery of H₂ is out of scope of this study but is definitely a key area for future work. The last-mile H₂ distribution network will affect the total number of gas trucks needed for H₂ transport in the system. Increased traffic congestion and safety considerations of a very large H₂ truck fleet may limit the deployment of trucks and increase the values of pipeline based transport, and further analysis in conjunction with traffic simulations is needed to understand this aspect.

Regional factors, including resource availability and demand level, could significantly affect the optimal technology portfolios and the costs in both power and H₂ sectors. For example, while natural gas supply is abundant in the studied U.S. Northeast region, it may be insufficient or expensive for many regions in the world, leading to higher shares of VRE, electrolytic H₂ production, and storage. The ability to cost-effectively store H₂ at various time scales and capacities is a critical factor in determining the optimal system architecture. Underground caverns, where available, can provide cheap H₂ storage for VRE and electrolysis deployment. The competing role of CCS with H₂ storage in underground resources also need to be considered for relevant regions.

Conflicts of interest

There are no conflicts to declare.

Acknowledgements

This work was partially supported by Shell New Energies Research and Technology, Amsterdam, Netherlands, and the Low-Carbon Energy Centers on Electric Power Systems and Carbon Capture Sequestration and Utilization at MIT Energy Initiative. We would like to thank Dr. Joe Powell, Dr. Mark Klokkenburg, and Prof. Robert Armstrong for their valuable advice on this work. We acknowledge the MIT SuperCloud and Lincoln Laboratory Supercomputing Center for providing resources that have contributed to the research results in this paper.

References

- [1] O. Schmidt, A. Gambhir, I. Staffell, A. Hawkes, J. Nelson, and S. Few. Future cost and performance of water electrolysis: An expert elicitation study. *Int. J. Hydrog. Energy*, 42(52): 30470–30492, 2017.
- [2] O. J. Guerra, J. Eichman, J. Kurtz, and B. M. Hodge. Cost competitiveness of electrolytic hydrogen. *Joule*, 3(10):2425 – 2443, 2019. doi: <https://doi.org/10.1016/j.joule.2019.07.006>.
- [3] Dharik Sanchan Mallapragada, Emre Gençer, Patrick Insinger, David William Keith, and Francis Martin O’Sullivan. Can industrial-scale solar hydrogen supplied from commodity technologies be cost competitive by 2030? *Cell Reports Physical Science*, 1(9):100174, 2020. doi: <https://doi.org/10.1016/j.xcrp.2020.100174>.
- [4] Cody E. Finke, Hugo F. Leandri, Evody Tshijik Karumb, David Zheng, Michael R. Hoffmann, and Neil A. Fromer. Economically advantageous pathways for reducing greenhouse gas emissions from industrial hydrogen under common, current economic conditions. *Energy & Environmental Science*, 2021. ISSN 1754-5692 1754-5706. doi: 10.1039/d0ee03768k.
- [5] Gunther Glenk and Stefan Reichelstein. Economics of converting renewable power to hydrogen. *Nature Energy*, 4(3):216–222, 2019.
- [6] Omar J. Guerra, Jiazi Zhang, Joshua Eichman, Paul Denholm, Jennifer Kurtz, and Bri-Mathias Hodge. The value of seasonal energy storage technologies for the integration of wind and solar power. *Energy & Environmental Science*, 13(7):1909–1922, 2020. doi: 10.1039/d0ee00771d.
- [7] Arthur Clerjon and Fabien Perdu. Matching intermittency and electricity storage characteristics through time scale analysis: an energy return on investment comparison. *Energy & Environmental Science*, 12(2):693–705, 2019.
- [8] Matthew A. Pellow, Christopher J. M. Emmott, Charles J. Barnhart, and Sally M. Benson. Hydrogen or batteries for grid storage? a net energy analysis. *Energy & Environmental Science*, 8(7):1938–1952, 2015.
- [9] Jacqueline A. Dowling, Katherine Z. Rinaldi, Tyler H. Ruggles, Steven J. Davis, Mengyao Yuan, Fan Tong, Nathan S. Lewis, and Ken Caldeira. Role of long-duration energy storage in variable renewable electricity systems. *Joule*, 4(9):1907–1928, 2020. doi: 10.1016/j.joule.2020.07.007.
- [10] Alexander Zerrahn and Wolf-Peter Schill. Long-run power storage requirements for high shares of renewables: review and a new model. *Renewable and Sustainable Energy Reviews*, 79:1518 – 1534, 2017. doi: <https://doi.org/10.1016/j.rser.2016.11.098>.
- [11] Madeleine McPherson, Nils Johnson, and Manfred Strubegger. The role of electricity storage and hydrogen technologies in enabling global low-carbon energy transitions. *Applied Energy*, 216:649 – 661, 2018. doi: <https://doi.org/10.1016/j.apenergy.2018.02.110>.
- [12] H. Khani and H. E. Z. Farag. Optimal day-ahead scheduling of power-to-gas energy storage and gas load management in wholesale electricity and gas markets. *IEEE Trans. Sustain. Energy*, 9(2):940–951, 2018.

- [13] H. Yang, Q. Li, S. Zhao, W. Chen, and H. Liu. A hierarchical self-regulation control for economic operation of ac/dc hybrid microgrid with hydrogen energy storage system. *IEEE Access*, 7:89330–89341, 2019.
- [14] S. J. Davis, N. S. Lewis, M. Shaner, S. Aggarwal, D. Arent, I. L. Azevedo, S. M. Benson, T. Bradley, J. Brouwer, Y. M. Chiang, C. T. M. Clack, A. Cohen, S. Doig, J. Edmonds, P. Fennell, C. B. Field, B. Hannegan, B. M. Hodge, M. I. Hoffert, E. Ingersoll, P. Jaramillo, K. S. Lackner, K. J. Mach, M. Mastrandrea, J. Ogden, P. F. Peterson, D. L. Sanchez, D. Sperling, J. Stagner, J. E. Trancik, C. J. Yang, and K. Caldeira. Net-zero emissions energy systems. *Science*, 360: 6396, 2018.
- [15] Nixon Sunny, Niall Mac Dowell, and Nilay Shah. What is needed to deliver carbon-neutral heat using hydrogen and CCS? *Energy Environ. Sci.*, 13:4204–4224, 2020. doi: 10.1039/D0EE02016H.
- [16] Marta Victoria, Kun Zhu, Tom Brown, Gorm B. Andresen, and Martin Greiner. The role of storage technologies throughout the decarbonisation of the sector-coupled european energy system. *Energy Conversion and Management*, 201:111977, 2019. doi: <https://doi.org/10.1016/j.enconman.2019.111977>.
- [17] Espen Flo Bødal, Dharik Mallapragada, Audun Botterud, and Magnus Korpås. Decarbonization synergies from joint planning of electricity and hydrogen production: A texas case study. *International Journal of Hydrogen Energy*, 45(58):32899 – 32915, 2020. doi: <https://doi.org/10.1016/j.ijhydene.2020.09.127>.
- [18] T. Brown, D. Schlachtberger, A. Kies, S. Schramm, and M. Greiner. Synergies of sector coupling and transmission reinforcement in a cost-optimised, highly renewable european energy system. *Energy*, 160:720 – 739, 2018. doi: <https://doi.org/10.1016/j.energy.2018.06.222>.
- [19] J. Li, J. Lin, H. Zhang, Y. Song, G. Chen, L. Ding, and D. Liang. Optimal investment of electrolyzers and seasonal storages in hydrogen supply chains incorporated with renewable electric networks. *IEEE Trans. Sustain. Energy*, 11(3):1773–1784, 2020.
- [20] M. Reuß, T. Grube, M. Robinius, P. Preuster, P. Wasserscheid, and D. Stolten. Seasonal storage and alternative carriers: A flexible hydrogen supply chain model. *Appl. Energy*, 200:290–302, 2017.
- [21] Lara Welder, D Severin Ryberg, Leander Kotzur, Thomas Grube, Martin Robinius, and Detlef Stolten. Spatio-temporal optimization of a future energy system for power-to-hydrogen applications in germany. *Energy*, 158:1130–1149, 2018.
- [22] A. O. Bique and E. Zondervan. An outlook towards hydrogen supply chain networks in 2050 — design of novel fuel infrastructures in germany. *Chem. Eng. Res. Des.*, 134:90–103, 2018.
- [23] S. D. L. Almaraz, C. Azzaro-Pantel, L. Montastruc, and S. Domenech. Hydrogen supply chain optimization for deployment scenarios in the Midi-Pyrénées region, France. *Int. J. Hydrog. Energy*, 39(23):11831–11845, August 2014. doi: 10.1016/j.ijhydene.2014.05.165.

- [24] L. Li, H. Manier, and M. A. Manier. Integrated optimization model for hydrogen supply chain network design and hydrogen fueling station planning. *Computers & Chemical Engineering*, 134:106683, 2020.
- [25] G. He, D. S. Mallapragada, Abhishek Bose, C. F. Heuberger, and Emre Gençer. Hydrogen supply chain planning with flexible transmission and storage scheduling. *IEEE Trans. on Sustain. Energy*, in press, 2021. URL <https://arxiv.org/abs/2008.07611>.
- [26] D. S. Mallapragada, N. A. Sepulveda, and J. D. Jenkins. Long-run system value of battery energy storage in future grids with increasing wind and solar generation. *Appl. Energy*, 275:115390, 2020. doi: <https://doi.org/10.1016/j.apenergy.2020.115390>.
- [27] J. D. Jenkins and N. A. Sepulveda. Enhanced decision support for a changing electricity landscape: the genx configurable electricity resource capacity expansion model. Technical report, MIT Energy Initiative, 2017. URL <http://energy.mit.edu/wp-content/uploads/2017/10/Enhanced-Decision-Support-for-a-Changing-Electricity-Landscape.pdf>.
- [28] Guannan He. gn-he/e-h2-planning v1.0, January 2021. URL <https://doi.org/10.5281/zenodo.4443233>.
- [29] EPA. Integrated planning model documentation v6. Technical report, 2020.
- [30] Trieu T Mai, Paige Jadun, Jeffrey S Logan, Colin A McMillan, Matteo Muratori, Daniel C Steinberg, Laura J Vimmerstedt, Benjamin Haley, Ryan Jones, and Brent Nelson. Electrification futures study: Scenarios of electric technology adoption and power consumption for the united states. Technical Report NREL/TP-6A20-71500, National Renewable Energy Laboratory, Golden, CO., 2018.
- [31] H2A hydrogen delivery infrastructure analysis models and conventional pathway options analysis results. Technical report, Nexant, Inc., 2008. URL https://www.energy.gov/sites/prod/files/2014/03/f9/nexant_h2a.pdf.
- [32] Freight analysis framework version 4. Technical report, Oak Ridge National Laboratory, 2019. URL <https://faf.ornl.gov/fafweb/>.
- [33] Laura J Vimmerstedt, Chad R Augustine, Philipp C Beiter, Wesley J Cole, David J Feldman, Parthiv Kurup, Eric J Lantz, Robert M Margolis, Tyler J Stehly, Craig S Turchi, et al. 2018 annual technology baseline (atb), 2018.
- [34] U.S. Energy Information Administration. *Annual Energy Outlook 2018: With Projections to 2050*. 2018.
- [35] Patrick R. Brown and Audun Botterud. The value of inter-regional coordination and transmission in decarbonizing the US electricity system. *Joule*, 5(1):115–134, 2021.
- [36] IEA. The future of hydrogen. Technical report, 2019. URL <https://www.iea.org/reports/the-future-of-hydrogen>.
- [37] Manufacturing cost analysis of 100 and 250 kw fuel cell systems for primary power and combined heat and power applications. Technical report, Battelle Memorial Institute, 2016.

- [38] Laura J Vimmerstedt, Sertac Akar, Chad R Augustine, Philipp C Beiter, Wesley J Cole, David J Feldman, Parthiv Kurup, Eric J Lantz, Robert M Margolis, Tyler J Stehly, et al. 2019 annual technology baseline, 2019.
- [39] J. R. Fekete, J. W. Sowards, and R. L. Amaro. Economic impact of applying high strength steels in hydrogen gas pipelines. *Int. J. Hydrog. Energy*, 40(33):10547 – 10558, 2015. doi: <https://doi.org/10.1016/j.ijhydene.2015.06.090>.
- [40] North american midstream infrastructure through 2035 - a secure energy future report. Technical report, The INGAA Foundation, Inc., 2014. URL <https://www.ingaa.org/Foundation/Foundation-Reports/Studies/14904/14889.aspx>.
- [41] C. Yang and J. Ogden. Determining the lowest-cost hydrogen delivery mode. *Int. J. Hydrog. Energy*, 32(2):268–286, 2007. doi: 10.1016/j.ijhydene.2006.05.009.
- [42] S. Schoenung. Economic analysis of large-scale hydrogen storage for renewable utility applications. Report, Sandia National Laboratories, 2011.
- [43] Sheila Samsatli and Nouri J. Samsatli. A multi-objective MILP model for the design and operation of future integrated multi-vector energy networks capturing detailed spatio-temporal dependencies. *Appl. Energy*, 220:893–920, June 2018. doi: 10.1016/j.apenergy.2017.09.055.
- [44] A. S. Lord, P. H. Kobos, G. T. Klise, and D. J. Borns. A life cycle cost analysis framework for geologic storage of hydrogen: A scenario analysis. Technical report, Sandia National Laboratories, 2010.
- [45] Bryan Stephen Palmintier. *Incorporating operational flexibility into electric generation planning: Impacts and methods for system design and policy analysis*. PhD thesis, Massachusetts Institute of Technology, 2013.
- [46] B. S. Palmintier and M. D. Webster. Heterogeneous unit clustering for efficient operational flexibility modeling. *IEEE Transactions on Power Systems*, 29(3):1089–1098, 2014. doi: 10.1109/TPWRS.2013.2293127.
- [47] Sonja van Renssen. The hydrogen solution? *Nature Climate Change*, 10(9):799–801, 2020.
- [48] The global status of CCS report 2020. Report, Global CCS Institute, 2020.

Sector coupling via hydrogen to lower the cost of energy system decarbonization: Supplementary Information

Guannan He^{*†}, Dharik S. Mallapragada[†], Abhishek Bose[†],
Clara F. Heuberger[‡], Emre Gençer[†]

Supplementary Figures

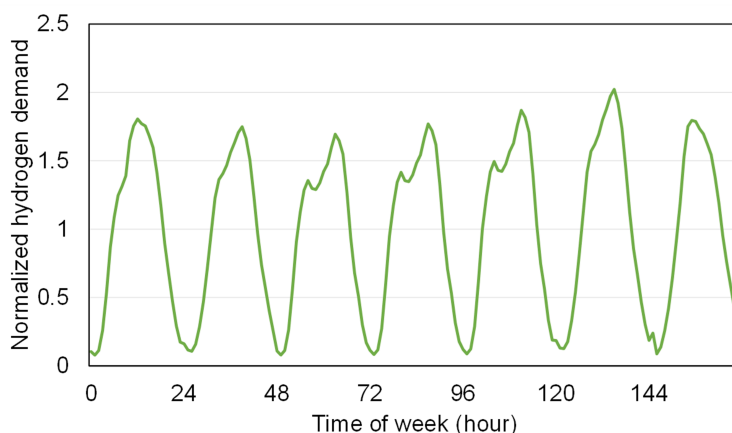


Figure S1. Hourly hydrogen refuelling profile normalized based on the mean

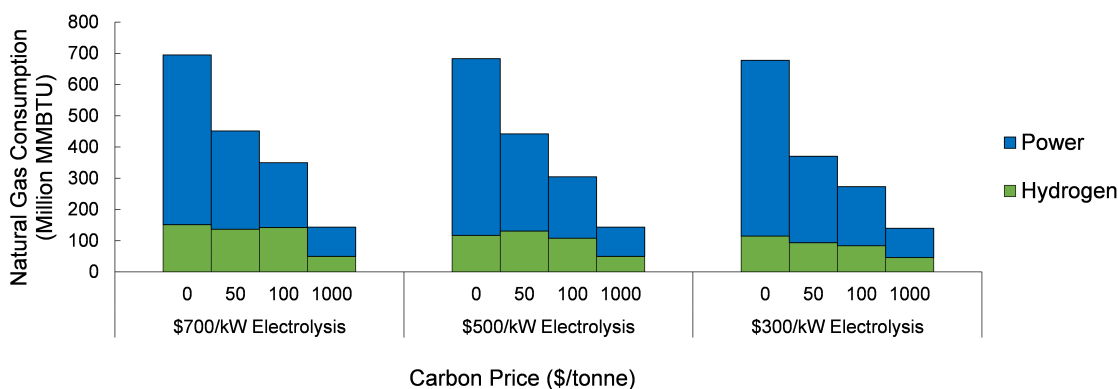



Figure S2. Natural gas consumption breakdowns in H₂ and power sectors.

*Email: gnhe@mit.edu

[†]MIT Energy Initiative, Massachusetts Institute of Technology, Cambridge, MA, USA.

[‡]Shell Global Solutions International B.V., Shell Technology Centre Amsterdam, 1031 HW Amsterdam, Netherlands.

(a) Power system capacity change due to sector coupling

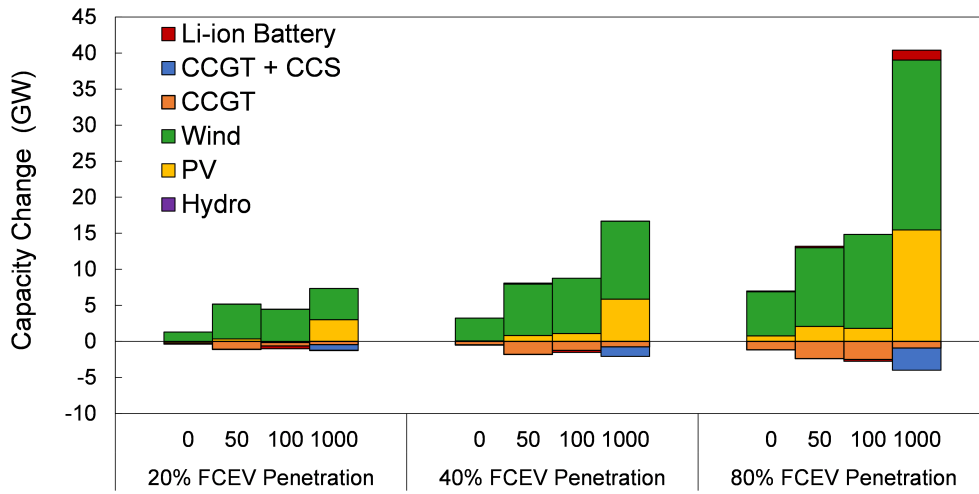

(b) Variable renewable energy curtailment reduction due to sector coupling

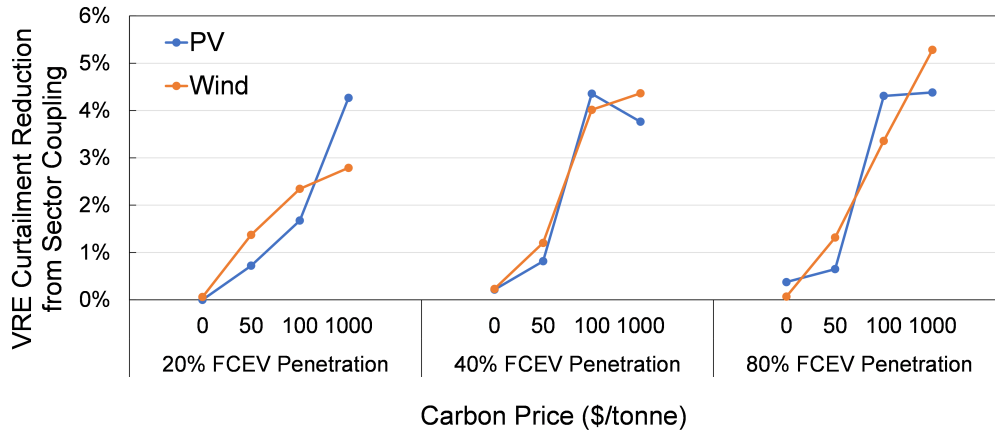


Figure S3. Differences in the optimal power system capacity mix and variable renewable energy (VRE) curtailment between energy systems with and without conversions between power to H₂ under various CO₂ price and FCEV penetration scenarios. (a) Differences in the optimal power system capacity mix; (b) Differences in the VRE curtailment. In (b), the VRE curtailment reductions are calculated as the differences in the curtailment percentages between energy systems with and without conversions between power to H₂ in each CO₂ price and FCEV penetration scenario.

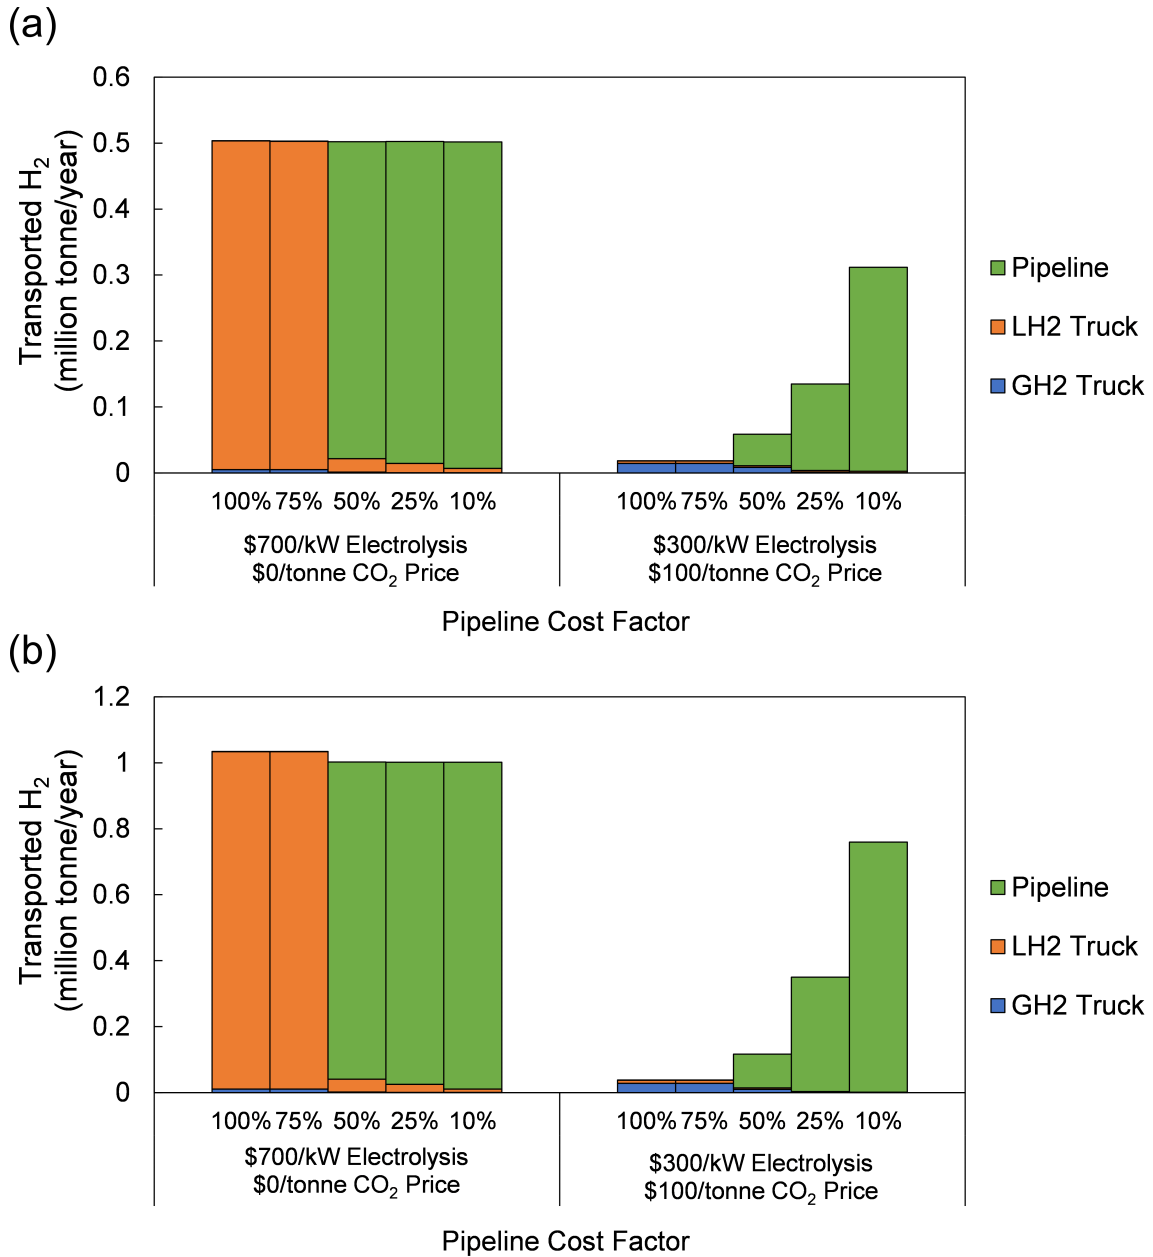


Figure S4. The amounts of transported H₂ per year via different transport modes under different pipeline cost scenarios and dominating H₂ generation modes. (a) 40% FCEV penetration; (b) 80% FCEV penetration. LH2: Liquid H₂; GH2: Gaseous H₂.

Supplementary Tables

Table S1. Additional Parameters of the e-H₂ model

Discount rate	7%
Power transmission expansion cost	1,600/MW-mile
Power transmission loss	1%/100 miles
Value of lost load (electricity)	\$20,000/MWh
Value of lost load (hydrogen)	\$1,000/kg
Gas Price	\$5.4/MMBTU
CO ₂ transportation cost	\$20/tonne

Table S2. Parameters of Existing Power Transmission Lines. Zone 7 represents Canada.

Line	Max Power Flow (MW)	Line Distance (km)
Zone 1-2	2000	317
Zone 2-3	2950	199
Zone 3-4	760	99
Zone 4-5	1528	216
Zone 3-5	600	158
Zone 2-5	800	179
Zone 5-6	5400	186
Zone 2-6	150	340
Zone 6-7	2600	0
Zone 2-7	1650	0
Zone 1-7	800	0

Table S3. Inter-Zone Distances of the Six Zones in the U.S. Northeast for Trucks and Pipelines (mile).

Zone	1	2	3	4	5	6
1	0	317	504	602	487	608
2	317	0	199	297	179	340
3	504	199	0	99	158	333
4	602	297	99	0	216	358
5	487	179	158	216	0	186
6	608	340	333	358	186	0