# Quantifying the benefit of load uncertainty reduction for the design of district energy systems under grid constraints using the Value of Information

Max Langtry, Ruchi Choudhary

Peak load	Prior distribution the measurement make budge aber for search and the search and	Simulation District energy system simulation simulate schematic sumpled schematic designed system Average over hypothesised measurements	nce
Data	Results	Conclusions	
Case study from Cambridge Uni 5 yrs of historic effect: usage data from 3 baidings on + entricity price 8 carbon intensity	<ol> <li>Installing solar-battery systems reduces overall operating cost by 40%, including 65% reduction in carbon emissions</li> <li>Building monitoring reduces overall cost by 2% on average</li> <li>Reducing uncertainty in mean load provides all available decision support benefit (same Vol as case with all uncertainties reduced)</li> <li>Reducing load uncertainty reduces cost uncertainty by 65%</li> </ol>	<ol> <li>Building load monitoring is not economically worthwhile for supporting district energy system design in case study</li> <li>Existing analyses erroneous suggest load uncertainty reduction important</li> <li>Current industry protected or using distributions of) standard building load profiles for energy system design is sufficient</li> <li>Further study required to determine if Vol remains low in other energy systems</li> </ol>	
		Icon credits: Fic	iticon.com

- Sizing of solar-battery and grid capacity in case study district with historic data
- Benefit of load uncertainty reduction for supporting energy system design quantified
- $\bullet\,$  Building monitoring reduces total system costs by less than 2% on average
- Monitoring found to be not economically worthwhile for supporting system design
- Reducing only mean load uncertainty provides all available decision support benefit

# Quantifying the benefit of load uncertainty reduction for the design of district energy systems under grid constraints using the Value of Information

Max Langtry<sup>a,\*</sup>, Ruchi Choudhary<sup>a,b</sup>

<sup>a</sup>Energy Efficient Cities Initiative, Department of Engineering, University of Cambridge, Trumpington Street, Cambridge, CB2 1PZ, UK <sup>b</sup>Data-Centric Engineering, The Alan Turing Institute, British Library, London, NW1 2DB, UK

# Abstract

Load uncertainty must be accounted for during design to ensure building energy systems can meet energy demands during operation. Reducing building load uncertainty allows for improved designs with less compromise to be identified, reducing the cost of decarbonizing energy usage. However, the building monitoring required to reduce load uncertainty is costly.

This study quantifies the economic benefit of practical building monitoring for supporting energy system design decisions, to determine if its benefits outweigh its cost. Value of Information analysis (VoI) is a numerical framework for quantifying the benefit of uncertainty reduction to support decision making. An extension of the framework, termed 'On-Policy' VoI, is proposed, which admits complex decision making tasks where decision policies are required. This is applied to a case study district energy system design problem, where a Linear Program model is used to size solar-battery systems and grid connection capacity under uncertain building loads, modelled using historic electricity metering data.

Load uncertainty is found to have a significant impact on both system operating costs  $(\pm 30\%)$  and the optimal system design  $(\pm 20\%)$ . However, using building monitoring is found to reduce overall costs by less than 2% on average, less than the cost of measurement, and is therefore not economically worthwhile. This provides the first numerical evidence to support the sufficiency of using standard building load profiles for energy system design. Further, reducing only uncertainty in mean load is found to provide all available decision support benefit, meaning using hourly measurement data provides no benefit for energy retrofit design.

*Keywords:* District energy system, Uncertainty reduction, Value of Information, Energy planning, Stochastic programming, Building monitoring

<sup>\*</sup>Corresponding author Email address: mal84@cam.ac.uk (Max Langtry)

Preprint submitted to Applied Energy

# 1. Introduction

#### 1.1. Background

Building energy systems accounted for over 40% of final energy consumption and 35% of carbon emissions in the EU in 2020 [1]. Hence, decarbonizing building energy usage is essential for achieving targets of netzero carbon emissions by 2050 [2]. As space and water heating makes up around 75% of final energy usage in buildings, it is necessary to install low-carbon heating systems to replace existing gas-based systems. Many countries such as the UK and EU have implemented policies that focus on the adoption of heat pumps to decarbonize building heating through electrification [3, 4]. However, facilitating widespread roll-out of heat pumps poses significant challenges for the electrical grid. Electrifying heating demand will substantially increase total electricity demand, and more significantly peak electricity demand [5], which would rise by 50% for the case of the UK [6, 7]. Supporting this additional electricity demand while maintaining security of supply requires investment in distribution and transmission systems [8], as well as reserve generation capacity [7], imposing additional costs to heat decarbonisation. Already, capacity limitations on the electrical supply system are causing delays to both building construction and renewable power generation projects [9, 10], and it is widely acknowledged that network capacity limitations pose a significant barrier to future decarbonisation [11].

To achieve decarbonization by 2050, energy retrofits must be cheap enough so that they are widely adopted, but also able to be safely integrated into the wider energy system. Hence, building energy systems must be designed to balance their total system cost, the carbon emissions reductions they achieve, and their impact on the electrical grid. The use of distributed generation and storage has emerged as a prominent pathway for reducing the carbon emissions of building energy usage, and so has attracted considerable research interest in recent literature [12, 13, 14, 15, 16, 17]. This is due to the falling costs of solar PV generation [18], and the need for local storage to both improve buildings' utilization of the solar energy and reduce the grid impact caused by peaks in solar generation [12].

When designing building energy systems, there is substantial uncertainty concerning the conditions in which they will operate. These include weather conditions which affect local energy generation, building usage type and occupant behaviour which determines the timing of energy usage, and building envelope characteristics which influence the building thermal response. Of particular importance for the management of grid impacts is the electricity usage behaviour of the building, including the timing and magnitude of peak loads. Due to the greater weather dependence and seasonal variability of heating loads, electrification of heating will increase uncertainty in building electricity usage [19, 20], in terms of both the aggregate and peak demand. The challenges posed by these uncertainties, and methods for properly accounting for them during the design of building energy systems have been widely studied [21, 22, 23, 24, 25].

Two routes exist for improving the design, and so eventual operational performance, of future decar-

bonized building energy systems. Firstly, improved optimization methods for designing energy systems in the presence of uncertainties can be developed. Secondly, the uncertainty in the conditions in which the energy system will operate can be reduced by monitoring the heating and electricity use patterns of the building prior to designing the heating retrofit. Optimization methodologies have received concerted research effort for many years [23, 26], whereas there has not yet been any study of the potential benefits of uncertainty reduction to improve energy system design.

Reducing uncertainty is advantageous to design as it reduces the need to adopt compromise designs that provide good performance across a wider range of operational scenarios, which causes worsened performance under the conditions the system eventually faces. The more accurate the statistical understanding of the operational conditions, the more tailored a system can be, and the lower its cost. However, uncertainty reduction is itself costly. For the case of existing buildings, these costs arise from the hardware and software needed to monitor energy consumption patterns, and the cost of management, curation, analysis, and interpretation of the data. In the UK, only 51% of electricity and gas meters are currently 'smart' (able to collect hourly energy usage data), despite rollout beginning in 2012, and expected to cost £19.4bn in total [27]. Therefore, it becomes important to quantify the benefits of uncertainty reduction through monitoring buildings on energy system design. Specifically, whether the reductions in total system cost are greater than the cost of gathering and exploiting the data needed to reduce uncertainty.

## 1.2. Quantifying the impacts of uncertainty on building energy system design

Study of the effects of uncertainty reduction on the design of building energy systems, and the quantification its benefits for decision making, have only recently been proposed [28, 29]. However, the opportunities for uncertainty reduction to improve the design of engineering systems have been explored in other fields. For example, [30] quantifies the improvements in the reliability and weight of vehicle designs optimized for crash worthiness when reducing uncertainty in structural material properties, crash performance estimates (from simulations), and experimental tolerances. It proposes that the quantified trade-off can be used to "decide whether to allocate ... resources for employing uncertainty reduction measures".

Within the building energy systems literature, the impact of uncertainties on the performance of energy systems has been widely studied. Uncertainty Analysis [24, 25, 31, 32] and Sensitivity Analysis [24, 31, 33, 34] have been applied to analyse the uncertainty in the performance of energy systems caused by uncertainty in operating conditions and building models. For example, [31] uses Sensitivity Analysis to identify the temperature set point and building wall area as the key uncertaint parameters affecting estimated energy usage for heating. However most commonly the impacts of uncertainty are considered in the context of system design [35, 36, 37, 38]. A diverse range of methods for accounting for uncertainties during energy system design optimization have been proposed, and several reviews have been conducted to classify and compare the different approaches [39, 40, 41]. Broadly, these methods provide a representation of the

uncertainty in the system performance (design objective) and/or design space (feasible region) caused by the underlying uncertainties in the energy system, and seek to identify a single system design (optimal solution) that either performs best on average or has a low risk in its performance. Whilst these methods account for the influence of uncertainty on candidate designs, they are not able to quantify its impact on the ex-post optimal design.

Study of the effects of uncertainty on design has been very limited in the energy systems literature, with only a few previous works investigating the influence of uncertain parameters on the optimal system design. [42] analyses the design of a Net Zero Energy Building with distributed generation and storage, and plots how the capacities of each system component (chillers, wind turbines, solar panels, and battery) and the total cost of the optimized system change with uncertain values of properties of the building (including wall thickness, internal heat gain, temperature set point). Additionally, influence coefficients of the uncertain parameters are computed for the capacity of each system component. A later study, [43], performed a similar analysis for another system with distributed generation and storage, investigating how the optimal design and total cost changed with varying scenarios of renewable generation. In both cases no statistical distributions of the uncertain parameters are considered, and so the insights gained are limited. E.g. for the case of [43], it is unclear whether a design with a substantially greater number of PV panels is likely to be optimal, and so worth investing in.

A statistical Sensitivity Analysis for the optimal design of an energy system with distributed generation and storage was performed in [33]. In this study, a Mixed Integer Linear Program was used to optimize the sizing of boilers, heat pumps, thermal storage, and PV generation for scenarios defined by samples from distributions of uncertain parameter values, including energy and capital costs, conversion efficiencies, and energy demand. This enabled a distribution of optimal sizes to be created for each component to illustrate how the uncertainties affect the optimal design choice. [38] performed a similar procedure for the sizing of components in a district energy system, however the optimized designs were not analyzed. Whilst these studies identify the distribution of optimal designs resulting from the underlying uncertainties in the system, they do not then provide a means to quantify the importance of those uncertainties for the design process.

# 1.3. Value of information analysis

Value of Information analysis (VoI) [44, 45] is a branch of Bayesian Decision Analysis that provides a framework quantifying the expected (mean) benefit to decision making derived from the reduction of epistemic uncertainty (uncertainty associated with lack of knowledge of a system [46]) through measurement. Its general methodology can be used to quantify the benefit of uncertainty reduction for any decision making problem under uncertainty, provided a mathematical description of the decision problem can be produced, i.e. the decision can be formulated as a stochastic decision problem [47]. VoI has been applied in fields such as environmental science, agriculture, and economics [48] to quantify the economic benefit provided by uncertainty reduction interventions to improve decision making. Within engineering, VoI has been used to determine whether proposed measurements and the uncertainty reduction they provide are financially worthwhile for supporting decisions regarding maintenance scheduling for buildings [49] and wind farms [50], construction project planning [51], and structural health monitoring [52, 53].

Only two previous studies have applied VoI to study the benefit of uncertainty reduction for decision making in building energy systems.

The first, [28], provides a proof-of-concept study of the capabilities of VoI to support decision making across three different building scenarios, quantifying the economic benefit provided by different measurements. The key limitation of this study is the simplicity of the modelling performed, which does not capture the full complexity of the uncertainties, decision options, and costs. Additionally, the investigation of uncertainty reduction in each scenario considers only a single uncertain parameter, providing guidance for one measurement intervention in each case.

The second, [29], studies the influence of uncertainties on the design of a district energy system with distributed generation and storage. It quantifies the expected reduction in the total lifetime cost (capital investment plus operational cost) achieved by eliminating uncertainty in building energy demand and solar generation, to improve the sizing of system components (including chillers, solar panels, and energy storage). Whilst the mathematical VoI framework and literature are not acknowledged in this paper, the study computes the Expected Value of Perfect Information (EVPI), defined in Section 2.2, for the decision problem of designing a district energy system, using a high temporal resolution (hourly) model. However, the value of information quantified in this study was not related to any practical measurement intervention to reduce uncertainty. In fact, the uncertainties considered in the analysis are not only epistemic, as at the time of design the energy demand and solar generation during operation cannot be known perfectly. Therefore, quantifying the benefit of eliminating these uncertainties provides limited practical insight, particularly as the value of removing uncertainty was found to be significant, and so is not informative as an upper bound. Similarly, a number of older studies investigating large-scale energy systems (transmission to national scale) quantify the benefit of eliminating uncertainty without association to any practical measurement [54, 55, 56, 57].

There remains a substantial research gap regarding the quantification of the benefits of uncertainty reduction to support the design of building energy systems, and the identification of opportunities for economically worthwhile measurement interventions to improve design. Value of Information analysis provides a methodology for addressing this gap, and its ability to do so has already been demonstrated [28].

## 1.4. Research objectives & novel contributions

In the existing literature, there has been very limited study of the economic benefit of uncertainty reduction from measurement (data collection) to support decision making in building energy systems. No previous study has quantified the benefit of using hourly energy metering data to support the design of district energy systems by reducing uncertainty in building load profiles. Understanding of the value of load monitoring for improving energy system design is necessary to determine whether significant cost savings are currently being missed, or whether current industry practice of using standard load profiles for design is sufficient.

This study applies a novel extension of the Value on Information analysis methodology, termed 'On-Policy' VoI, to quantify the overall cost savings achieved when using hourly building monitoring data to inform energy system design. It investigates the sizing of solar-battery systems and grid connection capacity for an illustrative district energy system, where probabilistic models of building load profiles are constructed using historic energy usage data from the Cambridge University estate. The main objectives of this study are:

- Determine if load monitoring is economically worthwhile for improving energy system design by reducing load uncertainty
- Quantify the relative importance of load profile features (mean load, peak load, and shape) for improving system design
- Gather evidence to assess whether current industry practice of using standard load profiles for building energy system design is sufficient

This work is the first to quantify the economic value of practical building measurement to support energy system design through load uncertainty reduction. It demonstrates that existing methods for assessing the impact of uncertainties on energy system design are insufficient, and lead to erroneous conclusions about the importance of uncertainty reduction. Further, it provides the first numerical evidence to indicate that existing industry practice of using (distributions of) standard building load profiles for energy system design is adequate for minimizing the cost of energy.

The remainder of this work is structured as follows. Section 2 outlines the Value of Information analysis (VoI) framework, and presents the 'On-Policy' extension which enables its application to complex decision making problems. Section 3 describes the case study district energy system. Sections 3.1 & 3.2 present the data studied, and how it is used to construct probabilistic models of building loads. Next, Sections 3.3 & 3.4 define how the system is designed using a Linear (Scenario) Programming model, and evaluated via simulation. The VoI calculations are performed in Section 4, and the practical importance of the results obtained is discussed. Finally conclusions are drawn in Section 5.

# 2. Value of information analysis

Value of Information analysis (VoI), initially introduced by Raiffa [44] and Howard [45] in the 1960s, is a framework based on Bayesian Decision Analysis and Expected Utility Theory [58] for quantifying the expected benefit to decision making provided by the reduction of epistemic uncertainty (uncertainty associated with lack of knowledge of a system [46]) through data collection (measurement). It numerically answers the question, "How much is decision making improved on average by reducing the epistemic uncertainty in a given problem?". This section briefly introduces the existing VoI framework, before then extending it in Section 2.3 to enable its application to complex decision making problems, including the design of district energy systems. A thorough explanation of the classical VoI framework is available in [46].

#### 2.1. Bayesian Decision Analysis

Bayesian Decision Analysis provides a mathematical framework for studying decision-making in the presence of uncertainties, particularly circumstances where those uncertainties can be reduced through measurement. Its aim is to determine the optimal set of actions which should be taken by a decision-maker in order to maximise their expected utility (the average benefit they receive from taking those actions).

Consider a generalised stochastic decision problem in which an actor seeks to select a 'decision action' to take,  $a \in \mathcal{A}$ , within a system with uncertain parameters  $\theta$ , which have a prior probabilistic model  $\pi(\theta)$ . The performance of each available action is given by a utility function which is also dependent upon the uncertain parameters,  $u(a, \theta)$ . In VoI analysis, before an action a is taken, the actor may choose to take a 'measurement action',  $e \in E$ , from which the actor receives data z which reduces uncertainty in  $\theta$ . The probabilistic model describing the measurement data  $f_e(z|\theta)$  is used to update the prior model,  $\pi(\theta)$ , to produce a posterior probabilistic model,  $\pi(\theta|z)$ . This posterior (with reduced uncertainty c.f. the prior) is then used by the actor to inform their choice of 'decision action', improving their decision making performance.

The set of available actions, prior probabilistic model, and utility function,  $\{\mathcal{A}, \pi(\theta), u(a, \theta)\}$ , provide a complete mathematical description of the decision making task under uncertainty. The likelihood function  $f_e(z|\theta)$  describes the reduction in epistemic uncertainty in the parameters of the system,  $\theta$ , provided by data collection.

This generalised model can be represented in decision tree form, as shown in Fig. 1, in which square nodes represent decisions, circular nodes represent uncertainties, and triangular nodes represent utilities.

The actor, who is assumed to be risk neutral, seeks to maximise their expected utility obtained from the selected 'decision action'. Costs are defined as negative utilities. The actor may choose to do this without taking any measurement. The resulting stochastic optimisation is termed the Prior Decision Problem,

$$\max_{a \in \mathcal{A}} \mathbb{E}_{\theta} \left\{ u(a, \theta) \right\} \tag{1}$$

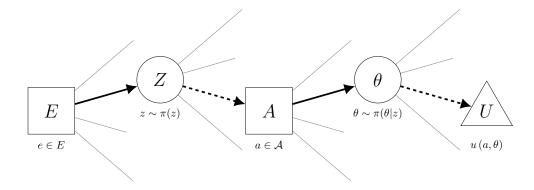


Figure 1: Decision tree representation of Pre-Posterior Decision Problem

Alternatively, the decision-maker may additionally consider the selection of a 'measurement action' within the decision variables of the optimisation, which leads to the Pre-Posterior Decision Problem,

$$\max_{e \in E} \mathbb{E}_{z} \left\{ \max_{a \in \mathcal{A}} \mathbb{E}_{\theta|z} \left\{ u(a, \theta) \right\} \right\}$$
(2)

# 2.2. Value of Information

The Bayesian Decision Analysis framework is used to quantify the expected Value of Information (VoI) [44], defined as the increase in the expected utility achieved by the optimal action taken by the actor as a result of reducing uncertainty in the system through measurement prior to selecting the 'decision action'. It is computed via the difference in expected utility achieved by the two cases where decision are made with and without uncertainty reduction from measurement.

In the general case where a measurement e provides imperfect/uncertain information that reduces but does not remove the epistemic uncertainty in the system, the expected value of that uncertain information is termed the Expected Value of Imperfect Information (EVII), and is given by,

$$EVII(e) = \mathbb{E}_{z} \left\{ \max_{a \in \mathcal{A}} \mathbb{E}_{\theta|z} \left\{ u(a,\theta) \right\} \right\} - \max_{a \in \mathcal{A}} \mathbb{E}_{\theta} \left\{ u(a,\theta) \right\}$$
(3)

where the posterior probabilistic model,  $\pi(\theta|z)$ , used to compute inner expectation with respect to  $\theta|z$ , is derived using the likelihood function for the measurement e,  $f_e(z|\theta)$ .

In the case where measurement provides perfect information on the true value of the uncertain parameters of the system, the expected utility obtained by the actor making decisions with perfect information simplifies as,

$$\mathbb{E}_{z}\left\{\max_{a\in\mathcal{A}}\mathbb{E}_{\theta|z}\left\{u(a,\theta)\right\}\right\} \longrightarrow \mathbb{E}_{z}\left\{\max_{a\in\mathcal{A}}u(a,z)\right\}$$
(4)

The expected value of information in this case is termed the Expected Value of Perfect Information (EVPI),

and is given by,

$$EVPI = \mathbb{E}_{z} \left\{ \max_{a \in \mathcal{A}} u(a, z) \right\} - \max_{a \in \mathcal{A}} \mathbb{E}_{\theta} \left\{ u(a, \theta) \right\}$$
(5)

The EVPI is significantly cheaper to compute, and provides an upper-bound on the EVII [48].

The Value of Information quantifies the increase in expected utility the actor can achieve through reducing uncertainty in the parameters of the system. Typically, decision problems are formulated using an economic objective, i.e. a total cost or profit. Hence, the VoI quantifies the actor's willingness to pay for measurement interventions that reduce uncertainty in the decision problem. Comparing VoI to the cost of reducing uncertainty allows the net economic benefit to be quantified, i.e. the VoI minus the cost of information. With this, a decision maker can determine whether the measurements considered are economically worthwhile, and compare the relative benefit of different uncertainty reduction options.

Most practical engineering systems are subject to aleatoric uncertainty (inherent variability which cannot be explained away) as well as epistemic uncertainty. This aleatoric uncertainty cannot be reduced via measurement, and so even when all uncertainty in  $\theta$  is removed from the system, some residual uncertainty may remain. To account for this, the parameters  $\theta$  are defined as the measurable parameters of the system (which may contain both epistemic and aleatoric uncertainty, meaning it may not be possible to fully remove their uncertainty), and additional unmeasureable parameters  $\phi$  are introduced. The utility function is now defined as,

$$u(a,\theta) = \mathbb{E}_{\phi} \left\{ u(a,\theta,\phi) \right\}$$
(6)

#### 2.3. On-Policy Value of Information

The current VoI framework assumes that the optimal action can be determined, and that in solving the stochastic optimisation problem a sufficient approximation of the expected utility is computed. However, many practical engineering decision problems are too complex for direct stochastic optimisation to be tractable. Instead, decisions are determined via policies, such as Rule-Based Control, Reinforcement Learning, or Stochastic Programming. These policies achieve tractability by either using heuristics to guide their search, or by simplifying the model of the energy system and/or the statistics used to evaluate performance<sup>1</sup>. As a result, policies may not provide a sufficiently accurate (low error) approximation of the decision maker's target utility to capture useful VoI values, i.e. errors are significantly greater than meaningful VoI values.

The classical VoI framework is extended to allow decision making via policies. This extension involves an additional step of evaluating the expected utility achieved by actions selected by the policy.

<sup>&</sup>lt;sup>1</sup>Most notably, Monte Carlo approximations of the expected utility with few samples are used to limit computational burden, causing significant statistical error.

A decision policy is defined as a mapping from a utility function describing the performance of the system,  $u(a, \theta)$ , and a distribution describing the uncertainty in the system parameters,  $\pi(\theta)$ , to an action.

$$\mathcal{P}\left(u(a,\theta),\pi(\theta)\right) \to \alpha \in \mathcal{A} \tag{7}$$

As the utility function and action set are defined by the given stochastic decision problem, the policy applied to the decision problem is referred to as  $\mathcal{P}_u(\pi(\theta))$ .

As before, the VoI is the difference between the expected utilities achieved when decisions are made with and without uncertainty reduction from measurement.

For the prior case (without measurement), the policy is applied to the prior probability model, and the expected utility it achieves over samples from the prior is evaluated,

$$\mathbb{E}_{\vartheta \sim \pi(\theta)} \left\{ u \left( \mathcal{P}_u \left( \pi(\theta) \right), \vartheta \right) \right\}$$
(8)

For the pre-posterior case (with uncertainty reduction from a measurement e), a set of hypothesised measurement values z are sampled from the joint probability model,  $\pi(\theta, z)$ . For each hypothetical measurement, the posterior probability model  $\pi(\theta|z)$  is constructed, the policy is applied to this posterior, and the expected utility it achieves over the posterior is computed. The pre-posterior expected utility is the expectation of these values over the hypothesised measurements,

$$\mathbb{E}_{z \sim \pi(\theta, z)} \left\{ \mathbb{E}_{\vartheta \sim \pi(\theta|z)} \left\{ u \left( \mathcal{P}_u \left( \pi(\theta|z) \right), \vartheta \right) \right\} \right\}$$
(9)

Therefore the VoI for an imperfect measurement, e, used to support a policy,  $\mathcal{P}_u$ , is given by,

$$\operatorname{EVII}_{\mathcal{P}}(e) = \mathbb{E}_{z \sim \pi(\theta, z)} \left\{ \mathbb{E}_{\vartheta \sim \pi(\theta|z)} \left\{ u \left( \mathcal{P}_u \left( \pi(\theta|z) \right), \vartheta \right) \right\} \right\} - \mathbb{E}_{\vartheta \sim \pi(\theta)} \left\{ u \left( \mathcal{P}_u \left( \pi(\theta) \right), \vartheta \right) \right\}$$
(10)

This framework extension is termed 'On-Policy VoI', as the benefit of uncertainty reduction is now dependent on the policy. This broadens a main criticism of the VoI framework, namely that VoI results do not generalise and are only valid for the particular system and probability models used for calculations, as now results are additionally only valid for the particular policy. However, this also opens the opportunity for investigating which policies are most benefited by uncertainty reduction and best exploit additional statistical information.

The key advantage of 'On-Policy VoI' is that it enables the study of the benefit of uncertainty reduction for complex, practical engineering decision problems where decision policies must be used, for instance problems with high-dimensional action spaces (i.e. where a large number of decisions must be made simultaneously), or those with tight computational limitations.

# 3. Case study district energy system

The benefits of uncertainty reduction to support energy system design are investigated for a problem involving the sizing of solar-battery systems to decarbonize electricity usage in a grid-constrained district energy system with electrified heating. At the time of design, the patterns and scale of electrical load in the buildings of the district are unknown/uncertain. This load uncertainty must be managed during design to allow the district to operate within the grids constraints. Specifically, the peaks in electrical load must be manageable, though their magnitude and timing (particular the co-incidence of peaks) or not known during design.

Prior to committing to a system design (PV, battery, and grid connection sizes), the designer may choose to gather hourly electricity usage for the buildings from smart meters, reducing uncertainty in both the patterns and scale of their electrical load. This enables a more tailored design with a lower total cost to be identified. However, gathering hourly metering data for each building in the district and applying it to size the solar-battery systems is costly. This case study asks the question,

"Does building monitoring to reduce uncertainty in electrical load provide a net economic benefit when designing solar-battery systems?",

i.e. "Does the reduction in cost from improved design outweigh the costs of collecting hourly monitoring data needed to achieve uncertainty reduction?".

#### 3.1. Case study data

Historic building energy usage data from the Cambridge University Estate is used to provide a case study for the design of a district of new academic buildings<sup>2</sup>. The dataset, [59], contains hourly electricity and gas usage data from 121 buildings of various usage types from the University estate, such as lecture blocks, offices, laboratories, and museums, covering the period 2000 to 2023, as well as weather observations and grid electricity price and carbon intensity data. The electricity usage measurements record the total electrical load at a given metering point in the building, which includes lighting, plug loads, and plant equipment electricity usage does not include any contributions from space heating or cooling. The gas usage measurements provide the total gas consumption at the metering points in each building, which is used for both space heating and DHW provision. Normalised power generation data from PV panels is taken from the renewables.ninja reanalysis model [60, 61], dynamic electricity pricing tariff data from Energy Stats UK

 $<sup>^{2}</sup>$ At the time of writing, such a development project is under consideration, and one significant hurdle for its implementation is the capacity restrictions on the local power distribution network, particularly as heat pumps are a leading option for minimising heating related carbon emissions.

[62], grid electricity carbon intensity from the National Grid ESO Data Portal [63]. Further detail on the data sourcing and processing is available in reference [59].

From this dataset, 9 buildings with available electricity and gas usage data for the period 2012 to 2017 are selected (the longest period in the dataset with a significant number of buildings with high quality data available). For each building, data for each year is separated out. To model energy usage in buildings with electrified heating, the electricity and gas usage measurements are combined to produce overall electrical load profiles such that equal amounts of electricity are used by direct electricity and heating (meaning that with an assumed average COP of 3, the direct electricity to final heating energy usage matches the current 25:75 ratio [1]). Fig. 2 plots examples of these building electrical load profiles (normalized by their mean loads) for periods in the summer and winter. It demonstrates the variation in electricity usage behaviour both between buildings, and between years for a given building.

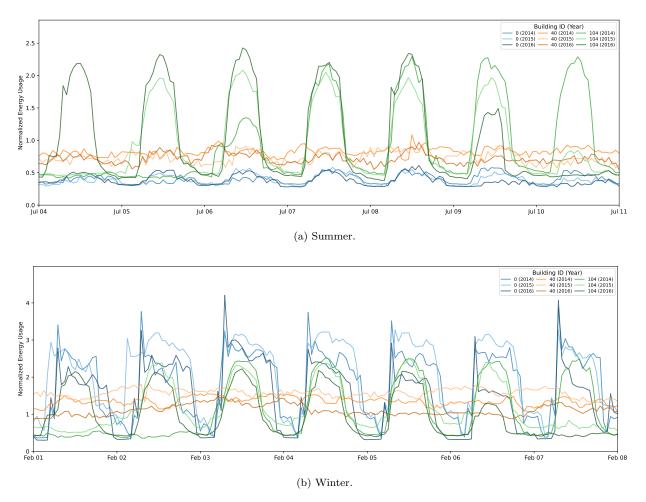


Figure 2: Examples of studied electricity load profiles, representing buildings with electrified heating. The complete set of electrified building load profiles considered in the case study can be view interactively here.

Data from 2023 is used for grid electricity price, grid carbon intensity, and normalised solar generation, as these provide the closest available representation of the conditions the district will face during operation. For the case study, these data are treated as exogenous, and are used to defined the probabilistic operational conditions of the energy system.

## 3.2. Probabilistic models of uncertain building electrical load & measurement via monitoring

A probabilistic model of the uncertain electricity load of a building is constructed from the data. The functional data variables representing building load are parameterized to provide a simple statistical representation that allows the importance of different characteristics of electrical load to be studied. Four parameters are used to specify the load profiles, two representing the shape of the profile (type and year), and two representing the scale of electricity usage (mean and peak).

The probabilistic models of profile shape are taken directly from data. The parameter type is used to represent the broad patterns of energy usage exhibited by a building, which derive largely from its usage type, e.g. laboratory, teaching, office, or a mix thereof. It is taken as a categorical variable denoting which building in the case study dataset the load profile data is taken from. All buildings are assumed equally likely,

$$type \sim \mathcal{U}\left(\{available \ buildings\}\right) \tag{11}$$

The parameter **year** is used to represent the inherent randomness in building energy usage due to factors that cannot be known in advance, such as occupant behaviour and weather. It is taken as a categorical variable denoting the year from which the load profile data is taken, which are all assumed equally likely,

$$year \sim \mathcal{U}\left(\{2012, \dots, 2017\}\right) \tag{12}$$

Load monitoring is assumed to provide knowledge of the broad energy usage patterns of a building, i.e. perfect information for the parameter type and no information for year.

Probabilistic models for the scale of electricity usage are determined from the statistics of the available load data. The prior model of mean building load is taken to be,

$$\text{mean} \sim \mathcal{N}(100, 25) \tag{13}$$

representing a  $\pm 50\%$  uncertainty in a design load of 100kW.

The prior model of peak building load is taken to be,

$$peak \sim \mathcal{U}(200, 400) \tag{14}$$

which is fit using the annual peak loads from the dataset.

In a practical building, load monitoring provides an uncertain/imperfect estimate of the mean and peak building load, as there is year-on-year variation in these values that cannot be predicted in advance. The likelihood models for the precision of mean and peak load measurements (estimates) from building monitoring are taken to be Gaussian, with measurement errors determined using the year-on-year variations observed in the load dataset, i.e. the likelihood of obtaining a measurement value is,

$$z|\theta \sim \mathcal{N}(\theta, \varepsilon\theta) \tag{15}$$

with  $\varepsilon = 0.1$  for mean, and  $\varepsilon = 0.075$  for peak.

The prior probabilistic models of the parameters describing the building electricity load profiles, and the likelihood models for measurements made via building monitoring are summarized in Table 1. Where necessary, the resulting posterior distributions are modeled using the probabilistic programming language **Stan** [64]. The probabilistic models of electrical load are taken to be the same for all buildings in the district, and independent.


Samples are drawn from the building load distributions (either prior or posterior) by sampling the four parameters (type, year, mean, peak) using their probabilistic models, retrieving the constructed electrified heating load data for the sampled building (type) and year (see Fig. 2), and scaling the profile to the sampled mean and peak load values.

Parameter	Prior model	Prior params	Measurement model	Msr. params
type year	Discrete uniform	{building ids} {data years}	Exact (perfect info) None (no info)	_
mean	Gaussian	$\mu = 100 \mathrm{kW}$ $\sigma = 25 \mathrm{kW}$	Gaussian imprecision	$\varepsilon = 0.1$
peak	Continuous uniform	$\begin{array}{l} \min = 200\mathrm{kW} \\ \max = 400\mathrm{kW} \end{array}$	$\begin{array}{l} \text{(imperfect info)} \\ z\theta \sim \mathcal{N}(\theta, \varepsilon\theta) \end{array}$	$\varepsilon = 0.075$

Table 1: Probabilistic models of parameters describing uncertain building load, and their measurement via monitoring.

The prior probabilistic model of building electrical load is visualised in Fig. 3. The mean load profile is indicated in black, with confidence intervals of  $\pm 1$  s.d.,  $\pm 2$  s.d., and the range (min to max), indicated in successively lighter shades of gray. A set of load profiles sampled from the distribution are traced in blue.

Fig. 4 illustrates the posterior distribution of building load for an example load profile measurement obtained by building monitoring (indicated in red). Load profiles sampled from the posterior distribution are traced in green. The confidence intervals of the prior distribution, from Fig. 3, are underlaid for comparison. The tighter clustering of the profiles sampled from the posterior compared to that for the prior samples in Fig. 3 demonstrates the reduction in building load uncertainty achieved by monitoring.

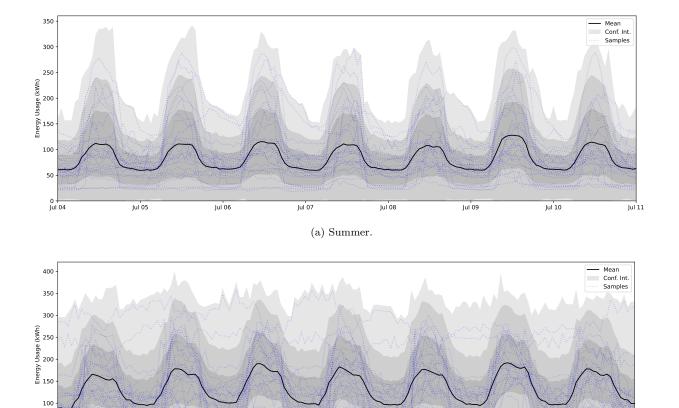



Feb 06

Feb 07

Feb 08

Figure 3: Visualisation of prior probabilistic model of uncertain building load, with profiles sampled from distribution.

50 -0 Feb 01

Feb 02

Feb 03


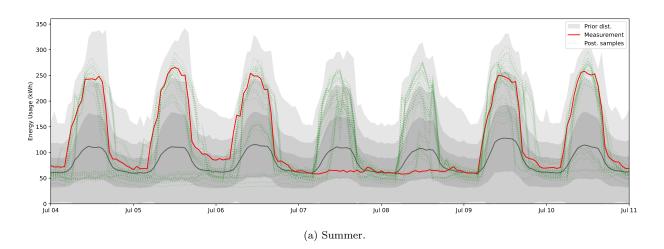


Figure 4: Visualisation of posterior probabilistic model of building load for example measurement. Continued over page.

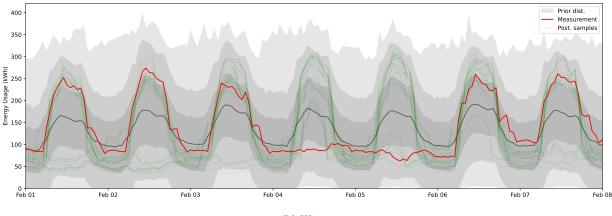

(b) Winter.

Figure 4: Visualisation of posterior probabilistic model of building load for example measurement.

#### 3.3. Stochastic Programming for system sizing

For the case study, Stochastic Programming is used as a policy to optimize the sizing of solar PV, battery storage units, and grid connection capacity, to determine district energy system designs that (attempt to) minimize the expected total system cost, accounting for uncertainty in electrical load. Stochastic Programming (specifically Scenario Optimization) is chosen as the optimization method due to its computational efficiency for problems with large numbers of decision variables, and its resulting prevalent use in the literature for designing district- and national-scale energy systems [22, 38, 65, 66].

A linearized model of the electrical behaviour of the district energy system is used. A schematic of the energy flows within the district energy system model is provided in Fig. 5. This allows the design optimization task to be formulated as a Linear Program, which is presented in Eq. 16, with Table 2 providing descriptions of the parameters.

The design optimization seeks to minimize as its objective the average total lifetime system cost over a set of M scenarios for the district of B buildings, operated for period of length T. This total system cost is comprised of: the capital cost of solar PV and battery units in the buildings, the cost of electricity purchased from the grid (metered per building), the cost of carbon emissions associated with used grid electricity (for the overall district), and the cost of grid usage. This optimization is subject to energy conservation (Eq. 16a) and capacity (Eq. 16b & Eq. 16c) constraints for operation within each scenario m.

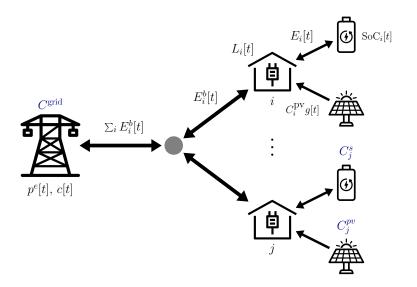


Figure 5: Energy flow schematic for case study district energy system. Operational variables are indicated in black, capacity variables are indicated in blue. (Icon credits: Symbolon)

$$\min \qquad \gamma \sum_{m} p_{m} \left( \sum_{t} \left( \underbrace{p^{e}[t] \sum_{i} \left( \max\left[0, E_{i,m}^{b}[t]\right] \right)}_{\text{electricity cost}} + \underbrace{p^{c} c[t] \max\left[0, \sum_{i} E_{i,m}^{b}[t]\right]}_{\text{carbon cost}} \right) + \underbrace{p^{\text{grid}}_{\text{excess}} \max\left[0, \max_{t} \left[ \left| \sum_{i} E_{i,m}^{b}[t] \right| \right] / \Delta t - C^{\text{grid}} / \text{FoS} \right]}_{\text{grid excess cost}} \right) \qquad (16)$$

$$+ \underbrace{\sum_{i} \left( p^{s} C_{i}^{s} + p^{\text{pv}} C_{i}^{\text{pv}} \right)}_{\text{capital cost}} + \underbrace{\gamma p^{\text{grid}} C^{\text{grid}}}_{\text{grid connection cost}}$$

over  $C_i^s, C_i^{\text{pv}}, C^{\text{grid}}, E_{i,m}[t], \text{SoC}_{i,m}[t+1] \quad \forall i, m, t$ 

subject to 
$$\operatorname{SoC}_{i,m}[t+1] = \operatorname{SoC}_{i,m}[t] + \sqrt{\eta_i} \left[ E_{i,m}[t] \right]^+ - 1/\sqrt{\eta_i} \left[ E_{i,m}[t] \right]^-$$
 (16a)

$$-P_i^{\max}\Delta t \le E_{i,m}[t] \le P_i^{\max}\Delta t \tag{16b}$$

$$0 \le \operatorname{SoC}_{i,m}[t+1] \le C_i^s \tag{16c}$$

$$P_i^{\max} = \delta C_i^s \tag{16d}$$

$$\operatorname{SoC}_{i,m}[0] = \operatorname{SoC}_i^0 \tag{16e}$$

$$E_{i,m}^{b}[t] = L_{i,m}[t] - C_{i}^{pv}g[t] + E_{i,m}[t]$$
(16f)

for all  $i \in [0, B-1], t \in [0, T-1], m \in [0, M-1]$ 

Parameter	Units	Description				
Decision v	Decision variables					
$C_i^s$	kWh	Energy capacity of battery unit in building $i$				
$C_i^{\mathrm{pv}}$	kWp	Peak power capacity of solar PV unit in building $i$				
$C^{\mathrm{grid}}$	kW	Contracted power capacity of grid connection				
$E_{i,m}[t]$	kWh	Energy <i>intake</i> to battery unit in building $i$ at time $t$ in scenario $m$				
$\operatorname{SoC}_{i,m}[t]$	kWh	State-of-charge of battery unit in building $i$ at time $t$ in scenario $m$				
Derived va	ariables					
$E_{i,m}^b[t]$	kWh	Net energy flow <i>into</i> building $i$ at time $t$ in scenario $m$				
$P_i^{\max}$	kW	Power capacity of battery unit in building $i$				
Parameter	rs (data)					
$\gamma$	_	System lifetime (multiple of operational period, $T$ )				
$\Delta t$	hrs	Time step of simulation data				
$p_m$	—	Probability of scenario $m$				
$\delta$	kW/kWh	Discharge ratio of battery units (power capacity/energy capacity)				
$\eta_i$	_	Round-trip efficiency of battery unit in building $i$				
$\mathrm{SoC}_i^0$	kWh	Initial state-of-charge of battery unit in building $i$				
$L_i[t]$	kWh	Electrical demand of building $i$ at time $t$				
g[t]	kW/kWp	Normalised generation power from solar PV at time $t$				
$p^{e}[t]$	$\pounds/kWh$	Grid electricity price at time $t$				
$p^c$	$\pounds/\mathrm{kgCO}_2$	Nominal carbon price				
c[t]	$\rm kgCO_2/kWh$	Carbon intensity of grid electricity at time $t$				
$p^{\mathrm{grid}}$	$\pounds/kW$	Price of contracted grid connection capacity (over operational period)				
$p_{\mathrm{excess}}^{\mathrm{grid}}$	$\pounds/kW$	Excess charge for exceeding contracted grid capacity (over op. period)				
FoS	_	Factor of safety for grid connection capacity				

Table 2: Description of Stochastic Program variables & parameters.

The cost of grid usage is modelled following the form of Distributed Use of Service (DUoS) connection capacity charges, which are the costs charged to large electricity consumers connected to the distribution network in the UK [67, 68]. These consumers must request a 'contracted' connection capacity from the distribution operator, for which they are charged a cost per unit of connection capacity ( $\pounds$ /kVA). If during operation a consumer draws power from the grid exceeding this contracted capacity, they are charged an additional cost for each kVA that their peak power draw exceeds the contracted capacity. Exaggerated grid charges (compared to current values) are used to represent the pressure on network connection capacity caused by future heat electrification.

As Linear Programs simultaneously optimize over all operational variables, they assume that the district energy system is operated with perfect foresight. This leads to underestimation of the system operational costs, as the battery units within the modelled energy system are scheduled more effectively than could be achieved in practice, reacting to and avoiding future costs which could not be foreseen. This is particularly important for the grid excess costs which depend on peak grid load values that are greatly influenced by the perfect foresight assumption. To account for this underestimation of grid usage in the design model, a factor of safety (FoS) is introduced into the grid excess cost. This FoS was calibrated using preliminary experiments, and was found to greatly reduce the overall cost of designs, as evaluated using the operational simulations introduced in the following section.

The Stochastic Program requires samples (scenarios) to be drawn from the probability space of electrical load profiles for each building in the district. As a result, the space of possible load scenarios is extremely large. However, due to the cubic computational complexity of Linear Programming, only a small number of scenarios can be tractably included in the Scenario Optimization. Therefore, after load profile samples are drawn, scenario reduction [69, 70] is performed to select a reduced set of 10 scenarios<sup>3</sup> that are statistically representative of the initial sample. A large initial sample must be considered to adequately cover the probability space of district loads. Therefore state-of-the-art scenario reduction methods which optimize each scenario individually, and use the resulting distribution of costs as the reduction metric [71] are intractable. Instead, computationally cheap scenario metrics must be used. The mean, maximum, and standard deviation of the aggregate electrical load for the district are chosen as the metrics for scenario reduction, as simple features representing the shape and scale of the district electricity load.

The parameter values used for all experiments are detailed in Appendix A.

# 3.4. Evaluation of operational cost of system designs via simulation

The objective of the Stochastic Program (SP) provides only an approximation of the expected (mean) total cost of the district energy system. The perfect foresight assumption of the Linear Program model causes underestimation of operating costs, a modelling error which is only partly corrected by the factor of safety. The small number of scenarios which can be considered in the Scenario Optimization due to computational limitations causes statistical error in the estimation of the mean cost. The combined model and statistical errors could lead to significant inaccuracy in the cost estimates<sup>4</sup>, and so the VoI. To provide more accurate estimations of the true cost of system designs (the decision maker's target utility), the operation of the district energy system is simulated.

The CityLearn [72, 73] building energy control framework is used to simulate the behaviour of the district energy system. These simulations provide a more accurate estimate of the operational cost of a system design for a given simulated load scenario. A Model Predictive Control (MPC) scheme is used to schedule battery operation in the simulations. This MPC scheme uses a Linear Programming (LP) formulation with the same form as used for design (Eq. 16), however it considers only a single scenario (that being simulated) with perfect forecasts of operational conditions over a 48hr planning horizon. Additionally, a small FoS is

<sup>&</sup>lt;sup>3</sup>The maximum number which could be used by the Stochastic Program given the available computational budget.

<sup>&</sup>lt;sup>4</sup>The accuracy of Stochastic Program objective's estimate of total system cost is investigated in Appendix C.2.

used to prevent numerical errors from the LP solver leading to erroneous exceedance of the grid capacity, calibrated from initial experiments. The simulator is configured with linearized building dynamics, such that the MPC scheme perfectly models the system simulation, and so provides perfect system control with 48hrs of foresight, mirroring the SP used for design, but relaxing the perfect foresight assumption. As a result, the simulations still underestimate operational costs [74], but this model error is lower than for the SP. As the simulations are computationally cheap, a large number of load scenarios can be simulated, and so the expected cost can be estimated using a large number of Monte Carlo samples (scenarios sampled from the building load distribution), reducing statistical error.

#### 3.5. Decision problem formulation

The case study can be contextualized within the On-Policy VoI framework proposed in Sec. 2.3 as follows.

The uncertain parameter in the district energy system,  $\theta$ , is defined as the electrical load profile (functional variable) in each building, and its probabilistic model,  $\pi(\theta)$ , is described in parametric form in Sec. 3.2 (see Table 1). The likelihood function,  $f(z|\theta)$ , describing the uncertainty reduction (imperfect parameter estimates) obtained from building load monitoring, is also described. A Stochastic Programming model, outlined in Sec. 3.3, is used as a policy,  $\mathcal{P}_u$ , determining a system design (action) to implement given samples from a distribution of building load profiles (to which scenario reduction is applied due to computational limitations). This policy minimizes an approximation of the expected total system cost (utility). The true system cost (utility, u) for a given design is evaluated using simulations of the district energy system with a more realistic control scheme, described in Sec. 3.4. Fig. 6 provides a diagrammatic overview of the methodology.

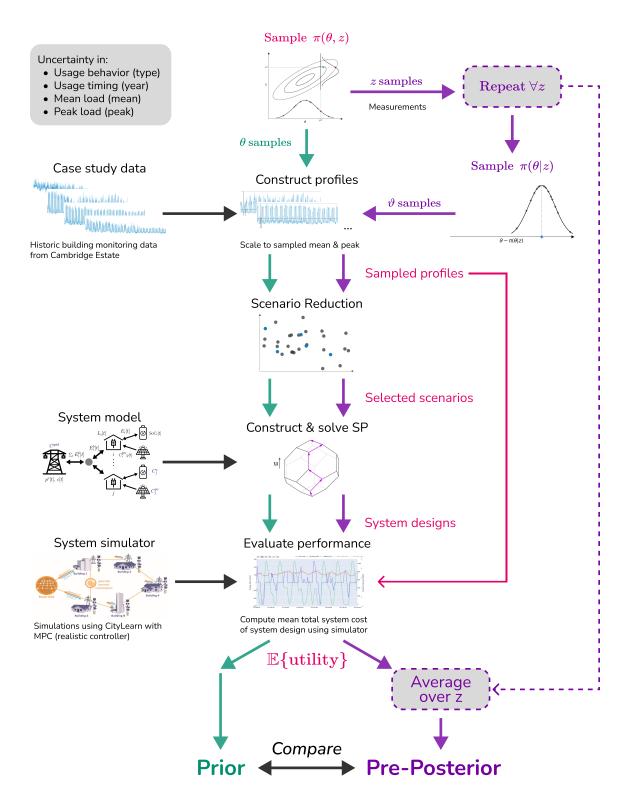


Figure 6: Methodology for computing VoI for case study district energy system design task.

## 4. Results & Discussion

## 4.1. System design without load monitoring

A district containing 5 university buildings, without constraints on asset sizing, is considered as a base case. Initially the case where no building load monitoring is used is considered. Load profile scenarios were sampled from the prior distribution, which represents the behaviour of a generic university building, and the Stochastic Program model described in Sec. 3.3 was used to size the solar-battery systems and grid connection capacity using these prior scenarios.

The optimized (prior) design installs 4,840 kWh of batteries and 2,870 kWp of solar panels across the 5 buildings, roughly evenly distributed, and contracts 1,190 kW of grid connection capacity (2.4 times the mean electrical load of the district of 500 kW). From operational simulations, the average lifetime cost for the system (the prior expected utility, Eqn. 8) was determined to be £22.140m over a 20 year operational lifetime, or £1.107m/year. Comparing to the case where no solar-battery systems are installed in the buildings, which results in a mean operational cost of £1.831m/year, this investment in local generation and storage reduces total operating costs for the energy system by 40%. Additionally, the embodied carbon emissions of providing energy are reduced by 65%, and the required grid connection capacity is reduced by 24%. Further, the practical building controller only exceeds the contracted grid capacity in 1 of the 256 sampled scenarios simulated (in that case by 56 kW, 4.7%). These results validate the ability of solar-battery systems to simultaneously reduce the overall cost of energy provision, embodied carbon emissions, and the grid impact of the district. Further details of the optimized system design and its performance across the simulated scenarios are provided in Appendix B.

Fig. 7 plots the distributions of simulated system costs and corresponding Levelized Costs of Energy (LCOEs) when the prior design is operated for each sampled load scenario. It shows that the uncertainty in building load causes significant uncertainty in the total operating cost of the system. As the LCOE normalizes the operating cost by the total energy usage of the buildings, it removes the contribution of mean load to cost variability. The standard deviation of the LCOE distribution is 4.4%, compared to 10.7% for the total cost distribution, comparing Fig. 7b to Fig. 7a. This demonstrates that mean load is the greatest driver of cost variability, but that the remaining uncertainties (peak load and load profile shape) also make a significant contribution. There is found to be no correlation between the peak electrical load of the district and the total operating cost across all scenarios, indicating that peak load has little to no influence on the cost of operation. This can be justified as the sizing of the battery units to perform bulk energy arbitrage results in them having a power capacity of 1,936 kW, meaning they can handle the highest possible peak load of the district of 2000 kW (of which only 810 kW needs to be shaved to avoid exceeding the grid connection capacity). As a result, in almost all scenarios no grid excess charges are incurred. Though the peak may occur when electricity is expensive, as they are infrequent there is only a small impact on the

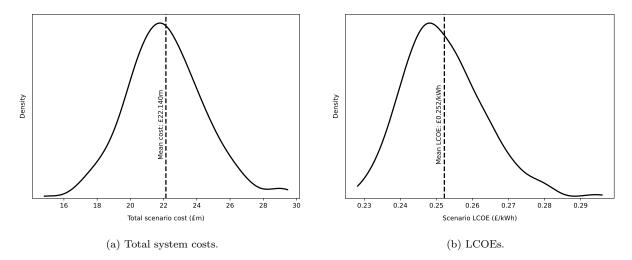


Figure 7: Distribution of simulated total system costs and LCOEs for prior system design over sampled building load scenarios.


overall electricity cost. The operational behaviour of the district energy system and the factors influencing system design are discussed further in Appendix B.

This analysis demonstrates that uncertainty in mean electrical load of the district is the largest driver of operational cost uncertainty, responsible for over half of induced variability, but that the other uncertainties (in peak load and load profile shape) also has a significant influence on cost. Therefore there might exist scope to reduce the total system cost by reducing uncertainty in these factors, and tailoring the system design to the energy usage behaviour of the true target building<sup>5</sup>. Most existing analyses, such as those in [24, 31], or other purely statistical approaches [75], stop at this stage and put forward the conclusion that reducing uncertainty in the models inputs (here, building load) would significantly reduce uncertainty in the model output (the operating cost of the system). However, this outcome does not provide any indication about whether this uncertainty reduction would affect the decision made, and so cannot quantify its importance for supporting decision making.

# 4.2. Value of building load monitoring

The On-Policy VoI framework presented in Sec. 2.3 was used to quantify the economic benefit of uncertainty reduction from building load monitoring to support the design decision of sizing solar-battery systems and grid connection capacity for the district. A set of 256 hypothetical monitoring measurements were sampled using the probability models defined in Sec. 3.2, and the procedure of using Stochastic Programming to design (size) the system, and simulations to evaluate its performance, was repeated for

 $<sup>^{5}</sup>$ This tailoring of the system (improved design) could reduce not only the highest cost scenarios for the prior case (the right tail of Fig. 7a), but also costs in the scenarios which are already cheap, as the system design does not need to compromise to keep costs down in the expensive cases, hence less generation and storage capacity can be used, reducing asset costs.

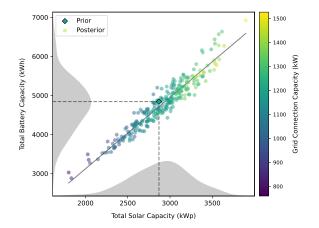

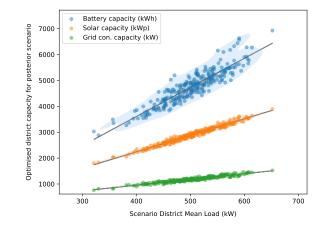


Figure 8: Total asset capacities in optimized system designs for each hypothesised load monitoring measurement. *Prior system design indicated with diamond.* 

Figure 9: Correlation between total asset capacities in posterior designs and mean load over posterior sampled building load scenarios used for design (from scenario reduction).

each hypothesised measurement using samples drawn from the corresponding posterior distribution. This process considers the following questions;

"Were the building monitoring systems to have returned a given measurement, reducing uncertainty in the building load profiles: What would the optimal district energy system design be? And what would be its average operational cost under the remaining load uncertainty?"

Fig. 8 plots the total asset capacities of the optimized system design for each hypothesised load monitoring measurement (the posterior designs, each indicated with a circle), and compares them to the prior system design (indicated by a diamond). It shows that the optimal asset sizes vary significantly with the load monitoring measurements, which provide information about the true energy usage behaviour of the district buildings, by approximately  $\pm 20\%$  for each of solar, battery, and grid total capacities. These posterior optimal asset capacities are strongly correlated with the mean load of the posterior distribution, see Fig. 9.

A sensitivity analysis studying the influence of input uncertainties on the optimal system design, such as those performed in [33] & [38], would stop at this point and conclude that the uncertainty reduction from building monitoring has a substantial impact on the optimal system design, and is therefore important information to gather for achieving a design close to the optimal for the district as built. However, this approach fails to address the actual goal of decision making. From the perspective of the decision-maker, they are not concerned with what decision is taken, but instead with how well on average that decision performs, i.e. its expected benefit/utility. Rather than the difference between the posterior designs and prior design themselves, the metric that is important for determining whether the building monitoring information is valuable for supporting decision making is the difference between their *performance*. I.e. how much lower the lifetime cost of the district energy system is on average as a result of performing the system design with

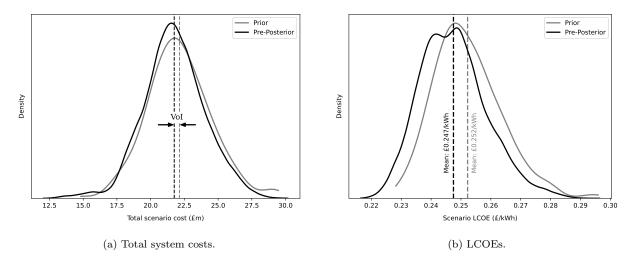


Figure 10: Comparison of simulated total system cost and LCOE distributions for prior and pre-posterior cases.

the building monitoring information, and the resulting reduced uncertainty. This metric is called the Value of Information (VoI), defined in Sec. 2.2.

Fig. 10 plots the distributions of total system costs and LCOEs achieved by the prior and posterior designs across the simulated building load scenario samples. The average lifetime cost for the posterior designs (the pre-posterior expected utility, Eqn. 9) is found to be £21.748m over the 20 year lifetime (£1.087m/year). Comparing to the prior expected utility of £22.140m, the Value of Information for building load monitoring is estimated at £392k, or 1.77% of the prior cost.

This VoI result demonstrates that using building monitoring to support energy system design for this district reduces the average total cost of the energy system by just under 2%. This methodology leads to a conclusion that is very different from those provided by existing analyses, which suggest that the uncertainty reduction would have a large impact on the design task. Further, the insights provided by VoI are far more aligned with the goals of the decision maker. Installing the solar-battery system was found in Sec. 4.1 to reduce operational costs by on average  $\pounds724k/year$ . Therefore, by itself the option cost of delaying installation of the solar-battery systems for one year to monitor the buildings and install an optimized system outweighs the benefits of that design optimization (provided by the uncertainty reduction from measurement). The actual cost of performing building monitoring would be higher due to costs associated with delaying the construction project. Hence, the VoI analysis shows that, for this particular energy system design task, reducing uncertainty in the building load profiles through monitoring is not economically worthwhile. I.e. the benefit it provides to improving decision making is less than its cost.

# 4.2.1. Relative importance of reduced uncertainties

The relative importance of each aspect of building load uncertainty (type, peak, mean) for supporting decision making was investigated by repeating the VoI analysis for uncertainty reduction in each parameter independently. Table 3 presents the results of this analysis. Similarly to the classical sensitivity analysis performed in Sec. 4.1, reducing the uncertainty in mean load is found to be of greater importance than uncertainty in the profile shape and peak load, providing roughly twice as much benefit to decision making. However, the VoI based importance analysis provides two key insights which were not identified by purely statistical analysis.

Reduced uncertainties $\mid$ Expected total cost (£m) [%] $\mid$ VoI (£k) [%]					
None (prior)	22.140 [100.0%]	_			
type	$21.972 \ [99.24\%]$	$168\ [0.76\%]$			
peak	$21.951 \ [99.14\%]$	$189\ [0.86\%]$			
mean	$21.748 \ [98.23\%]$	$392\ [1.77\%]$			
All	21.748 [98.23%]	392~[1.77%]			

Table 3: Expected system operating cost and VoI for separate uncertainty reduction in load parameters.

Firstly, the aggregate peak load of the district (i.e. the maximum possible electrical load in the scenario) was found to be uncorrelated with the simulated operating cost, leading the conclusion that it was unimportant for system design. However, the value of reducing uncertainty in building peak load is found to be significant, roughly the same as for profile shape (type). This indicates that whilst the total peak across the district does not influence cost, the peak load in each building is important for design, as information about it allows the solar-battery systems to be better distributed within the district, achieving better load management within each building and so reducing overall operating costs.

Secondly, and more importantly, the VoI of reducing uncertainty in the mean load is found to be the same as that for reducing all uncertainties<sup>6</sup>. This shows that the benefit for decision making support can be obtained by reducing uncertainty in the mean load only. This insight could not be picked up be a traditional statistical analysis, e.g. experimental design techniques, which analyse the contribution of input uncertainties to output uncertainty, and not whether that uncertainty can be practically addressed through improved decision making. This form of insight can only be obtained by applying the VoI methodology.

<sup>&</sup>lt;sup>6</sup>The Value of Information is not additive. This is because different measurements can either contain complementary information which is more useful for decision making when combined, or conversely can contain the same information, meaning the combination of measurements provides less total benefit [53].

## 4.2.2. Alternative system scenarios

The same energy system sizing task was investigated in two alternative building system scenarios to study how the VoI of building load monitoring varied, and whether the conclusions regarding its economic usefulness changed from the base case. These two cases involve designing for a single building energy system, and designing for a district with constrained solar capacity.

Often adjacent buildings are owned by independent parties, and their energy systems are installed at different times with limited cooperation. So, solar-battery systems are frequently designed independently for each building, and for large consumers (e.g. industrial sites) each must contract their own grid connection capacity. Repeating the VoI analysis with a single building, i.e. without district effects, the VoI was found to be £120k, or 2.62% of the prior cost of £4.562m. Whilst in this case the VoI has increased relative to the prior cost, it is still lower than the annual benefit of installing the solar-battery system, which is  $\pounds 148$ k/year. Therefore, it is still not economical to perform building monitoring to support design. It is proposed that the reduction in proportional VoI as more buildings are included in the district is caused by the variability (standard deviation) of the district mean load. Reducing uncertainty in mean load was found to be the most influential factor for improving system design in Sec. 4.2.1, and the district mean load was the greatest driver of cost uncertainty, see Sec. 4.1. As mean load distributions are taken to be independent for each building, by the Central Limit Theorem, the standard deviation of the district mean load as a fraction of that load decays with the number of buildings in the district as  $1/\sqrt{n}$ . Therefore, measurement of the buildings provides less information on the district mean load the more buildings there are. Hence, the less valuable that information is for supporting design. This implies the more buildings there are in the district, the better decisions regarding total storage capacity for bulk energy arbitrage average out across the district, and the less sensitive they are to uncertainty in the mean load.

In many European countries, due to land constraints, buildings are built tall to accommodate more floor area, and do not have spare open spaces nearby. This limits their available roof area, and so the quantity of local solar generation they can accommodate to decarbonize their energy usage. The VoI analysis was repeated for a district of 5 buildings with a constraint on the maximum solar capacity (kWp) per building. This constraint was derived using roof area data from the Cambridge dataset [59]. University buildings in Cambridge with around 100 kW mean load ( $\pm 20\%$ ) were found to have a roof area of approximately 1000 m<sup>2</sup>. Assuming a solar panel power density of 0.15 kWp/m<sup>2</sup> [76, 77], leads to an optimistic constraint of 150 kWp of solar capacity per building. With this constraint, the VoI of building load monitoring was found to be £0. I.e. reducing load uncertainty did not provide *any* benefit for design. Under the formulated operational objective, the primary benefit of the battery system is derived from arbitraging the cheap, zerocarbon solar energy generated by the building solar PV. This is why in the base case, the installed battery capacity of the optimal designs scale linearly with the solar capacity, see Fig. 8. For all scenarios in the solar constrained case, the maximum quantity of solar PV is installed, and so the value that can be derived from arbitraging that energy is fixed. Whilst the optimized system designs for each hypothesised measurement in the constrained case show some variability in the battery and grid capacities installed, these additional capacities provide only small additional benefit from arbitraging cheap and/or low carbon grid electricity, and these benefits are not much more than their costs. As a result, the improvement in design performance provided is negligible.

#### 4.3. Planning risk reduction

In the VoI framework, decision makers are assumed to be risk neutral, and the benefit of data collection is quantified in terms of how much it is able to improve the *average* performance/utility of decisions made. However, in the energy field, decisions makers are sensitive to risk, as it affects their ability to raise capital as well as the interest rates they can access, which impacts the cost of energy decarbonization and so their ability to afford it. For the prior optimal design in the base case, the range of system lifetime costs over the simulations was found to be £14.828m to £29.461m, from a mean of £21.140m (see Fig. 7a in Sec. 4.1). This 66% cost range could be problematic for the financial planning of the district energy system, particularly as the operational costs of energy system (electricity, carbon, and grid excess costs) vary from £4.609m to £19.253m.

The information provided by load monitoring can be used to support this financial planning, as it reduces uncertainty in the operational cost of energy system. In the experiments, after a hypothetical monitoring measurement was taken, the system design was optimized for the corresponding posterior load distribution, and the operation of this system was simulated for scenarios sampled from that posterior, leading to a distribution of total system costs for the design. Fig. 11 plots the distributions over the hypothesised measurements of the standard deviations and ranges of the simulated total system costs for each design (corresponding to a hypothesised measurement), as a proportion of the value for the total cost distribution for the prior design (shown in Fig. 7a). The standard deviation and range of the costs are significantly reduced after measurement, demonstrating that whilst designing the energy system with load monitoring information does not significantly reduce the average system cost, at the time of design and so financing, it substantially reduces the uncertainty in what the system cost will be. Therefore, there may be some additional value to this information for supporting financial decision making. This motivates the use of VoI to study the benefit of data collection to support risk averse decision making, which has yet to be done in an engineering context. This would require the expansion of utility/objective functions to account for the cost of risk. Existing studies have incorporated risk measures into district energy system design objectives to account for risk aversion [71], and these methods are applicable to studying VoI.

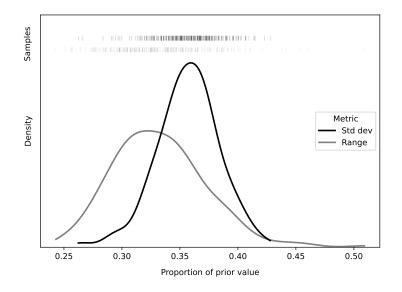


Figure 11: Distribution over hypothesised measurements of standard deviation and range of total cost distribution of optimized system design for each hypothesised measurement (simulated for scenarios drawn from corresponding posterior distribution).

# 4.4. Practical importance & limitations of study

The Value of Information calculations performed in this study (Sec. 4.2) demonstrate that, for the district energy system design task considered, hourly building load data is not worth collecting to support design, i.e. its benefit is less than its cost. This allows practitioners to avoid wasting time and resources on monitoring, and confirms that an opportunity for reducing the cost of decarbonizing building energy is not being missed. Further, showing that limited value is derived from reducing building load profile uncertainty indicates that population level priors constructed from monitoring data from existing buildings are sufficient for designing energy systems in unseen buildings. This provides the first numerical evidence to suggest that current industry practice of designing energy systems using standard building profiles achieves near optimal design performance. However, it is strongly recommended that using Stochastic Optimization techniques which seek designs that perform well over the distribution of building behaviours is critical.

Sec. 4.2.1 found that reducing uncertainty in only the mean load provided all available decision support benefit. This result is highly pertinent for the design of both new building energy systems, and energy retrofits of existing buildings. For new buildings, while load monitoring is not worthwhile to support design, the reduction in mean load uncertainty does provide significant benefit. Therefore, effort should be directed to producing an accurate statistical estimate of building mean load, for instance through detailed building usage modelling, i.e. at room level. Communication between the energy system designer and building owners/occupants regarding the intended use of the building is critical to enabling accurate load estimates, and so low cost energy system designs. For the case of building retrofits, monthly gas and electricity metering data are available. This enables a very good estimate of the mean building electrical load after retrofit, and so using hourly metering data for system sizing would provide no additional benefit.

In this study, only uncertainty in building load was considered for the sake of clarity when demonstrating the VoI methodology. However, several other important factors in the district energy system are subject to significant uncertainty, such as solar generation (which is determined by future weather conditions), asset operational lifetimes which impact their effective cost, and battery degradation (neglected in this model) which affects the efficiency and capacity of the battery units over their lifetime. More detailed system design work should consider these uncertainties in the Stochastic Optimization model to include their influence on the design task and resulting cost distributions. A key difference with these uncertainties is that they are not practically measurable at the time of design, and so should not be studied using VoI, as the resulting values would not be meaningful.

Performing VoI calculations is highly computationally intensive. In the On-Policy VoI framework, system designs must be both determined and evaluated for a large number of hypothesised measurements to achieve sufficient statistical accuracy in the mean utility estimates to enable the correct identification of the true VoI value over statistical error. This limits the complexity/resolution of building energy system models that can be studied with the framework. The computational requirements of the VoI calculations from this study are discussed further in Appendix C.

Finally, the key critique of the VoI framework is that VoI values computed are only valid under the particular model formulation studied, including its assumptions [28]. VoI results cannot be generalized, and changes in the problem setup can significantly alter the VoI, as seen when introducing solar capacity constraints in Sec. 4.2.2. Therefore, further investigation of VoI for supporting building energy system design is required to confirm whether the conclusions made in this study are consistent across different building energy systems, design objectives, and modelling assumptions.

# 5. Conclusions

This study investigated the economic benefit of gathering hourly building energy usage data to support the design of a district energy system, specifically involving the sizing of distributed solar-battery systems to decarbonize building energy usage under grid constraints. A case study district energy system containing 5 university buildings was considered, with probabilistic models of the building load profiles constructed using historic electricity metering data from the Cambridge University estate.

The uncertainty in building load was found to have a significant impact on the total system operating cost, causing a variation of  $\pm 30\%$  for the energy system designed without measurement information available. Additionally, reduction in building load uncertainty from monitoring had a significant effect on the optimized energy system design, with total installed capacities of solar, battery, and grid varying by roughly  $\pm 20\%$  across the hypothesised measurement values. Therefore, existing methods which stop at either of these two points would conclude that using hourly metering data would have a significant effect on system design.

However, performing a Value of Information analysis using the On-Policy VoI framework extension proposed in this work, demonstrated that reducing load uncertainty via monitoring reduces the overall energy system cost by under 2% on average through improved design. This was found to be less than the cost savings achieved by installing solar-battery systems to reduce operating costs over the period needed to monitor the buildings and install systems with improved design. Hence, collecting hourly building monitoring data was determined to be not economically worthwhile for supporting the design of the studied district energy system. Additionally, reducing uncertainty in only the mean load was found to provide all available decision support benefit. Therefore for building retrofits where the mean building load can be well estimated from monthly usage data, using hourly metering data provides no additional benefit for system design. This demonstrates the need for Value of Information analysis to justify and prioritize expenditure on data collection to support decision making, as current analyses can lead to erroneous conclusions regarding the benefit of uncertainty reduction.

These results are important for practitioners, as identifying the low value of load uncertainty reduction for supporting district energy system design allows wasteful delays to monitor building loads to be avoided. Additionally, it indicates that population level priors constructed using monitoring data from existing buildings are sufficient for energy system design. This provides the first numerical evidence to support the sufficiency of existing industry practice of using (distributions of) standard building load profiles for energy system design.

However, as the VoI framework provides no generalization guarantees, further research is required to determine whether the benefit of load monitoring remains below its cost across different energy system setups, different design objectives, and with the inclusion of additional uncertainties. Additionally, further work is required to determine whether uncertainty reduction can provide significant benefit to supporting financial planning through risk reduction.

Value of Information analysis provides a clear methodology for addressing the research gap of quantifying the benefits of uncertainty reduction for supporting decision making in building energy systems. Further, the On-Policy VoI framework proposed in this work enables the study of VoI in the context of more complex decision making tasks, such as energy system control using Model Predictive Control or Reinforcement Learning. With the ability to quantify and compare the benefit of data collection strategies, energy system designers and operators will be able to reduce the overall cost of decarbonizing energy usage, through either avoiding wasteful expenditure on low insight measurement, or identifying new measurement opportunities which enable the greatest cost reductions.

# **CRediT** authorship contribution statement

Max Langtry: Conceptualization, Software, Methodology, Investigation, Writing - Original Draft, Writing - Review & Editing Ruchi Choudhary: Supervision, Writing - Review & Editing

# Declaration of competing interests

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

# Data availability

All code and data used to perform the experiments in this study are available at https://github.com/mal84emma/Building-Design-VoI.

# Acknowledgements

Max Langtry is supported by the Engineering and Physical Sciences Research Council, through the CDT in Future Infrastructure and Built Environment: Resilience in a Changing World, Grant [EP/S02302X/1].

# Appendix A. Case study system parameter specification

Common parameter values specifying the district energy system, probabilistic model of building load, and procedure for sampling from that model, are used across all experiments. Table A.4 provides values for the parameters of the district energy system model, including costs defining the objective/utility, simulation durations, and assumptions regarding battery performance and grid control. All parameters for the probabilistic model of building load are specified within the definition of the probabilistic model in Sec. 3.2. Table A.5 provides the settings used when sampling for the defined distributions, and performing scenario reduction using the Fast Forward technique [70], as implemented in [69].

Parameter	Units	Value	Note/Refs
Carbon cost	$\pounds/\mathrm{kgCO}_2$	1	Chosen to be much greater than current carbon trading prices, c. $\pm 0.1/\text{kgCO}_2$ [78, 79], to reflect building owners' decarbonization priorities.
Battery capacity cost	$\pounds/kWh$	750	[80, 81]
Solar capacity cost	$\pounds/kWp$	1500	[76, 82]; corresponds to LCOE of $\pounds 58.6$ /MWh, in line with expected value [83]
Grid connection capacity cost	$\pounds/kW/day$	0.263	Chosen to be much greater than current costs, c. £0.05/kVA/day [84], to reflect future grid constraints. Converted to per kW value assuming a power factor of 0.95 [85, 86].
Grid connection excess charge	$\pounds/kW/day$	1.053	As above. Current value c. $\pounds 0.08/kVA/day$ [84].
Simulation duration, $T$	Hours	8760	
System lifetime	Years	20	
Design grid safety factor	_	1.25	Determined from initial experiments.
Operation grid safety factor	_	1.01	Determined from initial experiments.
Battery discharge ratio, $\delta$	kW/kWh	0.4	Value for Tesla Powerwall [81]

Table A.4: Parameter values for district energy system used in experiments.

Parameter	Value	
No. samples from prior distribution	1000	
No. samples from each posterior distribution	256	
MCMC sampling burn-in period		
MCMC sampling thinning factor		
No. of reduced scenarios used in Stochastic Program		

Table A.5: Settings for sampling from probabilistic load model used in experiments.

# Appendix B. Details of prior system design

The sizing of grid connection capacity and solar-battery systems for each building determined by the prior design optimization is presented in Table B.6. As all buildings in the district are taken to have identical probabilistic load models and solar generation potentials, in the perfect case, the design optimization would allocated equal asset capacities in all buildings, as on average they behave identically. However, Table B.6 shows significant variation in the solar-battery sizings across the buildings. This occurs as only a small number of reduced scenarios (10) are included in the Stochastic Program model, due to the cubic computational complexity of Linear Programming limiting the number of scenarios which can be considered. Random variation in the mean building loads across the reduced scenarios results in non-uniform sizing across the district.


Table B.7 provides a breakdown of the system operating cost contributions for the prior design across the 256 simulated building load scenarios.

Building no.	Solar capacity (kWp)	Battery capacity (kWh)	Grid con. capacity (kW)
0	600	1,079	_
1	526	874	_
2	635	1,021	_
3	595	1,011	_
4	513	857	-
Total	2869	4842	1,188

Table B.6: Installed asset capacities for prior system design.

Cost	Mean (£m)	Percentage $(\%)$	Std. dev. (£m)
Total LCOE (£/kWh)	<b>22.140</b> 0.252	100.0	<b>2.366</b> 0.0112
Electricity	7.270	32.8	1.409
Carbon	4.650	21.0	0.966
Grid excess	0.002	0.008	0.027
Grid connection	2.283	10.3	_
Battery	3.632	16.4	_
Solar	4.302	19.4	_

Table B.7: Breakdown of cost contributions over sampled scenario simulations for prior system design.

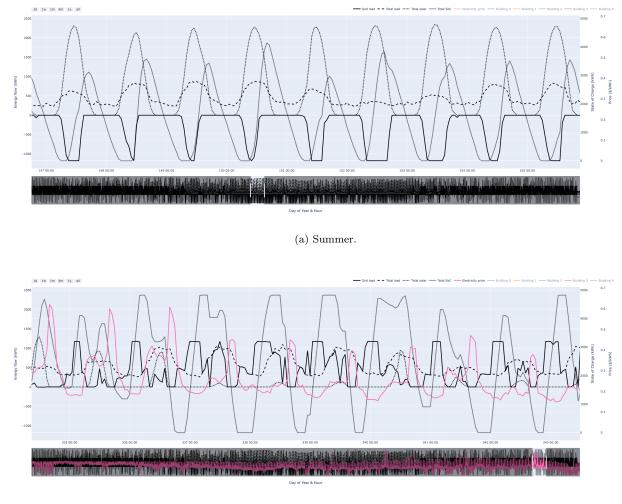

(b) Winter.

Figure B.12: Illustration of operation of prior system across seasons. Interactive version of plot available online here.

Observation of the operational behaviour of the district energy system provides insight into the factors driving system design. Fig. B.12 plots the overall loads and battery state-of-charge in the district when operating over periods in both the summer (Fig. B.12a) and the winter (Fig. B.12b) for one of the sampled load scenarios. Readers can investigate the operational behaviour of the district energy system further using an interactive version of plot available online at https://mal84emma.github.io/Building-Design-VoI/example\_prior\_system\_simulation.html.

Comparing Figs B.12a & B.12b shows that the net peak powers caused by local solar generation in the summer are significantly larger than those caused by building load in the winter. As a result, in the base case without constraints on the solar capacity, the required grid connection capacity is determined by the

quantity of solar PV, and the optimization trades-off grid connection cost with additional cheap, zero-carbon solar energy. This implies that consideration of uncertainty in solar generation in the design optimization is important, as the capacity factor of solar generation will determine the scaling of this trade-off (noting that the peak power is well known as it is approximately the capacity in all years). This behaviour of the district energy system regularly exporting large quantities of energy onto the grid at around noon in the summer may cause issues for regulation of the power grid, as discussed in [87], and will require either adaptation of grid infrastructure to handle reverse power flow, or differentiated pricing for grid export capacity to discourage energy prosumers (customers with local generation) from flooding the grid with solar energy at these peak times. This may then increase the need for local storage to prevent surges in grid export to manage grid stability.

For the majority of the summer, the district draws no power from the grid, though it provides significant quantities of energy to the grid. Therefore, over the summer this district would have zero energy bills. Additionally, as in this model the energy system operator is not paid for supplying energy to the grid, the solar generation capacity is therefore being set by its ability to provide cheap, zero-carbon energy during the spring and autumn to offset grid electricity. It is therefore correlated with the district mean load, as this determines the quantity of energy which must be offset. In future energy systems with large quantities of solar generation, it is likely that during peak generation times the price of grid electricity would fall to approximately zero, or potentially negative, as instantaneous generation exceeds energy demand.

Full depth battery charge cycles are observed in the winter but not the summer. This indicates that the battery capacities are determined by the financial benefit of arbitraging cheap grid electricity for use by the buildings at peak times. These capacities are then sufficient for maximising the usage of local solar energy generation, and managing power peaks to avoid exceeding the grid connection capacity. Fig. B.12b shows that the Model Predictive Controller successfully performs this price arbitrage of energy. On most days of the simulation, the power draw from the grid is near zero at peak demand times (around 5pm). In fact, this distributed generation and storage system reverses the timing of the peaks as the controller is not directed to smooth power usage.

As the district mean load determines the quantity of energy which must be arbitraged to reduce the cost of satisfying building loads at peak times, via the same mechanism as for solar capacity, the optimal battery capacity is therefore also determined by the district mean load. This justifies the correlation between optimized solar and battery capacities observed in Fig. 8.

# Appendix C. Investigation of numerical accuracy & computational requirements

#### Appendix C.1. Statistical accuracy

As the Value of Information is the difference of two expectations, the prior and pre-posterior expected utilities (see Eqn. 3), which are estimated using Monte Carlo sampling, the computed VoI values are statistical estimates of some underlying true value. The statistical accuracy of these estimates must therefore be considered before firm conclusions can drawn regarding whether data collection is worthwhile.

Fig. C.13 plots the convergence of the prior and pre-posterior expected utility estimates, as well as the VoI estimate, as the number of samples from the building load distribution (scenarios, with corresponding designs and simulations) used increases. It also plots 95% confidence intervals for the expectations using the standard error on the sample mean. For the VoI estimate, the VoI is considered as a single expectation, and the standard error is computed for the convergent sequence of VoI estimates. The expectation estimates are seen converge within the 256 samples used in the experiments, providing very similar estimates for all metrics after only 128 samples. This indicates that the VoI values computed in the experiments have sufficient statistical accuracy to support the hypothesis that the VoI is smaller than the cost of measurement, and therefore building monitoring is not financially worthwhile for supporting system design.

In this study a naive sampling scheme was used to sample from the building load distribution. The use of improved sampling techniques which provide greater sample efficiency for the load distribution would speed up the convergence of the expectation estimates, and so reduce the computational cost of achieving sufficient

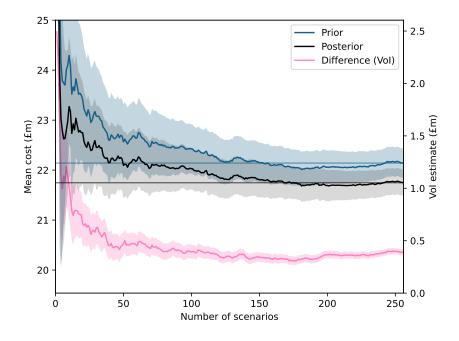


Figure C.13: Convergence of Monte Carlo estimates of expected utilities with number of samples from building load distribution.

statistical accuracy in the VoI estimates. Further work is required to properly quantify the statistical error of VoI estimates, and develop techniques for determining the number of samples required to achieve sufficient statistical accuracy to support conclusions drawn from the VoI, i.e. whether it is greater or less than some cost threshold. Such developments are necessary to reduce the computational cost of VoI calculations, to allow the study of complex, practical engineering decision problems, whilst providing confidence that the data collection strategy recommendations they produce are correct with high probability.

### Appendix C.2. Cost estimation accuracy

The On-Policy VoI framework proposed in Sec. 2.3 enables the VoI to be computed for complex decision problems where policies which do not necessarily provide an accurate estimate of the decision utility must be used for computational tractability. For the case study considered in this work, Stochastic Programming (SP) is needed to optimize the energy system sizing as the number of decision variables and simulation time makes the application of stochastic global optimization methods directly to the simulator intractable. However, the SP's estimate of mean system cost (expected utility) suffers from two sources of inaccuracy.

Firstly, the SP can only include 10 scenarios in its Monte Carlo estimate of mean operational cost within its objective function to run in a manageable computation time. This leads to potentially significant statistical error in the estimate of cost that is minimized. An attempt is made to manage this by using scenario reduction to select the 10 samples/scenarios that provide the best statistical representation of the population. However, as the space of possible load profiles is extremely large, only simple summary statistics could be used as the targeted statistical metric to represent, meaning the selection of scenarios to include in the SP does not have a direct link to the distribution of operational costs. Secondly, modelling error is introduced as the Linear Program formulation of the decision problem requires the assumption that the energy system is controlled with perfect foresight of the operational conditions, i.e. the weather and electricity price is known perfectly for all future periods during control. This assumption is not realistic and can lead to the SP model underestimating operational costs as the system is able to pre-empt difficult operational conditions and make unrealistically good control decisions in advance to reduce overall cost. In the case of managing the grid impact of energy usage under load uncertainty this assumption can be particularly over-optimistic, as unforeseen load conditions can lead to the battery state-of-charge not being sufficient to manage large peak loads, leading to substantial grid excess charges. Assuming perfect foresight allows the system to manage the battery level to avoid these instances, and causes a significant underestimate of operational cost. In fact, it is this over-optimism regarding the system's ability to manage peak loads that leads to the need to include a factor-of-safety on grid capacity during design.

Therefore, as these model and statistical errors could lead to significant inaccuracy in the SP's estimate of operating costs, a simulation step was included to provide a more accurate estimate of the true costs. These simulations used a Model Predictive Controller with only 48 hours of perfect foresight<sup>7</sup>, and evaluated a large number of sampled load scenarios to overcome both the model and statistical inaccuracies.

The accuracy of the Stochastic Program model objective was investigated by comparing it to the mean system operating costs determined by simulation. Table C.8 provides both the mean error and mean absolute error of the SP objective for system designs performed with both the prior and posterior distributions, across the range of cases considered in the experiments. Fig. C.14 plots the distribution of objective errors for the SP designs performed for each measurement scenario in the base case, where all uncertainties were reduced.

Case	Mean error $(\%)$	Mean absolute error $(\%)$
Prior cases (as considered in Sec. 4.2.2) - point estimates		
Base	0.724	_
Solar constrained	0.509	_
1 building	-0.246	0.246
Posterior cases (as defined in Table 3 of Sec. 4.2.1) - av. over 256 msrmnts.		
type	-0.147	0.682
peak	-0.646	1.238
mean	-0.791	1.232
All (base)	-0.534	0.598

Table C.8: Errors in SP estimates of mean system operating costs for optimized designs (under-estimation +ve).

The results show that the Stochastic Program is able to estimate the mean operating cost within around 1-1.5%, and in fact more frequently over-estimates the cost than under-estimates. This result is somewhat surprising considering that only 10 scenarios are considered in the SP objective, and these scenarios were selected in a simplistic manner. From the plots of operational behaviour (Fig. B.12) it can be seen that battery charge is rarely held for more than 72 hours, which indicates that during operation, assumption of complete perfect foresight would not lead to significant under-estimation of operational costs. However, this also demonstrates that the factor-of-safety used during design is performing well as the system does not end up in situations where is does not have the state-of-charge needed to manage peak loads. Additionally, as district mean load was one of the metrics used in scenario reduction, and was found to be the key driver of operational cost (Sec. 4.1), the scenario reduction was able to well represent the distribution of costs through correlation.

<sup>&</sup>lt;sup>7</sup>This controller is still unrealistic, as perfect foresight even over a limited planning horizon leads to practically unachievably low operational costs, as demonstrated in [74]. Whilst it would not be feasible to train practical prediction algorithms to use in each simulation, a controller using synthetically noisy forecasts calibrated to the properties of practical forecasting methods could be used to improve the realism of the simulated operation and resulting costs.

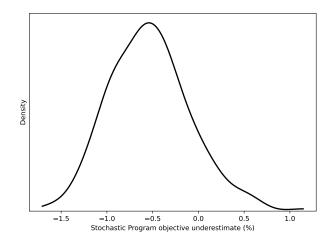


Figure C.14: Distribution of Stochastic Program objective value errors compared to simulated mean operating costs for posterior designs in base case.

However, whilst the SP objective error is relatively low, it is approximately the same magnitude as the VoI, which was 1.77% in the base case. An additional 1.5% error cost error added to the VoI estimate could have led to the conclusion that building monitoring was economically worthwhile, as it would have put it at the save level as the estimated cost of performing the measurement. However, the impact of the SP objective error on the VoI estimate is complex, as it depends on the error in the difference between the prior and pre-posterior cost estimates, which is challenging to study. Ultimately, verifying that the error is sufficiently low may as computationally expensive as performing the simulations required by the On-Policy VoI calculation.

### Appendix C.3. Computational cost

The computational cost of the experiments performed in this study was very large, with each VoI calculation taking roughly 10 days of computation time on a powerful desktop workstation<sup>8</sup> with a parallel processing workflow. Performing the simulations took approximately 80% of runtime.

Reducing the number of samples required by the Monte Carlos estimates of expected utilities or removing the need for simulation to accurately estimate utilities would greatly decrease the computational burden of VoI calculations. However, a key advantage of VoI calculations is that they are highly parallelizable, as each scenario can be evaluated independently, making them well suited for distributed computation. I.e. the optimization based design and simulator evaluation can be perform simultaneously for each measurement scenario given sufficient hardware.

 $<sup>^832</sup>$  core, 2.90 GHz Intel Xeon Gold CPU with 256 GB of DDR4 RAM.

## References

- EEA, Decarbonising heating and cooling a climate imperative, Briefing, European Environment Agency (Feb. 2023). URL https://www.eea.europa.eu/publications/decarbonisation-heating-and-cooling
- [2] CCC, Sixth Carbon Budget, Tech. rep., Climate Change Comittee (Dec. 2020). URL https://www.theccc.org.uk/publication/sixth-carbon-budget/
- [3] House of Commons, Decarbonising heat in homes: Seventh Report of Session 2021–22, Tech. rep., House of Commons Business, Energy and Industrial Strategy Committee (Feb. 2022).

 ${\rm URL\ https://committees.parliament.uk/publications/8742/documents/88647/default/}$ 

- [4] IEA, Net Zero by 2050 A Roadmap for the Global Energy Sector, Tech. rep., International Energy Agency (Oct. 2021). URL https://iea.blob.core.windows.net/assets/deebef5d-0c34-4539-9d0c-10b13d840027/ NetZeroby2050-ARoadmapfortheGlobalEnergySector\_CORR.pdf
- S. Heinen, P. Mancarella, C. O'Dwyer, M. O'Malley, Heat Electrification: The Latest Research in Europe, IEEE Power and Energy Magazine 16 (4) (2018) 69-78. doi:10.1109/MPE.2018.2822867.
   URL https://ieeexplore.ieee.org/abstract/document/8386884
- M. Zhang, M.-A. Millar, Z. Yu, J. Yu, An assessment of the impacts of heat electrification on the electric grid in the UK, Energy Reports 8 (2022) 14934-14946. doi:10.1016/j.egyr.2022.10.408.
   URL https://www.sciencedirect.com/science/article/pii/S2352484722023393
- [7] V. M. Charitopoulos, M. Fajardy, C. K. Chyong, D. M. Reiner, The impact of 100% electrification of domestic heat in Great Britain, iScience 26 (11) (2023) 108239. doi:10.1016/j.isci.2023.108239.
   URL https://www.sciencedirect.com/science/article/pii/S2589004223023167
- [8] M. Blonsky, A. Nagarajan, S. Ghosh, K. McKenna, S. Veda, B. Kroposki, Potential Impacts of Transportation and Building Electrification on the Grid: A Review of Electrification Projections and Their Effects on Grid Infrastructure, Operation, and Planning, Current Sustainable/Renewable Energy Reports 6 (4) (2019) 169–176. doi:10.1007/s40518-019-00140-5. URL https://doi.org/10.1007/s40518-019-00140-5
- BEIS, Powering Up Britain, Tech. rep., HM Government (Mar. 2023).
   URL https://assets.publishing.service.gov.uk/media/642468ff2fa8480013ec0f39/powering-up-britain-joint-overview.
   pdf
- [10] Department for Business and Trade, UK Battery Strategy, Tech. rep., HM Government (Oct. 2023).
   URL https://assets.publishing.service.gov.uk/media/656ef4871104cf000dfa74f3/uk-battery-strategy.pdf
- [11] S. Haben, S. Young, ADViCE: AI for Decarbonisation Challenges, Tech. rep., The Alan Turing Institute (Dec. 2023). URL https://www.turing.ac.uk/sites/default/files/2023-12/advice-\_ai\_for\_decarbonisation\_challenges.pdf
- [12] B. Li, Z. Liu, Y. Wu, P. Wang, R. Liu, L. Zhang, Review on photovoltaic with battery energy storage system for power supply to buildings: Challenges and opportunities, Journal of Energy Storage 61 (2023) 106763. doi:10.1016/j.est. 2023.106763.

URL https://www.sciencedirect.com/science/article/pii/S2352152X23001603

- [13] N. Niveditha, M. M. Rajan Singaravel, Optimal sizing of hybrid PV-Wind-Battery storage system for Net Zero Energy Buildings to reduce grid burden, Applied Energy 324 (2022) 119713. doi:10.1016/j.apenergy.2022.119713. URL https://www.sciencedirect.com/science/article/pii/S0306261922010054
- P. Sharma, M. Kolhe, A. Sharma, Economic performance assessment of building integrated photovoltaic system with battery energy storage under grid constraints, Renewable Energy 145 (2020) 1901–1909. doi:10.1016/j.renene.2019. 07.099.

URL https://www.sciencedirect.com/science/article/pii/S096014811931119X

[15] L. Novoa, R. Flores, J. Brouwer, Optimal renewable generation and battery storage sizing and siting considering local

transformer limits, Applied Energy 256 (2019) 113926. doi:10.1016/j.apenergy.2019.113926.

 ${\rm URL\ https://www.sciencedirect.com/science/article/pii/S0306261919316137}$ 

- [16] M. Salvador, S. Grieu, Methodology for the design of energy production and storage systems in buildings: Minimization of the energy impact on the electricity grid, Energy and Buildings 47 (2012) 659-673. doi:10.1016/j.enbuild.2012.01.006. URL https://www.sciencedirect.com/science/article/pii/S0378778812000084
- [17] G. Tumminia, F. Guarino, S. Longo, D. Aloisio, S. Cellura, F. Sergi, G. Brunaccini, V. Antonucci, M. Ferraro, Grid interaction and environmental impact of a net zero energy building, Energy Conversion and Management 203 (2020) 112228. doi:10.1016/j.enconman.2019.112228.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/S0196890419312348}$ 

- [18] IRENA, Renewable power generation costs in 2022, Tech. rep., International Renewable Energy Agency (Aug. 2023). URL https://www.irena.org/Publications/2023/Aug/Renewable-Power-Generation-Costs-in-2022
- [19] A. Deroubaix, I. Labuhn, M. Camredon, B. Gaubert, P.-A. Monerie, M. Popp, J. Ramarohetra, Y. Ruprich-Robert, L. G. Silvers, G. Siour, Large uncertainties in trends of energy demand for heating and cooling under climate change, Nature Communications 12 (1) (2021) 5197. doi:10.1038/s41467-021-25504-8. URL https://www.nature.com/articles/s41467-021-25504-8
- [20] R. Egging-Bratseth, H. Kauko, B. R. Knudsen, S. A. Bakke, A. Ettayebi, I. R. Haufe, Seasonal storage and demand side management in district heating systems with demand uncertainty, Applied Energy 285 (2021) 116392. doi:10.1016/j. apenergy.2020.116392.

 ${\rm URL\ https://www.sciencedirect.com/science/article/pii/S0306261920317645}$ 

[21] L. Zhu, J. Zhang, Y. Gao, W. Tian, Z. Yan, X. Ye, Y. Sun, C. Wu, Uncertainty and sensitivity analysis of cooling and heating loads for building energy planning, Journal of Building Engineering 45 (2022) 103440. doi:10.1016/j.jobe.2021. 103440.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/S2352710221012985}$ 

[22] J. DeCarolis, H. Daly, P. Dodds, I. Keppo, F. Li, W. McDowall, S. Pye, N. Strachan, E. Trutnevyte, W. Usher, M. Winning, S. Yeh, M. Zeyringer, Formalizing best practice for energy system optimization modelling, Applied Energy 194 (2017) 184-198. doi:10.1016/j.apenergy.2017.03.001.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/S0306261917302192}$ 

- [23] M. Fodstad, P. Crespo del Granado, L. Hellemo, B. R. Knudsen, P. Pisciella, A. Silvast, C. Bordin, S. Schmidt, J. Straus, Next frontiers in energy system modelling: A review on challenges and the state of the art, Renewable and Sustainable Energy Reviews 160 (2022) 112246. doi:10.1016/j.rser.2022.112246. URL https://www.sciencedirect.com/science/article/pii/S136403212200168X
- [24] G. Mavromatidis, K. Orehounig, J. Carmeliet, A review of uncertainty characterisation approaches for the optimal design of distributed energy systems, Renewable and Sustainable Energy Reviews 88 (2018) 258-277. doi:10.1016/j.rser.2018.02.021.

URL https://www.sciencedirect.com/science/article/pii/S1364032118300510

- [25] W. Tian, Y. Heo, P. de Wilde, Z. Li, D. Yan, C. S. Park, X. Feng, G. Augenbroe, A review of uncertainty analysis in building energy assessment, Renewable and Sustainable Energy Reviews 93 (2018) 285-301. doi:10.1016/j.rser.2018.05.029. URL https://www.sciencedirect.com/science/article/pii/S136403211830368X
- [26] D. Connolly, H. Lund, B. V. Mathiesen, M. Leahy, A review of computer tools for analysing the integration of renewable energy into various energy systems, Applied Energy 87 (4) (2010) 1059-1082. doi:10.1016/j.apenergy.2009.09.026. URL https://www.sciencedirect.com/science/article/pii/S0306261909004188
- [27] DESNZ, Update on the rollout of smart meters, Tech. rep., Department for Energy Security & Net Zero (Jun. 2023). URL https://www.nao.org.uk/wp-content/uploads/2023/06/update-on-the-rollout-of-smart-meters.pdf

- M. Langtry, C. Zhuang, R. Ward, N. Makasis, M. J. Kreitmair, Z. Xuereb Conti, D. Di Francesco, R. Choudhary, Value of Information Analysis for rationalising information gathering in building energy analysis, in: Building Simulation 2023, Vol. 18 of Building Simulation, IBPSA, 2023, pp. 3483-3490. doi:10.26868/25222708.2023.1478. URL https://publications.ibpsa.org/conference/paper/?id=bs2023\_1478
- [29] J. Niu, X. Li, Z. Tian, H. Yang, A framework for quantifying the value of information to mitigate risk in the optimal design of distributed energy systems under uncertainty, Applied Energy 350 (2023) 121717. doi:10.1016/j.apenergy. 2023.121717.

 ${\rm URL\ https://www.sciencedirect.com/science/article/pii/S0306261923010814}$ 

- [30] E. Acar, K. Solanki, System reliability based vehicle design for crashworthiness and effects of various uncertainty reduction measures, Structural and Multidisciplinary Optimization 39 (3) (2009) 311-325. doi:10.1007/s00158-008-0327-3. URL https://doi.org/10.1007/s00158-008-0327-3
- [31] E. Prataviera, J. Vivian, G. Lombardo, A. Zarrella, Evaluation of the impact of input uncertainty on urban building energy simulations using uncertainty and sensitivity analysis, Applied Energy 311 (2022) 118691. doi:10.1016/j.apenergy.2022. 118691.

 ${\rm URL\ https://www.sciencedirect.com/science/article/pii/S0306261922001568}$ 

- [32] W. Gang, S. Wang, K. Shan, D. Gao, Impacts of cooling load calculation uncertainties on the design optimization of building cooling systems, Energy and Buildings 94 (2015) 1-9. doi:10.1016/j.enbuild.2015.02.032. URL https://www.sciencedirect.com/science/article/pii/S0378778815001371
- [33] G. Mavromatidis, K. Orehounig, J. Carmeliet, Uncertainty and global sensitivity analysis for the optimal design of distributed energy systems, Applied Energy 214 (2018) 219-238. doi:10.1016/j.apenergy.2018.01.062. URL https://www.sciencedirect.com/science/article/pii/S0306261918300710
- [34] T. Liu, W. Jiao, X. Tian, A framework for uncertainty and sensitivity analysis of district energy systems considering different parameter types, Energy Reports 7 (2021) 6908-6920. doi:10.1016/j.egyr.2021.10.064. URL https://www.sciencedirect.com/science/article/pii/S2352484721010817
- [35] R. Khezri, A. Mahmoudi, H. Aki, Optimal planning of solar photovoltaic and battery storage systems for grid-connected residential sector: Review, challenges and new perspectives, Renewable and Sustainable Energy Reviews 153 (2022) 111763. doi:10.1016/j.rser.2021.111763.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/S1364032121010339}$ 

[36] E. O'Shaughnessy, D. Cutler, K. Ardani, R. Margolis, Solar plus: Optimization of distributed solar PV through battery storage and dispatchable load in residential buildings, Applied Energy 213 (2018) 11-21. doi:10.1016/j.apenergy.2017. 12.118.

URL https://www.sciencedirect.com/science/article/pii/S0306261917318421

[37] E. Sadeghibakhtiar, A. Naeimi, S. Naderi, G. Pignatta, A. Behbahaninia, Size optimization of a stand-alone solar-windbattery hybrid system for net zero energy buildings: A case study, Energy and Buildings 313 (2024) 114204. doi: 10.1016/j.enbuild.2024.114204.

URL https://www.sciencedirect.com/science/article/pii/S0378778824003207

- B. Pickering, R. Choudhary, District energy system optimisation under uncertain demand: Handling data-driven stochastic profiles, Applied Energy 236 (2019) 1138-1157. doi:10.1016/j.apenergy.2018.12.037. URL https://www.sciencedirect.com/science/article/pii/S0306261918318555
- [39] X. Zhu, X. Zhang, P. Gong, Y. Li, A review of distributed energy system optimization for building decarbonization, Journal of Building Engineering 73 (2023) 106735. doi:10.1016/j.jobe.2023.106735. URL https://www.sciencedirect.com/science/article/pii/S2352710223009142
- [40] B. Liu, Y. Wang, 6 Energy system optimization under uncertainties: A comprehensive review, in: J. Ren, Y. Wang,

C. He (Eds.), Towards Sustainable Chemical Processes, Elsevier, 2020, pp. 149–170. doi:10.1016/B978-0-12-818376-2. 00006-5.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/B9780128183762000065}$ 

- [41] À. Alonso-Travesset, H. Martín, S. Coronas, J. de la Hoz, Optimization Models under Uncertainty in Distributed Generation Systems: A Review, Energies 15 (5) (2022) 1932. doi:10.3390/en15051932.
   URL https://www.mdpi.com/1996-1073/15/5/1932
- Y. Sun, Sensitivity analysis of macro-parameters in the system design of net zero energy building, Energy and Buildings 86 (2015) 464-477. doi:10.1016/j.enbuild.2014.10.031.

 ${\rm URL}\ {\tt https://www.sciencedirect.com/science/article/pii/S0378778814008767}$ 

- [43] S. Sanajaoba Singh, E. Fernandez, Modeling, size optimization and sensitivity analysis of a remote hybrid renewable energy system, Energy 143 (2018) 719-731. doi:10.1016/j.energy.2017.11.053. URL https://www.sciencedirect.com/science/article/pii/S0360544217319023
- [44] H. Raiffa, Review of Decision Analysis: Introductory Lectures on Choices Under Uncertainty., The Journal of Finance 24 (5) (1969) 1000-1003. arXiv:2325714, doi:10.2307/2325714.
   URL https://www.jstor.org/stable/2325714
- [45] R. A. Howard, Information Value Theory, IEEE Transactions on Systems Science and Cybernetics 2 (1) (1966) 22-26. doi:10.1109/TSSC.1966.300074.

 ${\rm URL\ https://ieeexplore.ieee.org/abstract/document/4082064}$ 

- [46] W.-H. Zhang, D.-G. Lu, J. Qin, S. Thöns, M. H. Faber, Value of information analysis in civil and infrastructure engineering: A review, Journal of Infrastructure Preservation and Resilience 2 (1) (2021) 16. doi:10.1186/s43065-021-00027-0. URL https://doi.org/10.1186/s43065-021-00027-0
- [47] J. W. Pratt, H. Raiffa, R. Schlaifer, Introduction to Statistical Decision Theory, MIT Press, 1995.
- [48] J. M. Keisler, Z. A. Collier, E. Chu, N. Sinatra, I. Linkov, Value of information analysis: The state of application, Environment Systems and Decisions 34 (1) (2014) 3-23. doi:10.1007/s10669-013-9439-4. URL https://doi.org/10.1007/s10669-013-9439-4
- [49] M. N. Grussing, Optimized Building Component Assessment Planning Using a Value of Information Model, Journal of Performance of Constructed Facilities 32 (4) (2018) 04018054. doi:10.1061/(ASCE)CF.1943-5509.0001198. URL https://ascelibrary.org/doi/10.1061/%28ASCE%29CF.1943-5509.0001198
- [50] H. O. V. Myklebust, J. Eidsvik, I. B. Sperstad, D. Bhattacharjya, Value of Information Analysis for Complex Simulator Models: Application to Wind Farm Maintenance, Decision Analysis 17 (2) (2020) 134–153. doi:10.1287/deca.2019.0405. URL https://pubsonline.informs.org/doi/abs/10.1287/deca.2019.0405
- [51] M. Esnaashary Esfahani, C. Rausch, C. Haas, B. T. Adey, Prioritizing Preproject Planning Activities Using Value of Information Analysis, Journal of Management in Engineering 36 (5) (2020) 04020064. doi:10.1061/(ASCE)ME.1943-5479. 0000822.

URL https://ascelibrary.org/doi/10.1061/%28ASCE%29ME.1943-5479.0000822

- [52] D. Di Francesco, M. Chryssanthopoulos, M. H. Faber, U. Bharadwaj, Decision-theoretic inspection planning using imperfect and incomplete data, Data-Centric Engineering 2 (2021) e18. doi:10.1017/dce.2021.18.
  - ${\rm URL\ https://www.cambridge.org/core/product/identifier/S2632673621000186/type/journal\_article}$
- [53] D. Di Francesco, M. Langtry, A. B. Duncan, C. Dent, System Effects in Identifying Risk-Optimal Data Requirements for Digital Twins of Structures (Sep. 2023). arXiv:2309.07695, doi:10.48550/arXiv.2309.07695. URL http://arxiv.org/abs/2309.07695
- [54] E. M. Modiano, Derived Demand and Capacity Planning under Uncertainty, Operations Research 35 (2) (1987) 185–197.
   arXiv:170690.

URL https://www.jstor.org/stable/170690

- [55] P. Krukanont, T. Tezuka, Implications of capacity expansion under uncertainty and value of information: The near-term energy planning of Japan, Energy 32 (10) (2007) 1809-1824. doi:10.1016/j.energy.2007.02.003. URL https://www.sciencedirect.com/science/article/pii/S0360544207000333
- [56] M. Fürsch, S. Nagl, D. Lindenberger, Optimization of power plant investments under uncertain renewable energy deployment paths: A multistage stochastic programming approach, Energy Systems 5 (1) (2014) 85-121. doi:10.1007/ s12667-013-0094-0.

URL https://doi.org/10.1007/s12667-013-0094-0

- [57] Z. A. Wendling, Bridges beyond renewable energy: Decarbonizing the global electricity sector under uncertainty, Energy Research & Social Science 48 (2019) 235-245. doi:10.1016/j.erss.2018.09.020.
   URL https://www.sciencedirect.com/science/article/pii/S2214629618310387
- [58] C. a. B. Smith, Theory of Games and Economic Behaviour. By John Von Neumann and Oskar Morgenstern. Pp. xviii, 625. 66s. 6d. 1944. (Princeton U.P.; Humphrey Milford), The Mathematical Gazette 29 (285) (1945) 131–133. doi:10.2307/3610940.

URL https://www.cambridge.org/core/journals/mathematical-gazette/article/abs/theory-of-games-and-economic-behaviour-by-76E26E70D0D9B6AF26DB67A6A10D58CF

[59] M. Langtry, R. Choudhary, Cambridge University Estates building energy usage archive (Apr. 2024). doi:10.5281/ zenodo.10955332.

 ${\rm URL}\ {\tt https://github.com/EECi/Cambridge-Estates-Building-Energy-Archive}$ 

- [60] S. Pfenninger, I. Staffell, Long-term patterns of European PV output using 30 years of validated hourly reanalysis and satellite data, Energy 114 (2016) 1251-1265. doi:10.1016/j.energy.2016.08.060. URL https://www.sciencedirect.com/science/article/pii/S0360544216311744
- [61] I. Staffell, S. Pfenninger, Using bias-corrected reanalysis to simulate current and future wind power output, Energy 114 (2016) 1224-1239. doi:10.1016/j.energy.2016.08.068.
   URL https://www.sciencedirect.com/science/article/pii/S0360544216311811
- [62] Energy Stats UK, Historical pricing data octopus agile eastern england (Jul. 2023). URL https://energy-stats.uk/download-historical-pricing-data/
- [63] National Grid ESO, Historic generation mix & carbon intensity (Mar. 2020).
   URL https://data.nationalgrideso.com/carbon-intensity1/historic-generation-mix
- [64] B. Carpenter, A. Gelman, M. D. Hoffman, D. Lee, B. Goodrich, M. Betancourt, M. A. Brubaker, J. Guo, P. Li, A. Riddell, Stan: A Probabilistic Programming Language, Journal of statistical software 76 (2017) 1. doi:10.18637/jss.v076.i01. URL https://www.ncbi.nlm.nih.gov/pmc/articles/PMC9788645/
- [65] X. Yue, S. Pye, J. DeCarolis, F. G. N. Li, F. Rogan, B. Ó. Gallachóir, A review of approaches to uncertainty assessment in energy system optimization models, Energy Strategy Reviews 21 (2018) 204-217. doi:10.1016/j.esr.2018.06.003. URL https://www.sciencedirect.com/science/article/pii/S2211467X18300543
- [66] Open Energy Modelling Initiative Wiki (Jan. 2024). URL https://wiki.openmod-initiative.org/wiki/Main\_Page
- S. Acha, G. Vieira, M. Bird, N. Shah, Modelling UK electricity regional costs for commercial buildings, Energy and Buildings 271 (2022) 112301. doi:10.1016/j.enbuild.2022.112301.
   URL https://www.sciencedirect.com/science/article/pii/S0378778822004728
- [68] F. Economics, Network Tariffs for Energy Intensive Industry: Evaluation of rationale for exemptions, Tech. rep., Frontier Economics (Dec. 2022).

 $\label{eq:url:linear} URL\, \texttt{https://assets.publishing.service.gov.uk/media/649be812f90109001281891c/annex-b-frontier-economics-report-on-network-product and the second second$ 

pdf

- [69] D. Gioia, ScenarioReducer (Jun. 2023). URL https://github.com/DanieleGioia/ScenarioReducer
- [70] H. Heitsch, W. Römisch, Scenario Reduction Algorithms in Stochastic Programming, Computational Optimization and Applications 24 (2) (2003) 187–206. doi:10.1023/A:1021805924152.

 ${\rm URL}\ {\tt https://doi.org/10.1023/A:1021805924152}$ 

- B. C. Pickering, Practical Optimisation of District Energy Systems: Representation of Technology Characteristics, Demand Uncertainty, and System Robustness (May 2019). doi:10.17863/CAM.39849.
   URL https://www.repository.cam.ac.uk/handle/1810/292696
- [72] J. R. Vázquez-Canteli, J. Kämpf, G. Henze, Z. Nagy, CityLearn v1.0: An OpenAI Gym Environment for Demand Response with Deep Reinforcement Learning, in: Proceedings of the 6th ACM International Conference on Systems for Energy-Efficient Buildings, Cities, and Transportation, ACM, New York NY USA, 2019, pp. 356–357. doi:10.1145/3360322. 3360998.

URL https://dl.acm.org/doi/10.1145/3360322.3360998

[73] J. R. Vazquez-Canteli, S. Dey, G. Henze, Z. Nagy, CityLearn: Standardizing Research in Multi-Agent Reinforcement Learning for Demand Response and Urban Energy Management (Dec. 2020). arXiv:2012.10504, doi:10.48550/arXiv. 2012.10504.

URL http://arxiv.org/abs/2012.10504

[74] M. Langtry, V. Wichitwechkarn, R. Ward, C. Zhuang, M. J. Kreitmair, N. Makasis, Z. Xuereb Conti, R. Choudhary, Impact of data for forecasting on performance of model predictive control in buildings with smart energy storage, Energy and Buildings 320 (2024) 114605. doi:10.1016/j.enbuild.2024.114605.

 ${\rm URL\ https://www.sciencedirect.com/science/article/pii/S0378778824007217}$ 

- [75] Z. Pang, Z. O'Neill, Y. Li, F. Niu, The role of sensitivity analysis in the building performance analysis: A critical review, Energy and Buildings 209 (2020) 109659. doi:10.1016/j.enbuild.2019.109659.
   URL https://www.sciencedirect.com/science/article/pii/S0378778819319164
- [76] D. Gawley, P. McKenzie, Investigating the suitability of GIS and remotely-sensed datasets for photovoltaic modelling on building rooftops, Energy and Buildings 265 (2022) 112083. doi:10.1016/j.enbuild.2022.112083. URL https://www.sciencedirect.com/science/article/pii/S0378778822002547
- [77] P. Gagnon, R. Margolis, J. Melius, C. Phillips, R. Elmore, Estimating rooftop solar technical potential across the US using a combination of GIS-based methods, lidar data, and statistical modeling, Environmental Research Letters 13 (2) (2018) 024027. doi:10.1088/1748-9326/aaa554.

URL https://dx.doi.org/10.1088/1748-9326/aaa554

[78] DESNZ, UK ETS: Carbon prices for use in civil penalties, 2023.

URL https://www.gov.uk/government/publications/determinations-of-the-uk-ets-carbon-price/ uk-ets-carbon-prices-for-use-in-civil-penalties-2023

- [79] Bloomberg, EU ETS Market Outlook 1H 2024: Prices Valley Before Rally | BloombergNEF (May 2024). URL https://web.archive.org/web/20240523100529/https://about.bnef.com/blog/eu-ets-market-outlook-1h-2024-prices-valley-1
- [80] Mott MacDonald, Storage cost and technical assumptions for BEIS: Summary document, Tech. rep. (Aug. 2018). URL https://assets.publishing.service.gov.uk/media/5f3cf6c9d3bf7f1b0fa7a165/storage-costs-technical-assumptions-2018. pdf
- [81] Forbes Home, How Much Does The Tesla Powerwall Cost? (2024) (May 2024).
  - URL https://web.archive.org/web/20240511112531/https://www.forbes.com/home-improvement/solar/ tesla-powerwall-solar-battery-review/

- [82] E.ON Energy, Solar Panel Cost (Jan. 2024). URL https://web.archive.org/web/20240128072106/https://www.eonenergy.com/solar-panels/cost.html
- [83] DESNZ, Electricity generation costs 2023, Tech. rep., Department for Energy Security & Net Zero (Nov. 2023). URL https://assets.publishing.service.gov.uk/media/6556027d046ed400148b99fe/electricity-generation-costs-2023. pdf
- [84] E. P. Networks, Eastern Power Networks plc: Use of System Charging Statement, Tech. rep., UK Power Networks (Nov. 2023).

URL https://media.umbraco.io/uk-power-networks/gwcflqcq/eastern-power-networks-lc14-statement-2023-v1-4. pdf

- [85] EEPower, Power Factor: Determining how Much Electricity Your Power System Consumes Technical Articles (Sep. 2022). URL https://eepower.com/technical-articles/power-factor-determining-how-much-electricity-your-power-system-consumes/
- [86] H. C. Anderson, A. Al Hadi, E. S. Jones, D. M. Ionel, Power Factor and Reactive Power in US Residences Survey and EnergyPlus Modeling, in: 2021 10th International Conference on Renewable Energy Research and Application (ICRERA), IEEE, Istanbul, Turkey, 2021, pp. 418-422. doi:10.1109/ICRERA52334.2021.9598561. URL https://ieeexplore.ieee.org/document/9598561/
- [87] C. D. Iweh, S. Gyamfi, E. Tanyi, E. Effah-Donyina, Distributed Generation and Renewable Energy Integration into the Grid: Prerequisites, Push Factors, Practical Options, Issues and Merits, Energies 14 (17) (2021) 5375. doi:10.3390/ en14175375.

URL https://www.mdpi.com/1996-1073/14/17/5375