A comparative study of different TSO-DSO coordination in the reserve market

1st Hang Nguyen Electrical Energy Systems Group Eindhoven University of Technology Eindhoven, The Netherlands t.h.nguyen@tue.nl 2rd Phuong Nguyen Electrical Energy Systems Group Eindhoven University of Technology Eindhoven, The Netherlands P.Nguyen.Hong@tue.nl 3nd Koen Kok Electrical Energy Systems Group Eindhoven University of Technology Eindhoven, The Netherlands j.k.kok@tue.nl

Abstract-The increasing penetration of Distributed Energy Resources (DERs) in the distribution system has led to the emergence of a new market actor - the aggregator. The aggregator serves as a facilitator, enabling flexibility asset owners to get access to different markets. In which, EVs aggregators are gaining more attention due to their expanding use and potential to provide services in various types of markets, particularly in the reserve market. Currently, TSO indirectly utilizes these resources under the management of the distribution system operators (DSO), which can negatively impact the distribution grid. Conversely, adjustments from DSOs can impact service provision to TSO due to the shortage of TSO usage information. These factors highlight the importance of evaluating the service provision from aggregators under different TSO-DSO coordination schemes. This paper focuses on the provision of flexibility from electric vehicles (EVs) aggregators for balancing service in the TSO-DSO hybrid-managed and compares it with the DSOmanaged coordination schemes. The behavior of aggregators reacting to price fluctuations and TSO requests under different coordination schemes and simulation scenarios is thoroughly evaluated. Additionally, their impact on the grid is analyzed through the DSO's congestion management process and validated using data from a real part of the Dutch distribution network. Results find that the hybrid-managed coordination scheme gives more benefit to the aggregator than the DSO-managed scheme and the EVs aggregator will gain more profit in winter than summer due to more upward regulation service is needed.

Index Terms—TSO-DSO coordination, DERs, aggregator, congestion, flexibility.

I. INTRODUCTION

Along with exploiting the potential of distributed energy resources, providing flexibility services with these sources attracts the attention of many organizations and research groups and has already been implemented in some European countries like France, Finland, Hungary, Estonia, Denmark, Belgium, Romania, etc [1]. The role of the aggregator - a market participant responsible for bundling flexibility from multiple small customers and producers into a portfolio and offering the combined capacity in other markets [2] - is becoming increasingly important. Many research studies focus on optimal biding strategies [3]–[8], providing service to multiple markets (e.g., spot market, reserve, [3], [9]–[12] congestion

management services [7] or balancing portfolios [3]) and leveraging the potential of diverse appliances including electric vehicles (EVs), battery energy storage system (BESS), heat pumps, thermal-controlled load or their combination.

Recently, EV aggregators are receiving increasing attention due to their expanding use, driven by environmental factors and government incentives. In 2023, the Netherlands was the sixth-largest EV market in Europe with more than 300 thousand battery electric vehicles registered and leads in EV infrastructure [13]. Research on the Dutch situation shows the potential of EV aggregators to provide service in the reserve market [10]. EV fleets also have the potential to provide flexibility to the internal balancing portfolio [3], and congestion management [7]. The above studies show that EV aggregators have great prospective to provide flexibility services and bring benefits not only for aggregators but also for prosumers and system operators. Therefore, the detailed EV aggregator is investigated in this research to consider its behaviors on different market price fluctuations.

Moreover, the above research works focus on the aggregator business model when providing service to the transmission system operator (TSO) without a comprehensive analysis impact on the grid under the management of the distribution system operator (DSO). While an effective approach to leveraging DER flexibility is enhancing TSO-DSO coordination [14]. In recent years, TSO-DSO coordination has grown into a research trend of great interest to many researchers. Arthur et al [15] classify the existing coordination into three main schemes (1) TSO-managed; (2) DSO-managed; and (2) TSO-DSO Hybrid. The first one prioritizes the TSO in using flexibility, restricting the DSO from resources connected to their network. Conversely, the DSO-managed model assigns a greater role along with responsibility to DSO in optimizing the utility of flexibility. DSOs are prioritized to use the DER flexibility to manage congestion in their grids, then send the remainder to the central market. However, this scheme has the potential to create conflicts of benefit among DSOs. The Hybrid TSO-DSO managed model appears to be the most balanced option as TSO and DSO manage their own market and it allows TSO to use service with DSO's consent. This coordination aligns well with the prevailing circumstances in many countries and offers distinct advantages over others by

The authors would like to acknowledge the financial support for this work from the Netherlands Organization for Scientific Research (NWO) funded DEMOSES project.

empowering DSOs role and fostering greater social welfare. Therefore, the DSO-TSO hybrid-managed model is one of the schemes selected for investigation in this research.

Considering the provision of DERs flexibility from the aggregator within TSO-DSO coordination offers a broader perspective by highlighting the risk of violating grid constraints when procuring flexibility for the TSO. Therefore, this research constructs a comprehensive model for the EV aggregator to provide multiple services in different TSO-DSO coordination schemes. To the best of the authors's knowledge, this topic has not been widely explored in the literature. This paper finds some similarities with the 3 papers [16]-[18] in using flexibility from the distribution grid via aggregator while considering the TSO-DSO coordination. However, unlike [16], this paper models the detail of EV aggregator, improves the DSO model with linearized ACOPF and compares the flexibility provision in 2 different coordination schemes. In [17], the authors show that 16% and nearly 52% of the operational cost is reduced for TSO and DSO, respectively. While aggregator lost about 54% profit in the DSO-managed model. They didn't show how it would be different if TSO used flexibility from the aggregator in the balancing market. Compared with [18], this paper models the EV aggregator that considers individual EV to ensure EV energy within the limit range while providing vehicle to grid service and considering the TSO-DSO hybrid-managed model that advances over the DSO-managed coordination scheme.

The contributions of this work are as follows:

- Modeling the interaction between TSO, DSO and EV aggregator in the provision of balancing service (aFRR), while considering the constraint in the distribution grid.
- Considering the service provision in different TSO-DSO coordination schemes and validating the mechanism to one part of the distribution network of the Netherlands.
- Analysing the behavior of multiple EV aggregators in price fluctuations and seasonal changes.

The remainder of the paper is organized into four main parts. Firstly, Section II introduces the interaction of aggregator, TSO and DSO in different coordination schemes. The mathematical model of EV aggregator, TSO and DSO is presented in Section III. Section IV assesses and discusses the aggregator behavior and cost analysis via case study and simulation results. Finally, the conclusions are presented in Section V.

II. TSO-DSO COORDINATION WITH AGGREGATOR PARTICIPATION

Coordination between TSOs and DSOs can occur in various processes including pre-qualification, offering, and real-time activation of services. In the case of the Dutch balancing service, they coordinate pre-qualification of the equipment specifications before granting permission to connect to the grid. However, there is no interaction during the bidding and activation process, which takes place in real-time and near realtime. Balancing service is normally provided to TSO from the large generator and demand via a balancing service provider (BSP) [19]. A BSP offers a balancing service to TSO to balance out any unpredicted imbalances in the electricity grid. Two balancing services are used in the Netherlands, automatic frequency restoration reserve (aFRR) and manual frequency restoration reserve (mFRR). aFRR is frequently used to correct the imbalance within 15 minutes, while mFRR is used for larger and longer disturbances. Currently, BSP also takes the role of aggregator to provide these services by combining resources from scattered customers. In this study, coordination in the offering process for aFRR provision is proposed with two different schemes: the DSO-managed model and the TSO-DSO hybrid-managed model.

A. TSO-DSO hybrid-managed




Fig. 1. TSO-DSO hybrid-managed coordination scheme.

The first diagram is presented in Fig. 1, with 5 main processes. In which, the aggregator is responsible for aggregating all the resources from their prosumers, determining the optimal bidding strategy and sending it to the balancing responsible party (BRP) before the previous market gate closing date and determining the volume they will dedicate to service balancing. The TSO will make the economic dispatch offers and define the merit order list (MOL) (a list of offers sorted by price from low to high) for the next two imbalance settlement period (ISP), which is 30 minutes in the Netherlands. After receiving the MOL from the TSO, the DSO proceeds to validation, eliminate invalid bids/offers, and notify the TSO of the valid results. The processes are as follows:

- 1) Aggregator optimizes their bidding strategy and defines the volume they can bid for regulation service.
- 2a) Aggregator sends the volume they can bid for upward and downward regulation to TSO.
- 3a) TSO sends the MOL to DSO per ISP.
- 4a) DSO updates the boundary from the MOL and sends the new boundary to TSO.
- 5) TSO activates service in real-time.

The coordination between TSO and DSO starts from step 3a), after receiving the upper and lower boundary from the aggregator, TSO performs economic dispatch of flexibility to define the MOL and requests DSO for validation. Then, DSOs perform power flow analysis and inform TSO congestion state of the grid according to the traffic light concept mentioned in [20]. The green state means no congestion occurs. The yellow state informs the congestion happening in their network, DSO updates the upper and lower boundary of the flexibility by using linearized ACOPF and sends the new value to the TSO. Finally, the new boundary is sent to TSO.

B. DSO-managed




Fig. 2. DSO-managed coordination scheme.

Figure 2 illustrates the schemes where the DSO is prioritized in utilizing flexibility. The sequence of information exchange differs and is described below:

- Aggregator optimal bidding strategy and define the volume they can bid for upward and downward regulation.
- 2b) Aggregators send the volume they can bid for upward and downward regulation to **DSO**.
- 3b) DSO sends the new boundary of the upward/downward volume that the aggregator can provide to TSO.
- 4) TSO defines the MOL and sends activation requests to the aggregator in real-time.

The difference with the previous coordination schemes lies in step 2b, the aggregator will send their flexibility boundaries to DSO for validation instead of to the TSO. DSO updates the generation and demand of the grid with all flexibility and performs power flow analysis to check the congestion state in their network. Then DSO applies linearized ACOPF to determine the new boundaries of flexibility. Until no congestion occurs, DSO sends new boundaries to TSO. Finally, TSO defines the MOL based on the new boundaries.

In the above processes, the aggregator performs its functions the day before, while the TSO and DSO exchange data during the offering of aFRR services. The service cost and benefit are determined when the market closes. Moreover, when providing services to the TSO, the aggregator deviates from the day-ahead schedule submitted to the BRP the day before [21]. As a result, the aggregator incurs a deviation fee payable to the BRP to compensate for the imbalance. This fee influences the aggregator's decisions regarding how much flexibility to reserve. In addition to the deviation fee, the TSO's minimum bid size presents another challenge for aggregators. To facilitate greater DER flexibility, the TSO should consider lowering the minimum bid size and increasing procurement times to reduce the uncertainty associated with forecast errors [22]. Therefore, this study assumes that TSO will use all resources provided by the aggregator.

III. MATHEMATICAL MODELS

The mathematical representation of TSO, DSO and aggregator model will be discussed in the following subsections.

A. Aggregator model

The aggregator links prosumers and markets by determining the optimal bidding schedule to purchase electricity from the day-ahead market to sell to prosumers and to purchase services from prosumers to sell to other markets. Their objective is to maximize total benefit when providing services. The aggregator objective function and the relevant constraints for the whole day (96 steps) is present in Eq. 1 as below:

$$F^{Agg} = \sum_{t}^{T} \sum_{i}^{N} E_{i,t}^{\uparrow}(\lambda_{t}^{\uparrow} - \lambda^{\text{brp}}) + E_{i,t}^{\downarrow}(\lambda_{t}^{\downarrow} + \lambda^{\text{brp}}) + E_{i,t}^{\text{da}}(\lambda_{t}^{\text{da}} - \lambda^{\text{p}})$$
(1)

The following constraints need to be satisfied:

0

 $E_{i.t}^{\uparrow}$

$$\sum_{t \in T} E_{i,t}^{\uparrow} = 0 \quad \forall i, t \in [T_{\mathsf{d},i}, T_{\mathsf{a},i}]) \quad (2)$$

$$\sum_{t \in T} E_{i,t}^{\downarrow} = 0 \quad \forall i, t \in [T_{\mathsf{d},i}, T_{\mathsf{a},i}]) \quad (3)$$

$$\sum_{t \in T} E_{i,t}^{\mathrm{da}} = 0 \quad \forall i, t \in [T_{\mathrm{d},i}, T_{\mathrm{a},i}]) \quad (4)$$

$$P_{i,t}^{\uparrow} = E_{i,t}^{\uparrow} / \Delta T \quad \forall t, i$$
 (5)

$$P_{i,t}^{\downarrow} = E_{i,t}^{\downarrow} / \Delta T \quad \forall t, i \tag{6}$$

$$P_{i,t}^{aa} = E_{i,t}^{aa} / \Delta T \quad \forall t, i \tag{7}$$

$$\begin{cases} P_{i,t}^{\uparrow} = 0 & \text{if } \lambda_t^{\uparrow} = 0, \\ \underline{P_i^{\uparrow}} u_{i,t} \le P_{i,t}^{\uparrow} \le \overline{P_i^{\uparrow}} u_{i,t} & \text{if } \lambda_t^{\uparrow} \ne 0 \end{cases} \quad \forall t, i \tag{8}$$

$$\begin{cases} P_{i,t}^{\downarrow} = 0 & \text{if } \lambda_t^{\downarrow} = 0, \\ P_i^{\downarrow} v_{i,t} \le P_{i,t}^{\downarrow} \le \overline{P_i^{\downarrow}} v_{i,t} & \text{if } \lambda_t^{\downarrow} \ne 0 \end{cases} \quad \forall t, i \tag{9}$$

$$\underline{P_{i}^{\downarrow}}w_{i,t} \le P_{i,t}^{da} \le \overline{P_{i}^{\downarrow}}w_{i,t} \quad \forall t, i$$
(10)

$$u_{i,t} + v_{i,t} + v_{i,t} \le 0 \quad \forall t, i \tag{11}$$

$$2 \le E_{i,t}^{\text{EV}} / E_i^{\text{EV,Size}} \le 1 \quad \forall t, i \tag{12}$$

$$E_{i,t}^{\rm EV} = E_i^{\rm EV,Size} \quad \forall i,t = 0 \quad (13)$$

$$E_{i,t}^{\text{EV}} = E_i^{\text{EV,Size}} \quad \forall i, t = T_{d,i} \neq 0)$$
(14)

$$E_{i,t}^{\text{EV}} = E_i^{\text{EV,Size}} \quad \forall i, t = 95 (\neq T_a) \tag{15}$$

$$+E_{i,t}^{\downarrow}+E_{i,t}^{da}=E_{i,t-1}^{EV}-E_{i,t}^{EV} \quad \forall i,t \notin [T_{d,i},T_{a,i}]$$
 (16)

$$E_{i,t}^{\text{EV}} = E_{i,t-1}^{\text{EV}} - E_i^{EV,trip}/TL \quad \forall i,t \in [T_{d,i},T_{a,i}]$$
(17)

The volumes of flexibility used by each EV for upward and downward and the volume of energy bought from the day-ahead market are E_i^{\uparrow} , E_i^{\downarrow} , and E_i^{da} accordingly. The set of λ^{\uparrow} , λ^{\downarrow} and λ^{da} are balancing price of flexibility for regulating upward, downward and the day-ahead price. λ_{brp} is the contracted price between aggregator with BRP to pay for their deviation with the day-ahead schedule. λ_p is the price aggregator sell electricity to the EV's owner for charging their EV. And N is the number of EVs considered.

Aggregator considers Eq. 2, Eq. 3 and Eq. 4 to make sure the EV will not interact with the electricity market when EVs are away from home, it means the total of energy provided for upward or downward regulation or buy from the DA market is zeros after the departure time (T_d) and before arrival time (T_a) . In this study, EV is assumed to have only one leave session per day. Equations 5, 6 and 7 present the relationship between power (P_i) and energy (E_i) within one ISP, ΔT is 0.25 hour. Besides, power charge/discharge is limited to the min/max charging rate $(P_i^{\downarrow}, \overline{P_i^{\downarrow}})$ or min/max discharging rate $(P_i^{\uparrow}, P_i^{\uparrow})$ by Eq. 8, 9 and 10. Constraint 11 ensures that the aggregator will provide multiple services with the "In time" stacking type. This means that the EV will not provide up or downward service or buy from the DA market at the same time thanks to the use of the binary variables $u_{i,t}, v_{i,t}$ and $w_{i,t}$. Moreover, the state of charge (SOC) of each EV is constrained by Eq. 12 means that EV will not charge over maximum capacity (100%) and will not discharge lower than 20% because deeper discharges can lead to accelerated wear and reduced lifespan of the battery.

At the beginning of the day, before leaving home and before midnight EV energy $(E_{i,t}^{\rm EV})$ is initialized to be fully charged in Eq. 13, Eq. 14, Eq. 15. Equation 16 updates the EV's energy by step when EV is at home, EV energy at step t is equal to the energy from the previous step with the change from total energy charge and discharge. When EV leaves home, 17 energy is assumed to decrease gradually by the total energy for the trip $(E_i^{EV,trip})$ divided by the trip length (TL).

B. TSO model

TSO leverages the DER flexibility to minimize the cost they pay to balance the system per each ISP. TSO objective function is described in Eq. 18 and the constraints following need to be satisfied:

$$F_t^{TSO} = \sum_{m \in M} E_{m,t}^{a,\uparrow} \lambda_m^{a,\uparrow} + \sum_{k \in K} E_{k,t}^{a,\downarrow} \lambda_k^{a,\downarrow} + E_t^{r,\uparrow} \lambda_t^{\uparrow} - E_t^{r,\downarrow} \lambda_t^{\downarrow}$$
(18)

$$\sum_{m \in M} E_{m,t}^{a,\uparrow} + E_t^{r,\uparrow} = E_t^{reg,\uparrow} \quad \forall m,t$$
(19)

$$\sum_{k \in K} E_{k,t}^{a,\downarrow} + E_t^{r,\downarrow} = E_t^{reg,\downarrow} \quad \forall k,t$$
 (20)

$$\underline{E_{m,t}^{a,\uparrow}} \le E_{m,t}^{a,\uparrow} \le \overline{E_{m,t}^{a,\uparrow}} \quad \forall m,t$$
(21)

$$\underline{E_{k,t}^{a,\downarrow}} \le E_{k,t}^{a,\downarrow} \le E_{k,t}^{a,\downarrow} \quad \forall k,t$$
(22)

$$E_{k,t}^{a,\downarrow} \le 0 \le E_{m,t}^{a,\downarrow} \quad \forall m, k, t$$

$$E_{k,t}^{r,\downarrow} \le 0 \le E_{t}^{r,\uparrow} \quad \forall t$$

$$(23)$$

$$\overline{E_{m,t}^{a,\uparrow}} = \sum_{n \in N} E_{n,t}^{\uparrow} \quad \forall m,t$$
(25)

$$\underline{E_{k,t}^{a,\downarrow}} = \sum_{n \in N} E_{n,t}^{\downarrow} \quad \forall k,t$$
 (26)

$$\underline{E}_{m,t}^{a,\uparrow} = \overline{E_{k,t}^{a,\downarrow}} = 0 \quad \forall m, k, t$$
 (27)

In the offering process, TSO defines a list of selected bids, with prices ranging from low to high until the required quantity is reached to ensure balance. Therefore, the bid prices $(\lambda_m^{a,\uparrow}, \lambda_k^{a,\downarrow})$ for regulating upward and for regulating downward by aggregator m and k are factored into the cost function of TSO. Besides, λ_t^{\uparrow} and λ_t^{\downarrow} are prices of reserve capacity for regulating upward and for regulating downward from reserve units, which is assumed equal the balancing prices (imbalance price is calculated by the balancing price and most of the time when only upward or downward regulation in an ISP, these prices are identical). The variables $E_{m,t}^{a,\uparrow}, E_{k,t}^{a,\downarrow}$ are the volume of flexibility provided by aggregator m and aggregator k at step t. $E_t^{reg,\uparrow}$ and $E_t^{reg,\downarrow}$ are the total volume activated for regulation and E_t^r is the volume of reserve capacity uses. M and K are the number of aggregator flexibility units.

Equations 19 and 20 ensure that the total volume provided by the DER flexibility and reserve units is equal to the volume required for upward or downward regulation by the TSO. Equations 21 and 22 limit the volume activated by the TSO within the boundary that the aggregator can provide. Equations 23 and 24 represent the sign that the volume regulation for upward regulation is greater than zero and the volume for downward regulation less than zero. While equations 25, 26, and 27 are the boundaries calculated from the output of aggregator models.

C. DSO model

The DSO will receive the MOL from the TSO or the boundaries from the aggregator. Along with their demand forecast, DSO will perform the power flow analysis to check if any congestion occurs in their network. The DSO's objective function is to minimize the potential cost they have to pay to resolve congestion per ISP which is shown in Eq. 28:

$$F_t^{DSO} = \sum_{x \in \Omega_x} (V_{x,t}^{\uparrow} C_t^{\uparrow}) - (V_{x,t}^{\downarrow} C_t^{\downarrow})$$
(28)

In this case, only congestion caused by the activation of downward or upward regulation from the EVs aggregators within the management of DSO is considered. Therefore, flexibility used to solve congestion is from the same aggregation unit as TSO. $V_{x,t}^{\uparrow}, V_{x,t}^{\downarrow}$ are the volume of flexibility used for managing congestion at node x, which is in a set of buses Ω_x . M and K is a subset of Ω_x . C_t^{\uparrow} and C_t^{\downarrow} are congestion prices of flexibility for adjusting upward and downward at step t.

In the TSO-DSO hybrid-managed model, the DSO uses Eq. 29 and Eq. 30 to update the demand $P_{i,t}^{d'}$ and generation $P_{i,t}^{g'}$ in the next two ISPs with the volumes used by the TSO from the MOL $E_{x,t}^{a,\uparrow}, E_{x,t}^{a,\downarrow}$. Then, DSO performs the optimal power flow calculation based on Eq. 31-38 to determine the flexibility volume $V_{x,t}^{\uparrow}, V_{x,t}^{\downarrow}$ to resolve congestion. If the optimization calculation gives a feasible solution, meaning that the amount of flexible resources from the aggregators is sufficient to resolve the congestion caused by the use of the TSO's service. Otherwise, the boundary for the TSO is divided by *step*-th in 39 and 40. TSO can only use resources within this new limitation. The process is then performed until the DSO finds

the optimal solution or reaches the stopping condition after five divisions, the $E_{m,t}^{a,\uparrow'}, E_{k,t}^{a,\downarrow'}$ are reset to 0.

$$P_{x,t}^{g'} = P_{x,t}^g + E_{x,t}^{a,\uparrow'} \quad \forall x,t \qquad (29)$$

$$P_{x,t}^{d'} = P_{x,t}^{a,\downarrow'} - E_{x,t}^{a,\downarrow'} \quad \forall x,t \qquad (30)$$

$$V_{x,t}^{\uparrow} + V_{x,t}^{\downarrow} + P_{x,t}^{g'} - P_{x,t}^{d'} = \sum_{y \in J_x} Flow_{xy,t} \quad \forall x, y, t \quad (31)$$

$$\underline{E}_{x,t}^{a,\uparrow} \le V_{x,t}^{\uparrow} \le \overline{E}_{x,t}^{a,\uparrow} \quad \forall x,t \qquad (32)$$

$$\underline{E_{x,t}^{a,\downarrow}} \le V_{x,t}^{\downarrow} \le E_{x,t}^{a,\downarrow} \quad \forall x,t \qquad (33)$$

$$V_{x,t}^{\downarrow} \le 0 \le V_{x,t}^{\uparrow} \quad \forall x,t$$
 (34)

$$Flow_{xy,t} = -Flow_{yx,t} \quad \forall x, y, t \quad (35)$$

$$Flow_{xy,t} < Rated_{xy}PF \quad \forall x, y, t \quad (36)$$

$$Flow_{xy,t} = Base_{MVA}B_{xy}(\theta_{x,t} - \theta_{y,t}) \quad \forall x, y, t \quad (37)$$

$$B_{xy} \approx X_{xy} / (R_{xy}^2 + X_{xy}^2) \quad \forall x, y \tag{38}$$

$$E_{x,t}^{a,\uparrow} = E_{x,t}^{a,\uparrow} / step - V_{x,t}^{\uparrow} \quad \forall x,t$$
(39)

$$E_{x,t}^{a,\downarrow'} = E_{x,t}^{a,\downarrow}/step - V_{x,t}^{\downarrow} \quad \forall x,t$$
 (40)

Differently, in the DSO-managed coordination scheme, <u>DSO</u> updates the demand and generation at each node with $\overline{E_{x,t}^{a,\uparrow}}, E_{x,t}^{a,\downarrow}$ from the aggregator.

Active power balance at node x at step t is presented in Eq. 31, in which, J_x is the subset of nodes that are connected to node x. This constraint needs to be satisfied for all nodes in the network. Similar to TSO model, the constraints on flexibility boundaries are presented in Eq. 32, Eq. 33 and Eq. 34. Power flow symmetry condition in Eq. 35 means that the flow of power from node x to node y $(Flow_{xy})$ is opposite to the value of flow from node y to node x. This value is determined by the base power for the network (in MVA) $Base_{MVA}$, the susceptance of line in per unit B_{xy} and the voltage phase angle difference $\theta_{x,t}$ and $\theta_{y,t}$. B_{xy} is calculated by resistance and reactance of the line in Eq. 38. Moreover, the rated value of each branch ($Rated_{xy}$) in Eq. 36 multiplied with the power factor PF forms the thermal rating threshold for each branch. The power factor PF is considered 98% in this study. The above problems are mixed-integer linear programming (MILP) problems and are solved by the Gurobi solver in Pyomo.

IV. CASE STUDIES

The two proposed coordinations with DERs' flexibility provided by the aggregator are validated using the real distribution network in the Bleiswijk station in the northern part of the Netherlands. This network includes 4 step-down two-winding transformers from 25kV to 10.5kV, 182 busbars, 867 terminals, 224 lines, 25 synchronous machines, 170 substations, and 166 loads. The total installed capacity is 66.06 MW with a total spinning reserve is 11.36 MW. The PV penetration rate is 12.85% (8.5MW) from 16 installation points. The aggregator for upward is connected to nodes 12, 42, 145, 146, and 147 and for downward is connected to nodes 15, 18, 41, 179, and 183 in the network. Each aggregator manages 100 EVs and the aggregated flexibilities are identical. The only difference is their bid prices, which are presented in Tables I. One week in summer and one week in winter, different BRP prices are simulated to consider the aggregator behavior in price fluctuations and seasonal changes.

TABLE I THE DER FLEXIBILITY FOR UPWARD REGULATION

Unit	Name	Node	Туре	Price
				(€/MWh)
1	EV_Agg1	12	upward	25
2	EV_Agg2	42	upward	30
3	EV_Agg3	145	upward	20
4	EV_Agg4	146	upward	40
5	EV_Agg5	147	upward	35
6	EV_Agg6	18	downward	5
7	EV_Agg7	15	downward	10
8	EV_Agg8	179	downward	15
9	EV_Agg9	41	downward	-5
10	EV_Agg10	183	downward	-10

A. Aggregator behavior by market price and season

One week in summer, 2023 from June 26th to July 2nd and one week in winter, 2024 from February 19th to February 25th is selected. With a BRP price of 30 €/MW and a consumer price of 85 €/MW, respectively, which is lower and higher than the average day-ahead price this week. Both in winter and summer, the volume activated for upward and downward is concentrated when the DA price is high, the DA volume is concentrated when the DA price is low, which is presented in Fig. 3 and Fig. 4, respectively. The occurrence of downward service is very low and has the lowest total volume, followed by upward service, and the highest is the volume purchased from the DA market. Besides, the downward volume is densely distributed in the region where the upward price is zero and vice versa sparsely distributed in the high upward price region. The same behavior is for the distribution of upward volume versus downward price. In most cases in reality, when the system is in deficit, the upward regulation price will increase to attract more volume from service providers, the downward regulation at that time will aggravate the situation of the system. Conversely, there is no need for increased volume when the system is surplus, and the downward regulation price goes very low. The distribution of buy volume by DA price and downward volume by downward price in summer is wider than in winter due to energy surplus from solar power plants with zero-marginal prices leading to many negative price cases for DA and downward price. On the opposite, it's wider for upward price range caused by energy shortage in winter.




Fig. 3. Distribution of volume by price in winter.




Fig. 4. Distribution of volume by price in summer.

From the pie chart in Fig. 5 show that the total volume provided for upward service (blue part) in summer is lower than in winter due to the need for more energy in winter. Downward volume (green part) drops sharply in winter when BRP prices are high. The total volume for providing service is higher when the BRP price is small, especially for upward service in winter. Moreover, aggregator profit is inversely proportional to BRP price. The majority of the aggregator's profits come from providing upward services leading to the aggregator's profit in winter being higher than in summer.

BRP price impact is clearly illustrated in the total volume upward, downward regulation, and buy from DA market of each EV. Fig. 6 and Fig. 7 show the difference in the total volume downward when the BRP price is $200 \notin$ /MWh and $30 \notin$ /MWh. The orange bar presents the downward service almost disappears. Besides, the volume for upward (blue bar) is also decreased, leading to the volume bought from the DA market (green bar) being reduced, because they don't have to buy more to compensate for the volume discharge when providing upward service.

B. Grid constraint evaluation

Providing services brings more benefits to aggregators and prosumers. However, a problem arises when the TSO activates the service without considering the distribution network




Fig. 5. Distribution of volume by season with different BRP price.




Fig. 6. Volume by type of EV1 with BRP price = $30 \in /MWh$.




Fig. 7. Volume by type of EV1 with BRP price = $200 \in MWh$.

constraints, and multiple aggregators react at the same time, resulting in congestion within the distribution network. The green line in Fig. 8 shows that activating the TSO balancing service at ISP 44 causes overloading in the main line straight to the connection point with the external grid. The congestion above is due to the regulation upward from TSO, the line loading is nearly 100% because of the upward regulation when the distribution grid is in a low-demand situation, causing a reversed flow from the distribution grid to the transmission grid. This will cause rapid deterioration of the device or damage if the overload condition is prolonged. The dashed red line presents the limitation of the line loading, which is 95% in this study. With the coordination between TSO and DSO, after the DSO updates the MOL sent by TSO, they limit the volume of flexibility that TSO can use. Loading after TSO use flexibility with the new boundary is now below the limit constraints, which are presented by the orange line.

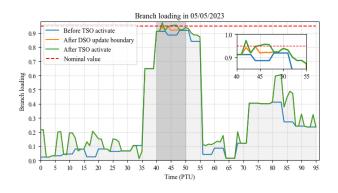


Fig. 8. TSO-DSO hybrid-managed.

In the DSO-managed model, DSO based on the demand forecast for the next 2 ISP, performs power flow analysis with all the flexibility volume sent by the aggregator. The result is presented in the green line in Fig. 9. Similar to the previous case, there is overloading occurs in the ISP 44. Then DSO has to update the boundary and send the new boundary to TSO. The loading of the measuring point is now the orange line, which shows that the limit constraint is satisfied.

However, the different between two cases is that the volume of flexibility that the aggregator can provide in the second case after DSO updates the boundary is less than the previous one, due to DSO not knowing exactly where TSO will call service, they will gradually reduce the boundary for all flexibility units until the congestion can be resolved by the available flexibility. This leads to the loss of profit for aggregators if they reserve energy for providing service in real-time, but this volume is not valid to provide anymore.

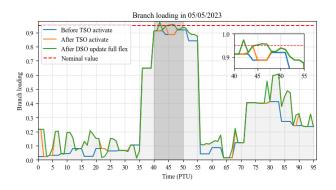


Fig. 9. DSO-managed.

V. CONCLUSION

To effectively harness the potential of the DERs services in the current context, coordination between TSOs and DSOs is necessary to maximize social welfare as well as minimize the risks of conflicting use cases. Notably, DSOs play a more important role in validating services before being utilized by TSOs. This validation ensures that grid constraints are taken into account when providing services from aggregators under the DSO's management. Thereby, mitigating the potential risks of unexpected overload caused by the simultaneous reaction of aggregators with prices and requests from TSOs. Aggregator's objective is to maximize their profits by optimizing bidding strategies. Analyzing the service provision from aggregator shows that similar behavior from multiple aggregators in neighboring regions in response to attractive very high upward regulation price or very low downward regulation price will lead to excessive reversed power flow from their connection points to the higher voltage grid or vice versa. Besides, the price the aggregator contracts with BRP for their real-time deviation has a great impact on the decision to provide services and the final profit. The EVs aggregator will gain more profit from providing the upward regulation service than downward and therefore it is clear that winter will be more profitable due to the higher energy demand and frequency of upward service calls. The coordination between TSO and DSO in the offering process allows the provision of services within the grid constraints. When the TSO has the priority in receiving information in the hybrid-managed model, the DSO updates the boundaries based on the TSO's selected bids. Conversely, in the DSO-managed model, unused bids are considered when DSOs resolve congestion resulting in a larger portion of services being excluded in this scenario compared with the first one. Therefore, the hybrid-managed gives an advantage with more volume provided and more benefit to the aggregator than the DSO-managed coordination scheme. The risks associated with inaccurate forecasts of demand, price, and EV sessions significantly influence the decisions of each participant. These challenges will be addressed in future studies.

REFERENCES

 I. Saviuc, C. Zabala López, A. Puskás-Tompos, K. Rollert, and Bertoldi P. Explicit demand response for small endusers and independent aggregators – status, context, enablers and barriers. Publications Office of the European Union, Luxembourg, 2022.

- [2] Market roles. TenneT, 2022.
- [3] Ö. Okur. Aggregators' business models for flexibility from electricity consumers. [Dissertation (TU Delft), Delft University of Technology], 2021.
- [4] Homa Rashidizadeh-Kermani, Hamid Reza Najafi, Amjad Anvari-Moghaddam, and Josep M. Guerrero. Optimal decision-making strategy of an electric vehicle aggregator in short-term electricity markets. *Energies*, 11(9), 2018.
- [5] José Iria and Filipe Soares. Real-time provision of multiple electricity market products by an aggregator of prosumers. *Applied Energy*, 255:113792, 2019.
- [6] José Iria, Filipe Soares, and Manuel Matos. Optimal bidding strategy for an aggregator of prosumers in energy and secondary reserve markets. *Applied Energy*, 238:1361–1372, 2019.
- [7] Christoph Loschan, Daniel Schwabeneder, Georg Lettner, and Hans Auer. Flexibility potential of aggregated electric vehicle fleets to reduce transmission congestions and redispatch needs: A case study in austria. *International Journal of Electrical Power & Energy Systems*, 146:108802, 2023.
- [8] S. Minniti, A.N.M.M. Haque, N.G. Paterakis, and P.H. Nguyen. A hybrid robust-stochastic approach for the day-ahead scheduling of an ev aggregator. In 2019 IEEE Milan PowerTech, pages 1–6, 2019.
- [9] Johannes Jargstorf and Manuel Wickert. Offer of secondary reserve with a pool of electric vehicles on the german market. *Energy Policy*, 62:185–195, 2013.
- [10] T.W. Hoogvliet, G.B.M.A. Litjens, and W.G.J.H.M. van Sark. Provision of regulating- and reserve power by electric vehicle owners in the dutch market. *Applied Energy*, 190:1008–1019, 2017.
- [11] Nadali Mahmoudi, Ehsan Heydarian-Forushani, Miadreza Shafie-khah, Tapan K. Saha, M.E.H. Golshan, and Pierluigi Siano. A bottom-up approach for demand response aggregators' participation in electricity markets. *Electric Power Systems Research*, 143:121–129, 2017.
- [12] Junjie Hu, Guangya Yang, Charalampos Ziras, and Koen Kok. Aggregator operation in the balancing market through network-constrained transactive energy. *IEEE Transactions on Power Systems*, 34(5):4071– 4080, 2019.
- [13] Evboosters Powering charging careers. https://evboosters.com/ev-charging-news/ week-9-the-electric-vehicle-market-in-the-netherlands/?utm_source= chatgpt.com. Accessed: 2025-01-01.
- [14] P.C.d. Granado, J. Rajasekharan, and S.V. et al. Pandiyan. Flexibility characterization, aggregation, and market design trends with a high share of renewables: a review. *Curr Sustainable Renewable Energy*, 2023.
- [15] Arthur Gonçalves Givisiez, Kyriacos Petrou, and Luis F. Ochoa. A review on tso-dso coordination models and solution techniques. *Electric Power Systems Research*, 189:106659, 2020.
- [16] Hang Nguyen, Trung Thai Tran, Kha T. Nguyen, Koen Kok, and Phuong H. Nguyen. Tso-dso coordination to effectively integrate der flexibility into the balancing market. In 2024 IEEE/IAS Industrial and Commercial Power System Asia (I&CPS Asia), pages 307–312, 2024.
- [17] Tayfur Gokcek and Ozan Erdinc. Tri-level tso/dso coordination approach considering active interaction with the flexibility of microgrid aggregators. In 2023 12th International Conference on Power Science and Engineering (ICPSE), pages 29–34, 2023.
- [18] Lusha Wang, Jonghwan Kwon, Noel Schulz, and Zhi Zhou. Evaluation of aggregated ev flexibility with tso-dso coordination. *IEEE Transactions* on Sustainable Energy, 13(4):2304–2315, 2022.
- [19] Aleksandra Roos. Designing a joint market for procurement of transmission and distribution system services from demand flexibility. *Renewable Energy Focus*, 21:16–24, 2017.
- [20] Calum Edmunds, Stuart Galloway, Ian Elders, Waqquas Bukhsh, and Rory Telford. Design of a dso-tso balancing market coordination scheme for decentralised energy. *IET Generation Transmission & Distribution*, 14, 01 2020.
- [21] Marten van der Laan and Hans de Heer. Usef: Work stream on aggregator implementation models. USEF, 2016.
- [22] Webinar 1 The smartEn map: Ancillary Services 2022. https://smarten. eu/events/webinar-1-the-smarten-map-ancillary-services-2022/. Accessed: 2023-11-01.